



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id

**VILTER ENG #1 HS #1**

Component

**Reciprocating Compressor**

Fluid

**VILTER 717 COMPRESSOR OIL ISO 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The oil viscosity is higher than typical. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0946954</b>	---	---
Sample Date	Client Info		<b>17 Jun 2024</b>	---	---
Machine Age	hrs	Client Info	<b>20318</b>	---	---
Oil Age	hrs	Client Info	<b>10000</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	---	---
Iron	ppm	ASTM D5185(m) >50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185(m) >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m) >25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185(m) >25	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m) >50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185(m) >15	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>0</b>	---	---
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m)	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Zinc	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Sulfur	ppm	ASTM D5185(m)	<b>13</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<b>0</b>	---	---
Sodium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	---	---
Water	%	ASTM D6304* >0.1	<b>0.002</b>	---	---
ppm Water	ppm	ASTM D6304* >1000	<b>17</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.2	<b>0.01</b>	---	---



# OIL ANALYSIS REPORT

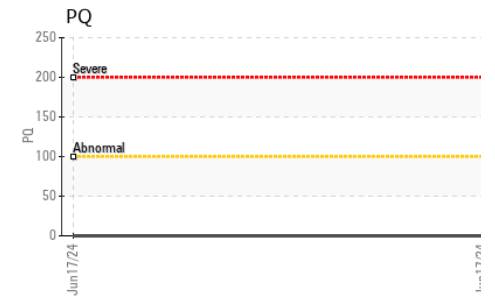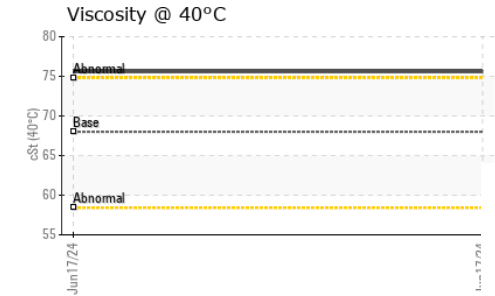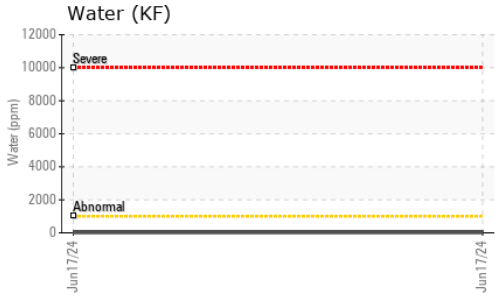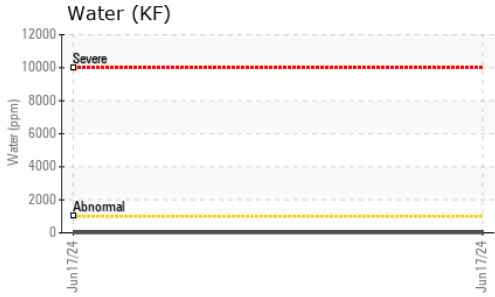






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.1	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	68	75.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

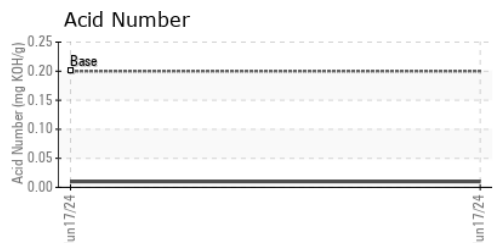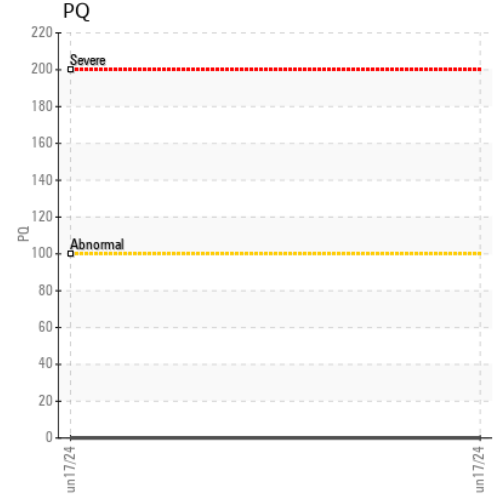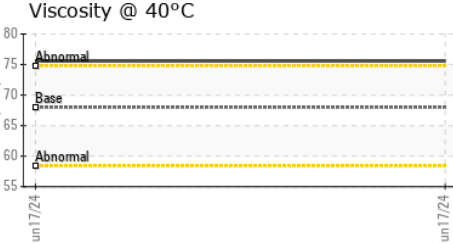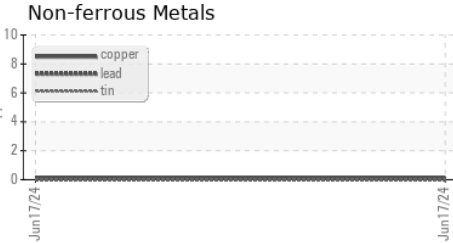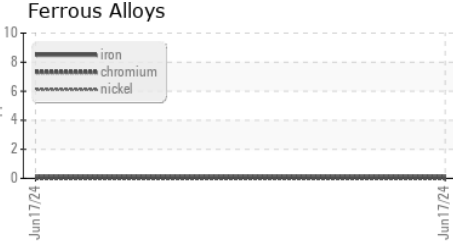

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0946954 **Received** : 19 Jun 2024  
**Lab Number** : **02642965** **Tested** : 20 Jun 2024  
**Unique Number** : 5800504 **Diagnosed** : 21 Jun 2024 - Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: KF, TAN Man )

**CONESTOGA COLD STORAGE**  
 2660 MEADOWPINE BLVD., DOOR 57, CALL EXT. 2317  
 MISSISSAUGA, ON  
 CA L5N 7E6  
 Contact: Jeremy Koziol  
 jkoziol@coldstorage.com  
 T: (519)748-4086  
 F: (905)567-1844

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.