




OIL ANALYSIS REPORT

Sample Rating Trend

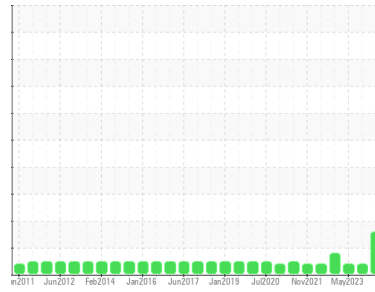

VISCOSITY



Area

BRUCE B/5/71210

Machine Id

5-71210-P2-PM Lo Brg Level

Component

Lower Bearing

Fluid

ESSO TERESSO ISO 68 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

Contaminants

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

Oil Condition

Viscosity of sample indicates oil is within ISO 150 range, advise investigate. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WC0900713 | WC0845378 | WC0744583 |
| Sample Date | Client Info | | 10 Jun 2024 | 18 Jan 2024 | 11 May 2023 |
| Machine Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Changed | Client Info | | N/A | N/A | N/A |
| Sample Status | | | ABNORMAL | ABNORMAL | ABNORMAL |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|-------------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185(m) >10 | 0 | 0 | 0 |
| Chromium | ppm | ASTM D5185(m) >5 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185(m) >5 | <1 | <1 | 0 |
| Titanium | ppm | ASTM D5185(m) >5 | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185(m) >5 | <1 | <1 | 0 |
| Lead | ppm | ASTM D5185(m) >5 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185(m) >5 | 0 | 0 | 0 |
| Tin | ppm | ASTM D5185(m) >5 | 0 | 0 | <1 |
| Antimony | ppm | ASTM D5185(m) | 0 | 0 | <1 |
| Vanadium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|--------------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185(m) 4.5 | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185(m) 0.4 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185(m) 0 | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185(m) 0 | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185(m) 0 | <1 | <1 | 0 |
| Phosphorus | ppm | ASTM D5185(m) 0.7 | <1 | <1 | 2 |
| Zinc | ppm | ASTM D5185(m) 0 | 1 | 1 | <1 |
| Sulfur | ppm | ASTM D5185(m) 1315 | 4850 | 5171 | 4999 |
| Lithium | ppm | ASTM D5185(m) | <1 | <1 | <1 |


CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|--------------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185(m) >5 | <1 | <1 | <1 |
| Sodium | ppm | ASTM D5185(m) >5 | 0 | 0 | 0 |
| Potassium | ppm | ASTM D5185(m) >20 | 0 | <1 | 0 |
| Water | % | ASTM D6304* >0.005 | 0.001 | 0.001 | 0.00 |
| ppm Water | ppm | ASTM D6304* >50 | 13 | 14 | 0.00 |

FLUID CLEANLINESS






| | method | limit/base | current | history1 | history2 |
|-----------------|--------------|------------|-------------------|----------|----------|
| Particles >4µm | ASTM D7647 | >5000 | ▲ 14033 | 1291 | 2292 |
| Particles >6µm | ASTM D7647 | >1300 | ▲ 3901 | 369 | 679 |
| Particles >14µm | ASTM D7647 | >320 | 170 | 31 | 59 |
| Particles >21µm | ASTM D7647 | >80 | 33 | 9 | 13 |
| Particles >38µm | ASTM D7647 | >20 | 1 | 1 | 1 |
| Particles >71µm | ASTM D7647 | >4 | 0 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) | >19/17/15 | ▲ 21/19/15 | 17/16/12 | 18/17/13 |

Particle Filter (Magn: 200 x)

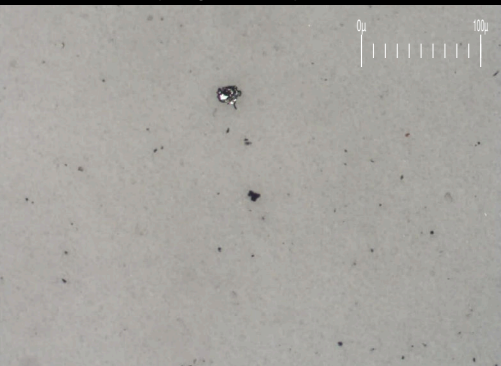



OIL ANALYSIS REPORT

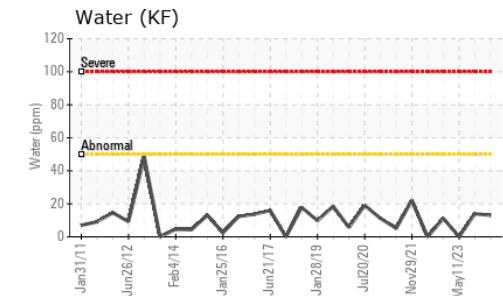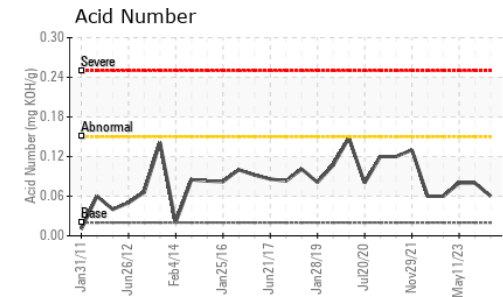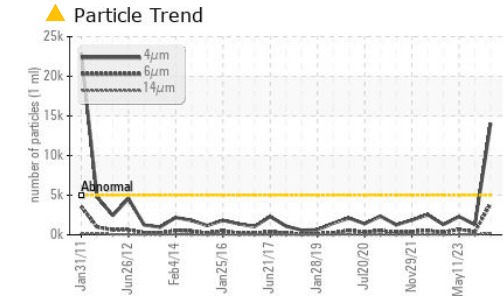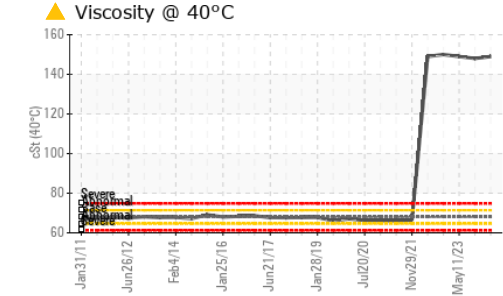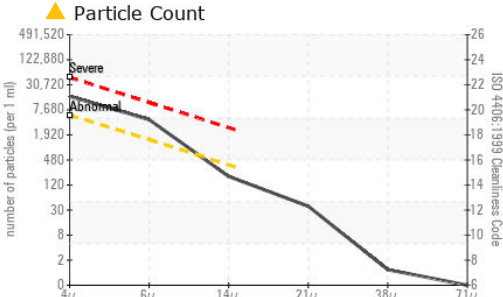

| FLUID DEGRADATION | method | limit/base | current | history1 | history2 | |
|-------------------|----------|------------|---------|-------------|----------|------|
| Acid Number (AN) | mg KOH/g | ASTM D974* | 0.02 | 0.06 | 0.08 | 0.08 |

| VISUAL | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|--------------|----------|-------|
| White Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Precipitate | scalar | Visual* | NONE | NONE | NONE | NONE |
| Silt | scalar | Visual* | NONE | NONE | NONE | NONE |
| Debris | scalar | Visual* | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | Visual* | NONE | NONE | NONE | NONE |
| Appearance | scalar | Visual* | NORML | NORML | NORML | NORML |
| Odor | scalar | Visual* | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | Visual* | >0.005 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|---------------|---------|--------------|----------|-------|
| Visc @ 40°C | cSt | ASTM D7279(m) | 68 | ▲ 149 | ▲ 148 | ▲ 149 |

SAMPLE IMAGES

| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------|---|--|--|
| Color | | |  |  |  |
| Bottom | | |  |  |  |
| PrtFilter | | |  | no image | no image |



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0900713
Lab Number : 02642978
Unique Number : 5800517
Test Package : IND 2 (Additional Tests: A-FERR, BottomAnalysis, DR-FERR, FILTERPATCH, PrtFilter, TAN)

Bruce Power - Bruce A PdM
 P.O.Box 1540, 177 Tie Road., RM-222 U2 Column 2N11 615'
 Tiverton, ON
 CA N0G 2T0
 Contact: Pierre Adouki
 pierre.adouki@brucepower.com


To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.



FERROGRAPHY REPORT

Area
BRUCE B/5/71210
 Machine Id
5-71210-P2-PM Lo Brg Level
 Component
Lower Bearing
 Fluid
ESSO TERESSO ISO 68 (--- GAL)

Magn: 200x Illum: BC

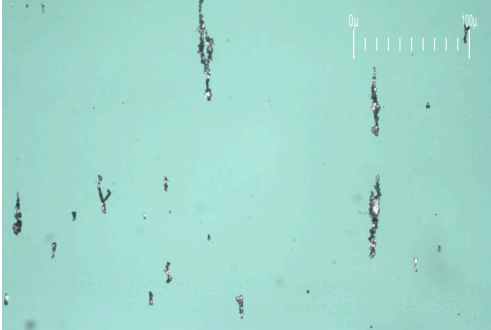

Magn: 50x Illum: RW



Magn: 100x Illum: RW




| DR-FERROGRAPHY | | method | limit/base | current | history1 | history2 |
|----------------------------|---|----------|------------|---------|----------|----------|
| Large Particles | | DR-Ferr* | | 1.4 | --- | --- |
| Small Particles | | DR-Ferr* | | 1.1 | --- | --- |
| Total Particles | | DR-Ferr* | >--- | 2.5 | --- | --- |
| Large Particles Percentage | % | DR-Ferr* | | 12 | --- | --- |
| Severity Index | | DR-Ferr* | | 0 | --- | --- |

| FERROGRAPHY | | method | limit/base | current | history1 | history2 |
|-----------------------|------------|-------------|------------|---------|----------|----------|
| Ferrous Rubbing | Scale 0-10 | ASTM D7684* | | 2 | | |
| Ferrous Sliding | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Cutting | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Rolling | Scale 0-10 | ASTM D7684* | | 1 | | |
| Ferrous Break-in | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Spheres | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Black Oxides | Scale 0-10 | ASTM D7684* | | 1 | | |
| Ferrous Red Oxides | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Corrosive | Scale 0-10 | ASTM D7684* | | | | |
| Ferrous Other | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Rubbing | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Sliding | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Cutting | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Rolling | Scale 0-10 | ASTM D7684* | | | | |
| Nonferrous Other | Scale 0-10 | ASTM D7684* | | | | |
| Carbonaceous Material | Scale 0-10 | ASTM D7684* | | | | |
| Lubricant Degradation | Scale 0-10 | ASTM D7684* | | | | |
| Sand/Dirt | Scale 0-10 | ASTM D7684* | | 1 | | |
| Fibres | Scale 0-10 | ASTM D7684* | | | | |
| Spheres | Scale 0-10 | ASTM D7684* | | | | |
| Other | Scale 0-10 | ASTM D7684* | | 1 | | |

WEAR

All component wear rates are normal.
 The ferrography results are normal indicating no abnormal wear in the system.

DR Ferrography

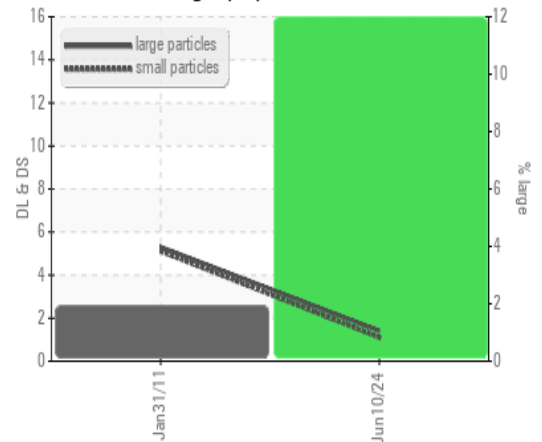

This page left intentionally blank