




OIL ANALYSIS REPORT

Sample Rating Trend

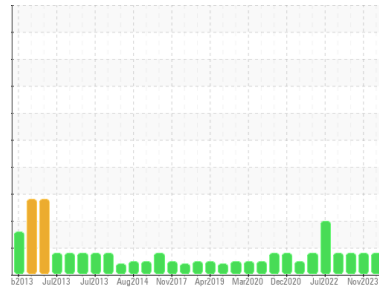

Area
(ZONE3) BRUCE A/2/33310
 Machine Id
2-33310-P2-Tank Vent
 Component
Bulk Fluid Tank
 Fluid
MOBIL DTE 732 (--- GAL)

DIAGNOSIS

- Recommendation**
We recommend an early resample to monitor this condition.
- Wear**
Lead ppm levels are abnormal.
- Contamination**
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.
- Fluid Condition**
The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0914963	WC0871712	WC0801488
Sample Date	Client Info		27 May 2024	28 Nov 2023	22 Jun 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >10	<1	0	<1
Chromium	ppm	ASTM D5185(m) >5	0	0	0
Nickel	ppm	ASTM D5185(m) >5	<1	0	0
Titanium	ppm	ASTM D5185(m) >5	0	0	0
Silver	ppm	ASTM D5185(m)	0	<1	0
Aluminum	ppm	ASTM D5185(m) >5	<1	<1	<1
Lead	ppm	ASTM D5185(m) >5	▲ 6	▲ 7	▲ 6
Copper	ppm	ASTM D5185(m) >5	<1	<1	<1
Tin	ppm	ASTM D5185(m) >5	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<1	<1	<1
Barium	ppm	ASTM D5185(m)	0	<1	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	<1
Calcium	ppm	ASTM D5185(m)	<1	<1	1
Phosphorus	ppm	ASTM D5185(m)	1	<1	1
Zinc	ppm	ASTM D5185(m)	<1	<1	2
Sulfur	ppm	ASTM D5185(m)	1072	1106	1106
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >5	3	3	3
Sodium	ppm	ASTM D5185(m) >5	0	0	0
Potassium	ppm	ASTM D5185(m) >20	0	0	1
Water	%	ASTM D6304* >0.005	0.00	0.003	0.001
ppm Water	ppm	ASTM D6304* >50	0	26	9.7

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	1505	384	3499
Particles >6µm	ASTM D7647	>1300	339	77	805
Particles >14µm	ASTM D7647	>320	17	4	46
Particles >21µm	ASTM D7647	>80	4	2	10
Particles >38µm	ASTM D7647	>20	0	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/15	18/16/11	16/13/9	19/17/13



OIL ANALYSIS REPORT

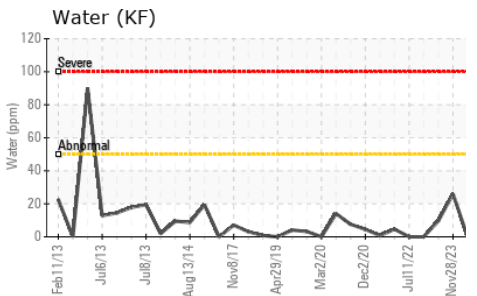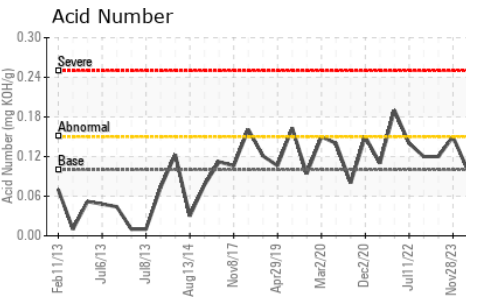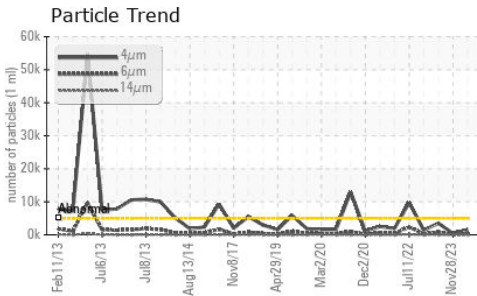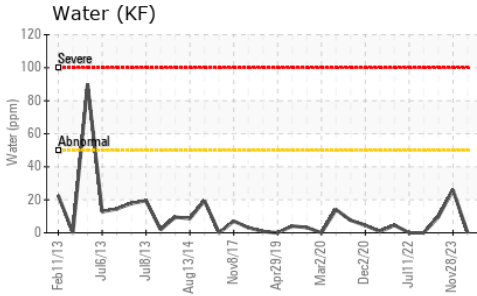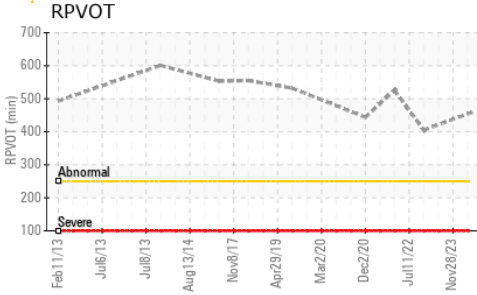





FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.10	0.10	0.15	0.12

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.005	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	30.0	31.6	31.7	31.6
Oxidation Test (RPVOT)	minutes	ASTM D2272*	1000	454	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

GRAPHS

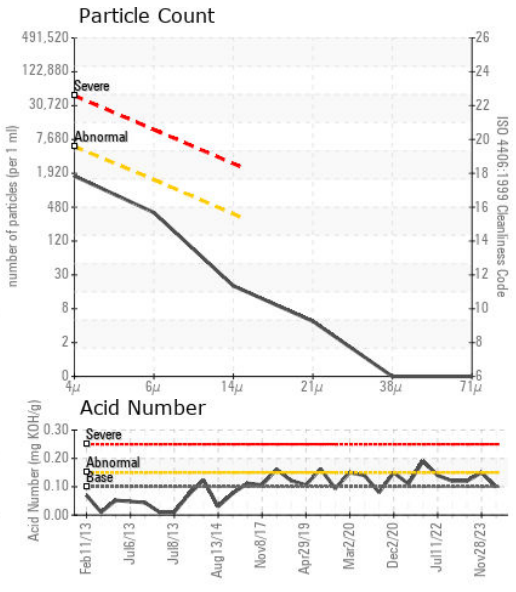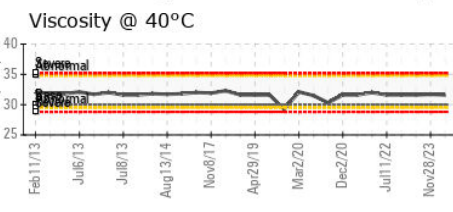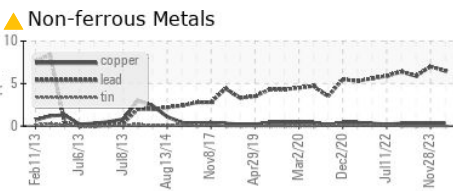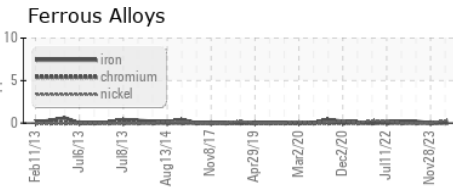

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0914963 **Received** : 20 Jun 2024
Lab Number : **02643193** **Tested** : 02 Jul 2024
Unique Number : 5800732 **Diagnosed** : 02 Jul 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: RPVOT, TAN Man)

Bruce Power - Bruce A PdM
 P.O.Box 1540, 177 Tie Road., RM-222 U2 Column 2N11 615'
 Tiverton, ON
 CA N0G 2T0
 Contact: Pierre Adouki
 pierre.adouki@brucepower.com
 T: (519)361-2673
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.