


PROBLEM SUMMARY

Sample Rating Trend


ISO



Area
Stadacona - S11900
 Machine Id
PG099
 Component
Unknown Component
 Fluid
MOBIL DTE PM 220 (--- GAL)

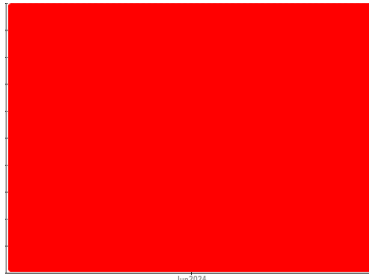

COMPONENT CONDITION SUMMARY

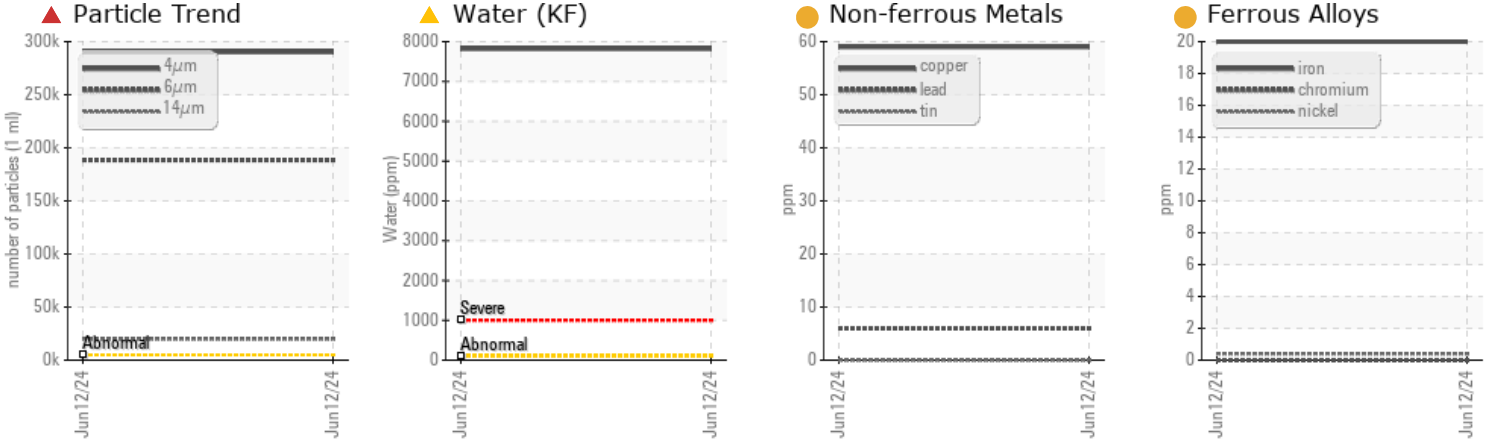

RECOMMENDATION

The sample submitted is 64 times dirtier than the ISO dirt count recommendation of 19/16/14.
 The water content is higher than the recommended level of 300 ppm.
 Copper and Iron ppm levels are noted.
 We recommend monitoring these metals content.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	---	---
Water	%	ASTM D6304*	▲ 0.782	---	---
ppm Water	ppm	ASTM D6304*	▲ 7821	---	---
Particles >4µm		ASTM D7647 >5000	▲ 290274	---	---
Particles >6µm		ASTM D7647 >640	▲ 188474	---	---
Particles >14µm		ASTM D7647 >160	▲ 19950	---	---
Particles >21µm		ASTM D7647 >40	▲ 2982	---	---
Particles >38µm		ASTM D7647 >10	▲ 23	---	---
Oil Cleanliness		ISO 4406 (c) >19/16/14	▲ 25/25/21	---	---
Emulsified Water	scalar	Visual*	▲ 1%	---	---

Customer Id: CHECOB
 Sample No.: E30002443
 Lab Number: 02643492
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Aylwin Lee +1 (905)372-2251
aylwinlee@e360s.ca

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.


HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

ISO

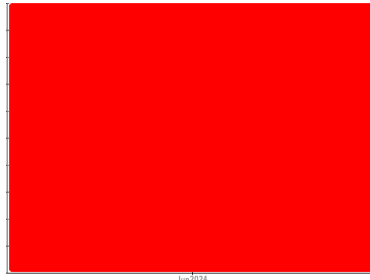

Area
Stadacona - S11900
 Machine Id
PG099
 Component
Unknown Component
 Fluid
MOBIL DTE PM 220 (--- GAL)

DIAGNOSIS

▲ Recommendation
 The sample submitted is 64 times dirtier than the ISO dirt count recommendation of 19/16/14. The water content is higher than the recommended level of 300 ppm. Copper and Iron ppm levels are noted. We recommend monitoring these metals content.

● Wear
 Copper ppm levels are noted.

▲ Contamination
 Particles >14µm are severely high. Particles >21µm are severely high. Particles >6µm are severely high. Oil Cleanliness are severely high. Particles >4µm are severely high. Water contamination levels are abnormally high. Water contamination levels are abnormally high. ppm Water contamination levels are abnormally high. Particles >38µm are abnormally high.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Department	Client Info		Sales	---	---
Sample From	Client Info		Machine	---	---
Production Stage	Client Info		Initial	---	---
Sent to WC	Client Info		06/19/2024	---	---
Sample Number	Client Info		E30002443	---	---
Sample Date	Client Info		12 Jun 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			SEVERE	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	20	---	---
Chromium	ppm	ASTM D5185(m)	0	---	---
Nickel	ppm	ASTM D5185(m)	<1	---	---
Titanium	ppm	ASTM D5185(m)	<1	---	---
Silver	ppm	ASTM D5185(m)	<1	---	---
Aluminum	ppm	ASTM D5185(m)	4	---	---
Lead	ppm	ASTM D5185(m)	6	---	---
Copper	ppm	ASTM D5185(m)	59	---	---
Tin	ppm	ASTM D5185(m)	0	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	<1	---	---






ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<1	---	---
Barium	ppm	ASTM D5185(m)	3	---	---
Molybdenum	ppm	ASTM D5185(m)	0	---	---
Manganese	ppm	ASTM D5185(m)	<1	---	---
Magnesium	ppm	ASTM D5185(m)	2	---	---
Calcium	ppm	ASTM D5185(m)	118	---	---
Phosphorus	ppm	ASTM D5185(m)	755	---	---
Zinc	ppm	ASTM D5185(m)	983	---	---
Sulfur	ppm	ASTM D5185(m)	10182	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	6	---	---
Sodium	ppm	ASTM D5185(m)	4	---	---
Potassium	ppm	ASTM D5185(m) >20	1	---	---
Water	%	ASTM D6304*	0.782	---	---
ppm Water	ppm	ASTM D6304*	7821	---	---

OIL ANALYSIS REPORT

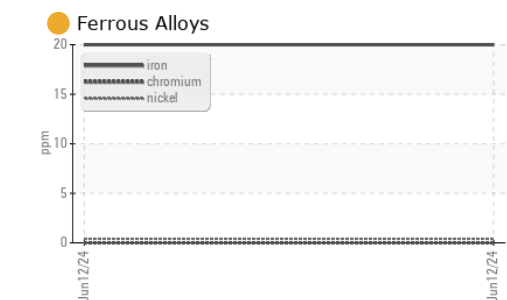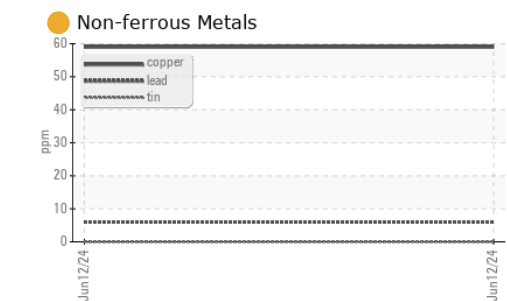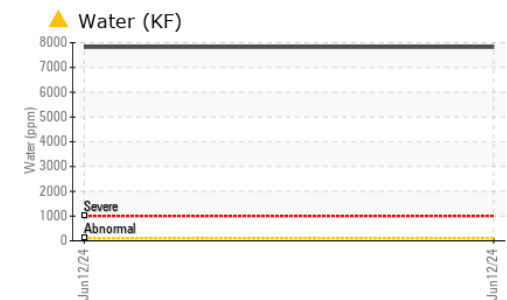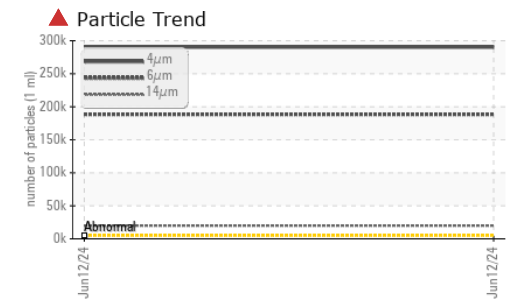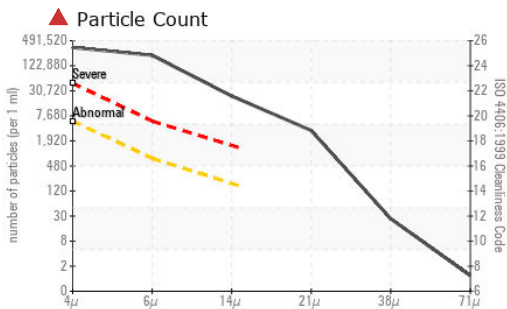

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 290274	---	---
Particles >6µm	ASTM D7647	>640	▲ 188474	---	---
Particles >14µm	ASTM D7647	>160	▲ 19950	---	---
Particles >21µm	ASTM D7647	>40	▲ 2982	---	---
Particles >38µm	ASTM D7647	>10	▲ 23	---	---
Particles >71µm	ASTM D7647	>3	▲ 1	---	---
Oil Cleanliness	ISO 4406 (c)	>19/16/14	▲ 25/25/21	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	1.52	---	---

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	LIGHT	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	▲ 1%	---	---	
Free Water	scalar	Visual*	NEG	---	---	

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	220	225	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	19.0	7.7	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : E30002443
Lab Number : 02643492
Unique Number : 5801031
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, TAN Man, VI)

Environmental 360 Solutions Ltd.
 640 Victoria Street
 Cobourg, ON
 CA K9A 5H5
 Contact: Tatiana Sorkina
 tsorkina@e360s.ca
 T: (800)263-3939
 F: (905)373-4950

To discuss this sample report, contact Customer Service at 1-905-372-2251.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.