

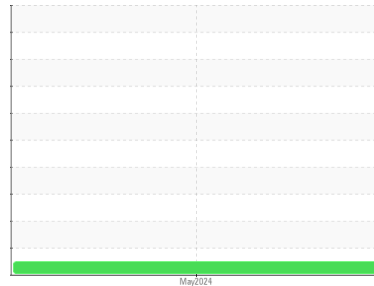


# OIL ANALYSIS REPORT



Area  
**Maison de la Culture [GTT224-457 858130]**  
 Machine Id  
**TRANE M03J02265(3,2)**  
 Component  
**Chiller**  
 Fluid  
**TRANE 0015 (--- GAL)**

### Sample Rating Trend



**NORMAL**



### DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The water content is negligible. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GTT0003336</b>	---	---
Sample Date	Client Info		<b>30 May 2024</b>	---	---
Machine Age	hrs Client Info		<b>0</b>	---	---
Oil Age	hrs Client Info		<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m)	>8	<b>0</b>	---	---
Chromium	ppm ASTM D5185(m)	>2	<b>0</b>	---	---
Nickel	ppm ASTM D5185(m)		<b>&lt;1</b>	---	---
Titanium	ppm ASTM D5185(m)		<b>0</b>	---	---
Silver	ppm ASTM D5185(m)	>2	<b>0</b>	---	---
Aluminum	ppm ASTM D5185(m)	>3	<b>&lt;1</b>	---	---
Lead	ppm ASTM D5185(m)	>2	<b>0</b>	---	---
Copper	ppm ASTM D5185(m)	>8	<b>&lt;1</b>	---	---
Tin	ppm ASTM D5185(m)	>4	<b>0</b>	---	---
Antimony	ppm ASTM D5185(m)		<b>&lt;1</b>	---	---
Vanadium	ppm ASTM D5185(m)		<b>0</b>	---	---
Beryllium	ppm ASTM D5185(m)		<b>0</b>	---	---
Cadmium	ppm ASTM D5185(m)		<b>0</b>	---	---

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	0	<b>0</b>	---	---
Barium	ppm ASTM D5185(m)	0	<b>0</b>	---	---
Molybdenum	ppm ASTM D5185(m)	0	<b>0</b>	---	---
Manganese	ppm ASTM D5185(m)	0	<b>0</b>	---	---
Magnesium	ppm ASTM D5185(m)	0	<b>0</b>	---	---
Calcium	ppm ASTM D5185(m)	0	<b>0</b>	---	---
Phosphorus	ppm ASTM D5185(m)	0	<b>0</b>	---	---
Zinc	ppm ASTM D5185(m)	0	<b>&lt;1</b>	---	---
Sulfur	ppm ASTM D5185(m)	250	<b>271</b>	---	---
Lithium	ppm ASTM D5185(m)		<b>&lt;1</b>	---	---

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m)	>15	<b>&lt;1</b>	---	---
Sodium	ppm ASTM D5185(m)		<b>0</b>	---	---
Potassium	ppm ASTM D5185(m)	>20	<b>&lt;1</b>	---	---
ppm Water	ppm ASTM D6304*	>300	<b>&lt;10</b>	---	---

### FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	0.04	<b>0.01</b>	---	---

# OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---
Emulsified Water	scalar	Visual*	>0.030	<b>NEG</b>	---
Free Water	scalar	Visual*		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68.0	<b>60.5</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color					no image	no image
Bottom					no image	no image

## GRAPHS



**Sample No.** : GTT0003336      **Received** : 21 Jun 2024  
**Lab Number** : 02643583      **Tested** : 26 Jun 2024  
**Unique Number** : 5801122      **Diagnosed** : 26 Jun 2024 - Bill Quesnel  
**Test Package** : IND 2 ( Additional Tests: KV40, Spat, TAN Auto )  
*To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.*  
*Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.*  
*Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.*

**Ainsworth**  
 1930 Rue onesime  
 Gagon Lachine, QC  
 CA H8T 2M6  
 Contact: Service Manager

T:  
F: