

FUEL REPORT

Area **LEGISLATIVE ASSEMBLY [154429]** 37210693

Diesel Fuel

Fluid No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation


Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).



Sample Rating Trend




SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		CU0023351		
Sample Date		Client Info		18 Jun 2024		
Machine Age	hrs	Client Info		277		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.839	0.845		
Fuel Color	text	Visual Screen*	Yllow	LtRed		
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	2.5		
Pensky-Martens Flash Point	°C	ASTM D7215*	52	62.2		
SULFUR CONTEI	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	10	12		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	173		
5% Distillation Point	°C	ASTM D2887*		199		
10% Distill Point	°C	ASTM D2887*	201	209		
15% Distillation Point	°C	ASTM D2887*		216		
20% Distill Point	°C	ASTM D2887*	216	224		
30% Distill Point	°C	ASTM D2887*	230	236		
40% Distill Point	°C	ASTM D2887*	243	247		
50% Distill Point	°C	ASTM D2887*	255	258		
60% Distill Point	°C	ASTM D2887*	267	270		
70% Distill Point	°C	ASTM D2887*	280	282		
80% Distill Point	°C	ASTM D2887*	295	297		
85% Distillation Point	°C	ASTM D2887*		308		
90% Distill Point	°C	ASTM D2887*	310	319		
95% Distillation Point	°C	ASTM D2887*		337		
Final Boiling Point	°C	ASTM D2887*	341	370		
IGNITION QUALI	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	37.7	35		
Cetane Index		ASTM D4737*	<40.0	46		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	<1		
Sodium	ppm	ASTM D5185(m)	<0.1	0		
Potassium	ppm	ASTM D5185(m)	<0.1	0		
Water	%	ASTM D6304*	<0.05	0.003		
ppm Water	ppm	ASTM D6304*	<500	30		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	1126		
			0.4.0			

FLUID GLEANLINESS	methou	iiiiii/base	Current	TIISTOLAT	Thistory Z
Particles >4µm	ASTM D7647	>2500	1126		
Particles >6µm	ASTM D7647	>640	360		
Particles >14µm	ASTM D7647	>80	40		
Particles >21µm	ASTM D7647	>20	8		
Particles >38µm	ASTM D7647	>4	1		
Particles >71µm	ASTM D7647	>3	0		
Oil Cleanliness	ISO 4406 (c)	>18/16/13	17/16/12		

Contact/Location: Elisia Johnson - CUMMISGEN




FUEL REPORT

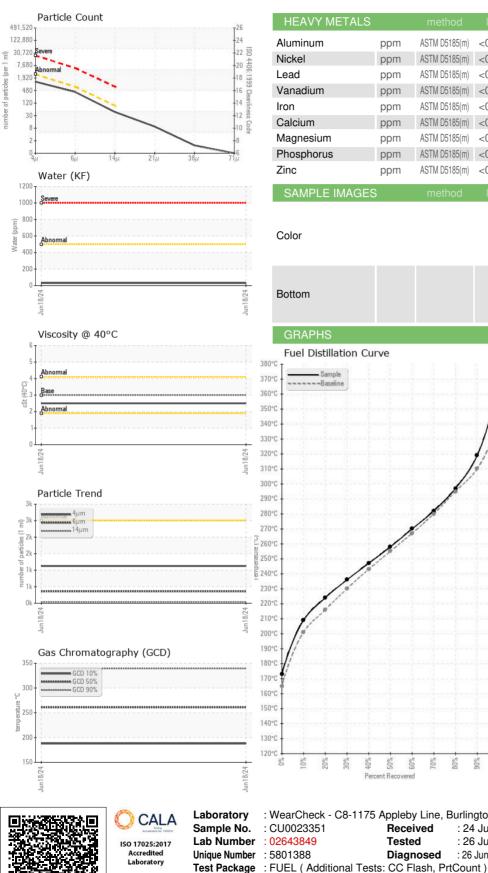

HEAVY METALS		method				history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0		
Nickel	ppm	ASTM D5185(m)	<0.1	0		
_ead	ppm	ASTM D5185(m)	<0.1	0		
Vanadium	ppm	ASTM D5185(m)	<0.1	0		
ron	ppm	ASTM D5185(m)	<0.1	0		
Calcium	ppm	ASTM D5185(m)	<0.1	<1		
Magnesium	ppm	ASTM D5185(m)	<0.1	0		
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1		
Zinc	ppm	ASTM D5185(m)	<0.1	0		
SAMPLE IMAGES	6	method	limit/base	current	history1	history2





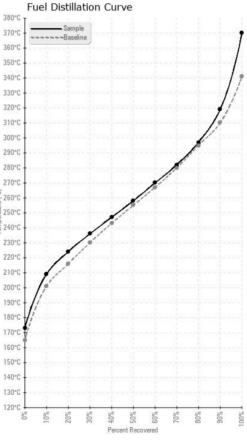

: 24 Jun 2024

: 26 Jun 2024


Received

Diagnosed

Tested

To discuss this sample report, contact Customer Service at 1-800-268-2131.

Validity of results and interpretation are based on the sample and information as supplied.

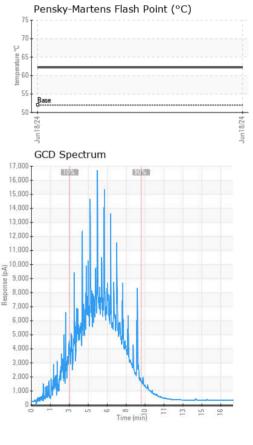



: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 CUMMINS CANADA ULC - GENERATOR DIVISION 7175 PACIFIC CIRCLE MISSISSAUGA, ON : 26 Jun 2024 - Kevin Marson CA L5T 2A5 Contact: Elisia Johnson elisia.johnson@cummins.com T: (905)795-0050 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. F: (905)795-9252

Report Id: CUMMISGEN [WCAMIS] 02643849 (Generated: 06/26/2024 08:54:13) Rev: 1

Contact/Location: Elisia Johnson - CUMMISGEN