


FUEL REPORT

Sample Rating Trend



ISO

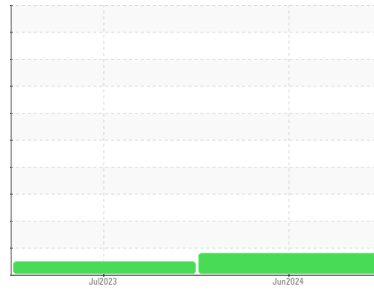

Area

[6100299068]

Machine Id

GENERAC E002-051700

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. We advise that you filter this fluid before use. We recommend you service the filters on this component. Resample at the next service interval to monitor.

Contaminants

There is a light amount of silt (particulates < 14 microns in size) present in the fuel. The water content is negligible.

Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WA0021954	WA0020245	---
Sample Date	Client Info			19 Jun 2024	05 Jul 2023	---
Machine Age	hrs	Client Info		0	0	---
Sample Status				ATTENTION	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.839	0.843	0.839	---
Fuel Color	text	Visual Screen*	Yellow	Yellow	Yellow	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	2.7	2.6	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	62.5	60.4	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	10	12	12	---






DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	174	172	---
5% Distillation Point	°C	ASTM D2887*		197	192	---
10% Distill Point	°C	ASTM D2887*	201	209	203	---
15% Distillation Point	°C	ASTM D2887*		218	211	---
20% Distill Point	°C	ASTM D2887*	216	226	220	---
30% Distill Point	°C	ASTM D2887*	230	242	235	---
40% Distill Point	°C	ASTM D2887*	243	254	248	---
50% Distill Point	°C	ASTM D2887*	255	267	261	---
60% Distill Point	°C	ASTM D2887*	267	280	274	---
70% Distill Point	°C	ASTM D2887*	280	293	287	---
80% Distill Point	°C	ASTM D2887*	295	309	302	---
85% Distillation Point	°C	ASTM D2887*		320	313	---
90% Distill Point	°C	ASTM D2887*	310	331	325	---
95% Distillation Point	°C	ASTM D2887*		351	344	---
Final Boiling Point	°C	ASTM D2887*	341	380	373	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	37.7	36	37	---
Cetane Index		ASTM D4737*	<40.0	49	49	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	0	0	---
Sodium	ppm	ASTM D5185(m)	<0.1	0	<1	---
Potassium	ppm	ASTM D5185(m)	<0.1	0	<1	---
Water	%	ASTM D6304*	<0.05	0.002	0.004	---
ppm Water	ppm	ASTM D6304*	<500	17	40.8	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	3438	93	---
Particles >6µm		ASTM D7647	>1300	843	26	---
Particles >14µm		ASTM D7647	>160	98	3	---
Particles >21µm		ASTM D7647	>40	27	1	---
Particles >38µm		ASTM D7647	>10	3	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>18/17/14	19/17/14	14/12/9	---




FUEL REPORT

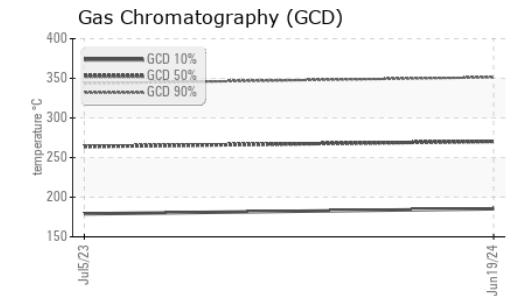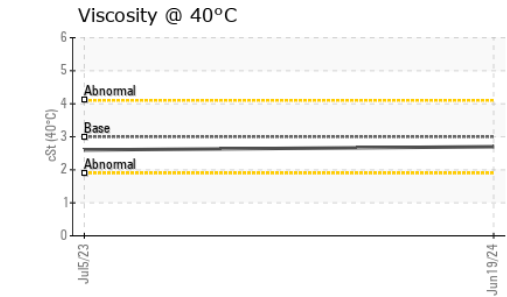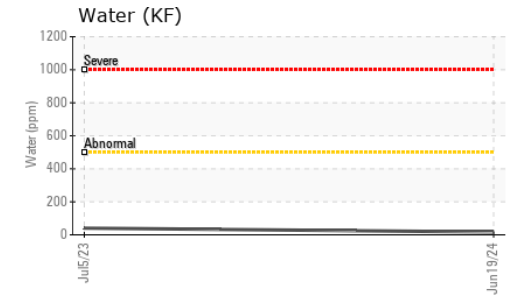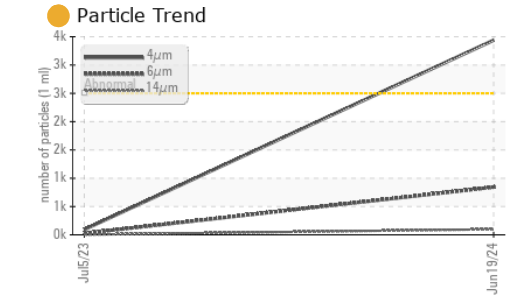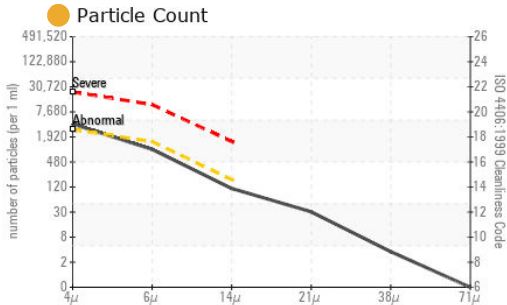

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---
Iron	ppm	ASTM D5185(m)	<0.1	<1	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image

GRAPHS

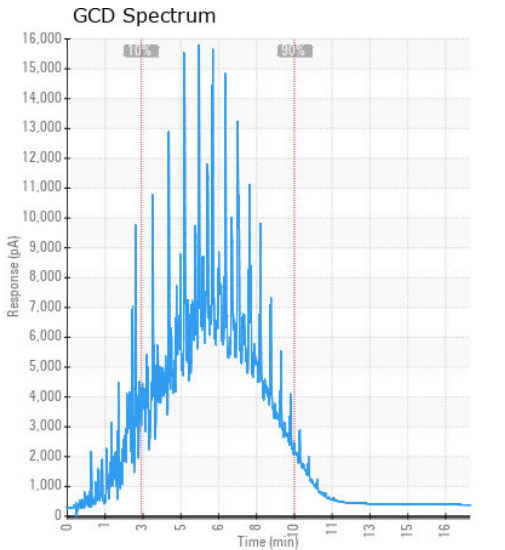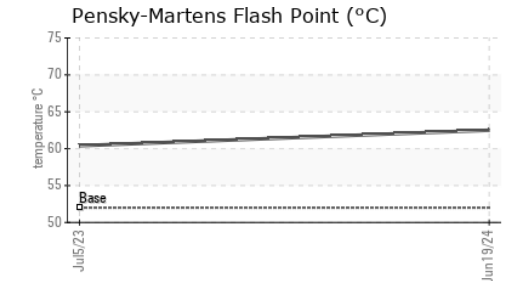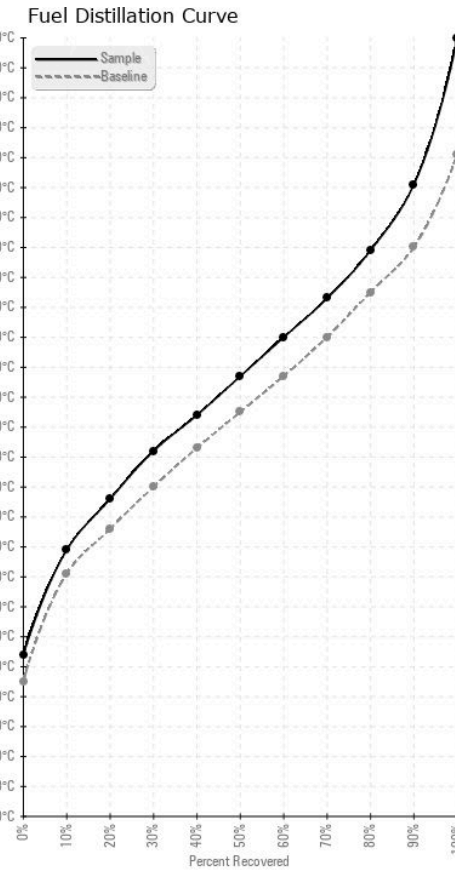

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021954 **Received** : 26 Jun 2024
Lab Number : 02644266 **Tested** : 02 Jul 2024
Unique Number : 5801805 **Diagnosed** : 02 Jul 2024 - Kevin Marson
Test Package : FUEL (Additional Tests: CC Flash, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325