




PROBLEM SUMMARY

Area
BRUCE B/0B/54300
 Machine Id
0B-54300-EPG2-CP1-OIL
 Component
Compressor
 Fluid
ESSO NUTO H ISO 150 (--- GAL)

Sample Rating Trend

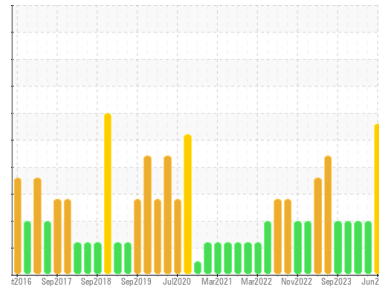


WATER



COMPONENT CONDITION SUMMARY

▲ Particle Trend

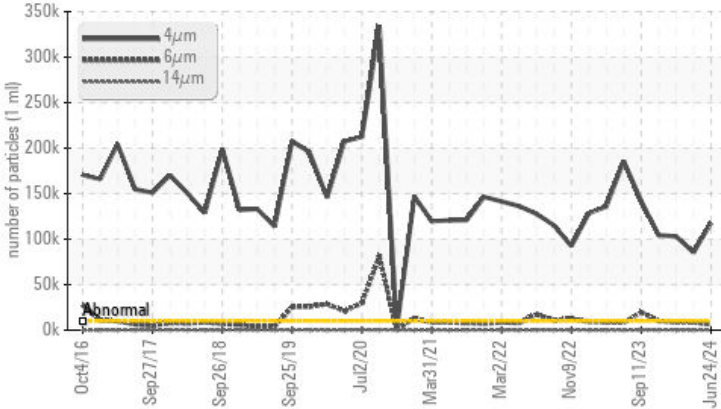

RECOMMENDATION

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	SEVERE	SEVERE
Particles >4µm	ASTM D7647	>10000	▲ 117574	▲ 85522	▲ 103030	
Particles >6µm	ASTM D7647	>2500	▲ 6466	▲ 8584	▲ 8717	
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 24/20/12	▲ 24/20/12	▲ 24/20/12	
White Metal	scalar	Visual*	NONE	▲ VLITE	NONE	NONE
Appearance	scalar	Visual*	NORML	▲ WGOIL	NORML	HAZY
Free Water	scalar	Visual*	▲ 1%	NEG	NEG	NEG
PrtFilter						

Customer Id: BRUTIV
 Sample No.: WC0896804
 Lab Number: 02644356
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Water Access	---	---	?	We advise that you check for the source of water entry.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.
Filter Fluid	---	---	?	We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil.

HISTORICAL DIAGNOSIS

ISO



27 Mar 2024 Diag: Kevin Marson

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



ISO



05 Jan 2024 Diag: Kevin Marson

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



ISO



11 Dec 2023 Diag: Kevin Marson

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

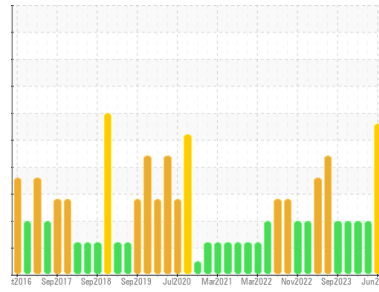

WATER



Area
BRUCE B/0B/54300
 Machine Id
0B-54300-EPG2-CP1-OIL
 Component
Compressor
 Fluid
ESSO NUTO H ISO 150 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

Light concentration of visible metal present. The ferrography results are normal indicating no abnormal wear in the system.


Contaminants

There is a high amount of silt (particulates < 14 microns in size) present in the oil. Free water present.

Oil Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

Particle Filter (Magn: 200 x)

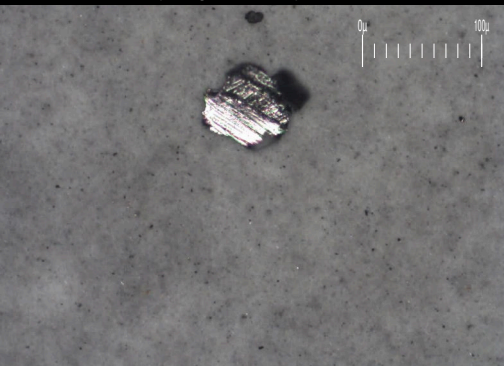

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0896804	WC0896852	WC0642725
Sample Date	Client Info		24 Jun 2024	27 Mar 2024	05 Jan 2024
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	SEVERE	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >50	4	4	4
Chromium	ppm	ASTM D5185(m) >10	0	0	0
Nickel	ppm	ASTM D5185(m)	<1	0	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >25	4	4	5
Lead	ppm	ASTM D5185(m) >25	<1	0	1
Copper	ppm	ASTM D5185(m) >50	2	2	2
Tin	ppm	ASTM D5185(m) >15	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	1	<1	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<1	0	0
Barium	ppm	ASTM D5185(m)	1	1	1
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	<1	<1	<1
Calcium	ppm	ASTM D5185(m)	39	40	43
Phosphorus	ppm	ASTM D5185(m)	328	323	340
Zinc	ppm	ASTM D5185(m)	408	412	414
Sulfur	ppm	ASTM D5185(m)	2805	2901	3185
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	1	1	5
Sodium	ppm	ASTM D5185(m)	0	<1	0
Potassium	ppm	ASTM D5185(m) >20	0	<1	4
Water	%	ASTM D6304* >0.1	0.022	0.003	0.002
ppm Water	ppm	ASTM D6304* >1000	229	31	23

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 117574	▲ 85522	▲ 103030
Particles >6µm	ASTM D7647	>2500	▲ 6466	▲ 8584	▲ 8717
Particles >14µm	ASTM D7647	>320	25	28	39
Particles >21µm	ASTM D7647	>80	4	6	9
Particles >38µm	ASTM D7647	>20	1	1	2
Particles >71µm	ASTM D7647	>4	1	1	2
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 24/20/12	▲ 24/20/12	▲ 24/20/12



OIL ANALYSIS REPORT

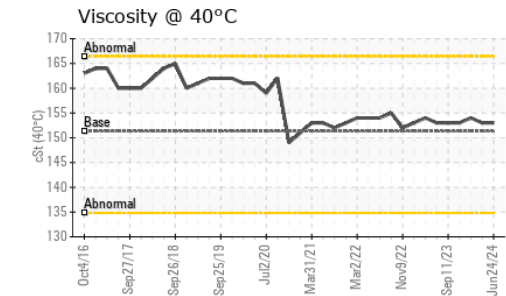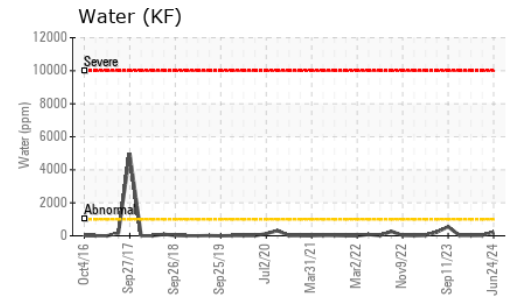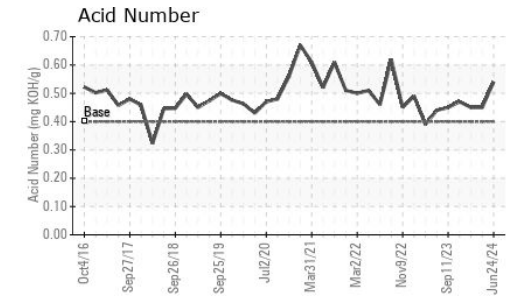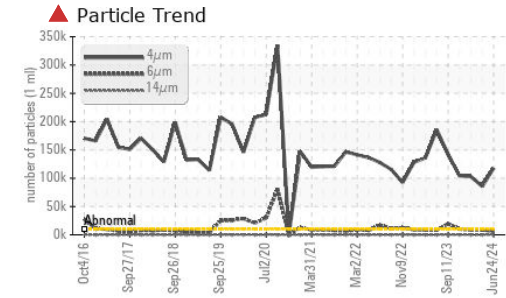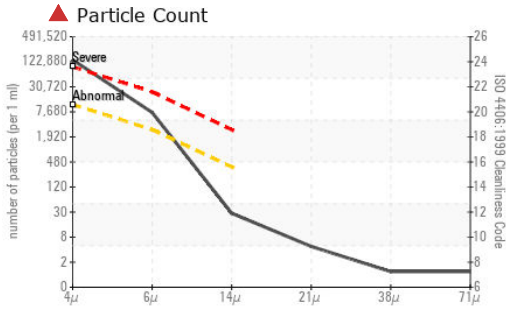


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974*	.40	0.54	0.45	0.45

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	▲ VLITE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	▲ WGOIL	NORML	HAZY
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	.2%	NEG	NEG
Free Water	scalar	Visual*		▲ 1%	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	151.3	153	153	154

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

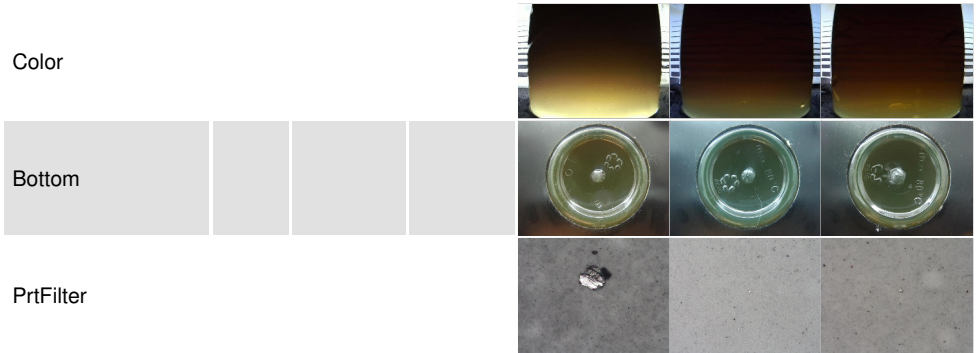

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0896804
Lab Number : **02644356**
Unique Number : 5801895
Test Package : IND 2 (Additional Tests: A-FERR, BottomAnalysis, DR-FERR, FILTERPATCH, PrtFilter, RPVOT, TAN)




Bruce Power - Bruce A PdM
 P.O.Box 1540, 177 Tie Road., RM-222 U2 Column 2N11 615'
 Tiverton, ON
 CA N0G 2T0
 Contact: Pierre Adouki
 pierre.adouki@brucepower.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T: (519)361-2673
 F:

FERROGRAPHY REPORT

Area
BRUCE B/0B/54300
Machine Id
0B-54300-EPG2-CP1-OIL
Component
Compressor
Fluid
ESSO NUTO H ISO 150 (--- GAL)

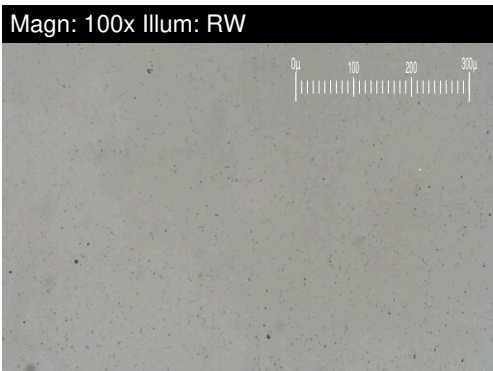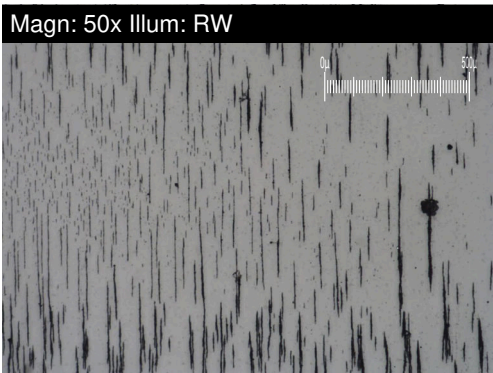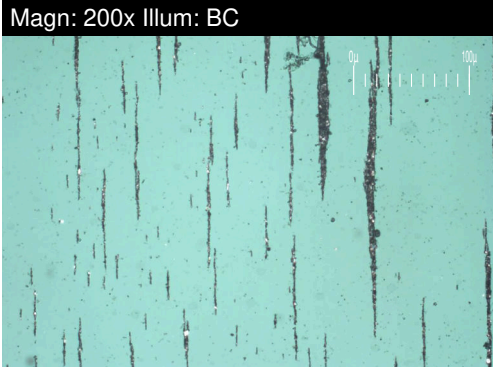


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		18.5	41.2	37.8
Small Particles		DR-Ferr*		11.5	17.3	17.4
Total Particles		DR-Ferr*	>---	30	58.5	55.2
Large Particles Percentage	%	DR-Ferr*		23.3	40.9	37
Severity Index		DR-Ferr*		130	985	771

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		4	4	4
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		2	2	2
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		1	1	1
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				1
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1	1	1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1	1	1

WEAR

Light concentration of visible metal present. The ferrography results are normal indicating no abnormal wear in the system.

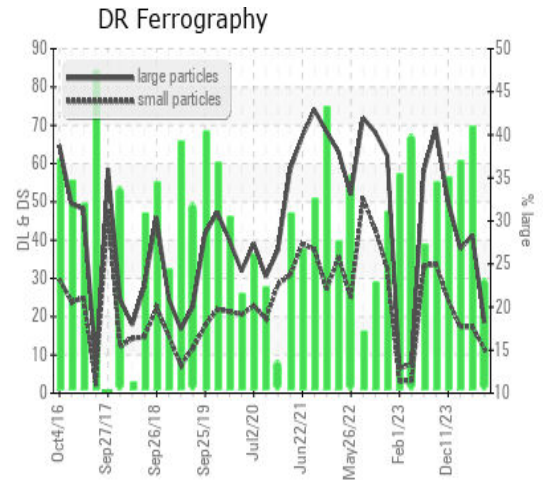

This page left intentionally blank