

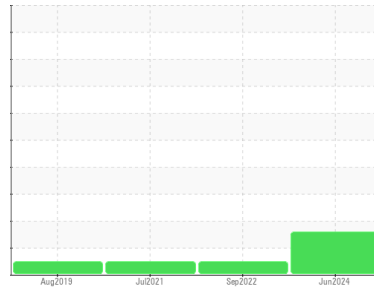


OIL ANALYSIS REPORT



Area
Ecole Grande Riviere #1 [GTT224-462 1-1P1M79P]
 Machine Id
YORK SLEM926540
 Component
Chiller
 Fluid
YORK TYPE K (--- GAL)

Sample Rating Trend



WATER



DIAGNOSIS

Recommendation

If not recently done change any filter driers to reduce moisture level. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

The elevated moisture content is associated with POE oils which are hygroscopic, and can absorb moisture from sampling and processing.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GTT0003545	GTT67523	GTT67524
Sample Date	Client Info		19 Jun 2024	14 Sep 2022	05 Jul 2021
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed		Client Info	N/A	N/A	N/A
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	3	4	2
Chromium	ppm	ASTM D5185(m) >2	0	<1	<1
Nickel	ppm	ASTM D5185(m)	<1	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >2	0	---	---
Aluminum	ppm	ASTM D5185(m) >3	<1	<1	<1
Lead	ppm	ASTM D5185(m) >2	0	<1	<1
Copper	ppm	ASTM D5185(m) >8	<1	2	<1
Tin	ppm	ASTM D5185(m) >4	0	<1	<1
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<1	---	---
Barium	ppm	ASTM D5185(m) 0	<1	---	---
Molybdenum	ppm	ASTM D5185(m) 0	0	---	---
Manganese	ppm	ASTM D5185(m) 0	0	---	---
Magnesium	ppm	ASTM D5185(m) 0	<1	---	---
Calcium	ppm	ASTM D5185(m) 0	0	---	---
Phosphorus	ppm	ASTM D5185(m) 5	<1	---	---
Zinc	ppm	ASTM D5185(m) 0	1	<1	<1
Sulfur	ppm	ASTM D5185(m) 10	8	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	2	---	---
Sodium	ppm	ASTM D5185(m)	<1	---	---
Potassium	ppm	ASTM D5185(m) >20	<1	---	---
ppm Water	ppm	ASTM D6304* >300	599	245	287

FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.03	0.02	0.003	0.014

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.03	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	32.0	34.0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color					no image	no image
Bottom					no image	no image

GRAPHS



Sample No. : GTT0003545
Lab Number : 02644477
Unique Number : 5802016
Test Package : IND 2 (Additional Tests: KF, TAN Man)
Received : 27 Jun 2024
Tested : 04 Jul 2024
Diagnosed : 04 Jul 2024 - Bill Quesnel

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Johnson Controls-Ottawa
 Accounts Payable A-33, P.O. Box 2012
 Milwaukee, WI
 US 532012012
 Contact: Service Manager

T:
F: