OIL ANALYSIS REPORT

Sample Rating Trend

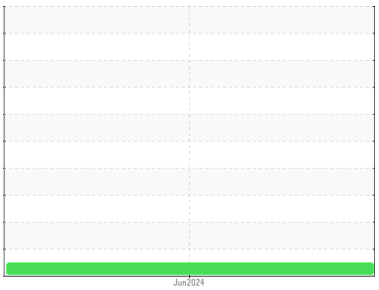

NORMAL

Machine Id
C1
Component
Screw Compressor
Fluid
REFRIG COMP OIL ISO 68 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) REFRIG COMP OIL ISO 68. Please confirm.

Wear
All component wear rates are normal.

Contamination
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0900473**	---	---
Sample Date		Client Info		**20 Jun 2024**	---	---
Machine Age	hrs	Client Info		**0**	---	---
Oil Age	hrs	Client Info		**0**	---	---
Oil Changed		Client Info		**N/A**	---	---
Sample Status				**NORMAL**	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>60	**<1**	---	---
Chromium	ppm	ASTM D5185(m)	>4	**0**	---	---
Nickel	ppm	ASTM D5185(m)		**<1**	---	---
Titanium	ppm	ASTM D5185(m)		**0**	---	---
Silver	ppm	ASTM D5185(m)		**0**	---	---
Aluminum	ppm	ASTM D5185(m)	>5	**<1**	---	---
Lead	ppm	ASTM D5185(m)	>10	**0**	---	---
Copper	ppm	ASTM D5185(m)	>30	**<1**	---	---
Tin	ppm	ASTM D5185(m)	>15	**0**	---	---
Antimony	ppm	ASTM D5185(m)		**0**	---	---
Vanadium	ppm	ASTM D5185(m)		**0**	---	---
Beryllium	ppm	ASTM D5185(m)		**0**	---	---
Cadmium	ppm	ASTM D5185(m)		**0**	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	**0**	---	---
Barium	ppm	ASTM D5185(m)	5	**1**	---	---
Molybdenum	ppm	ASTM D5185(m)	5	**0**	---	---
Manganese	ppm	ASTM D5185(m)		**0**	---	---
Magnesium	ppm	ASTM D5185(m)	5	**<1**	---	---
Calcium	ppm	ASTM D5185(m)	12	**<1**	---	---
Phosphorus	ppm	ASTM D5185(m)	12	**1**	---	---
Zinc	ppm	ASTM D5185(m)	12	**1**	---	---
Sulfur	ppm	ASTM D5185(m)	1000	**123**	---	---
Lithium	ppm	ASTM D5185(m)		**<1**	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	**0**	---	---
Sodium	ppm	ASTM D5185(m)		**0**	---	---
Potassium	ppm	ASTM D5185(m)	>20	**<1**	---	---
Water	%	ASTM D6304*	>0.1	**0.00**	---	---
ppm Water	ppm	ASTM D6304*	>1000	**0**	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	**5199**	---	---
Particles >6µm	ASTM D7647	>2500	**1313**	---	---
Particles >14µm	ASTM D7647	>320	**109**	---	---
Particles >21µm	ASTM D7647	>80	**39**	---	---
Particles >38µm	ASTM D7647	>20	**6**	---	---
Particles >71µm	ASTM D7647	>4	**0**	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	**20/18/14**	---	---

OIL ANALYSIS REPORT

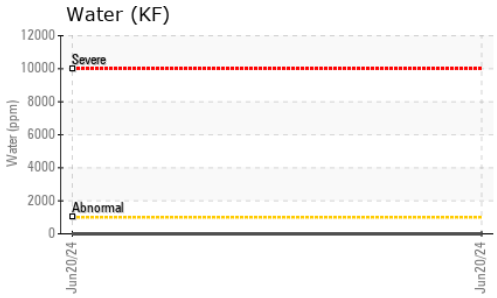

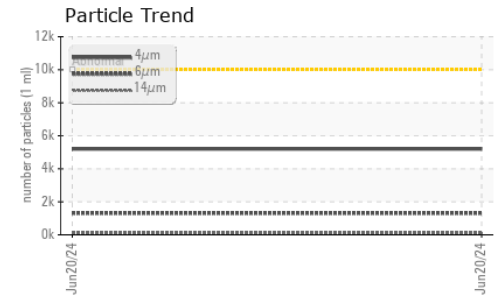

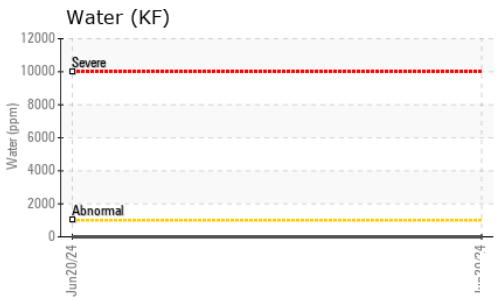

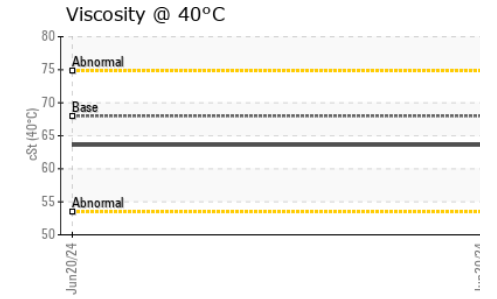

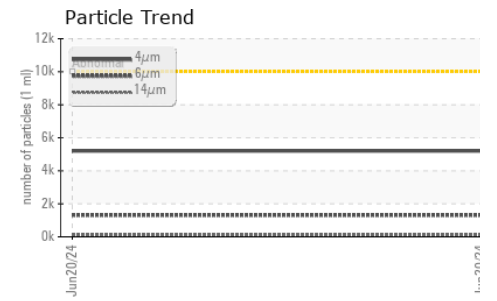

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.10	**0.03**	---	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	---	---
Yellow Metal	scalar	Visual*	NONE	**NONE**	---	---
Precipitate	scalar	Visual*	NONE	**NONE**	---	---
Silt	scalar	Visual*	NONE	**NONE**	---	---
Debris	scalar	Visual*	NONE	**VLITE**	---	---
Sand/Dirt	scalar	Visual*	NONE	**NONE**	---	---
Appearance	scalar	Visual*	NORML	**NORML**	---	---
Odor	scalar	Visual*	NORML	**NORML**	---	---
Emulsified Water	scalar	Visual*	>0.1	**NEG**	---	---
Free Water	scalar	Visual*		**NEG**	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	**63.6**	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				*no image*	*no image*
Bottom				*no image*	*no image*

GRAPHS

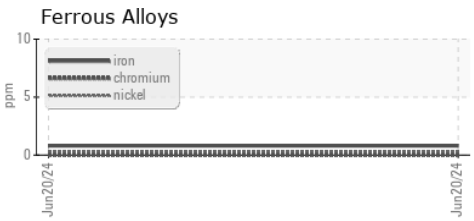

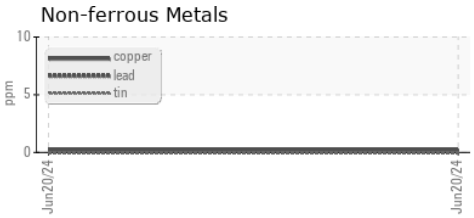

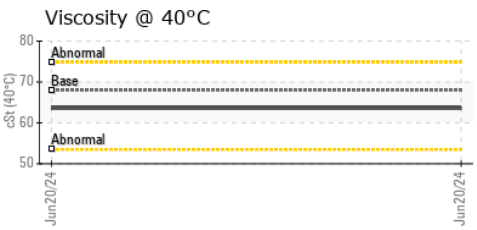

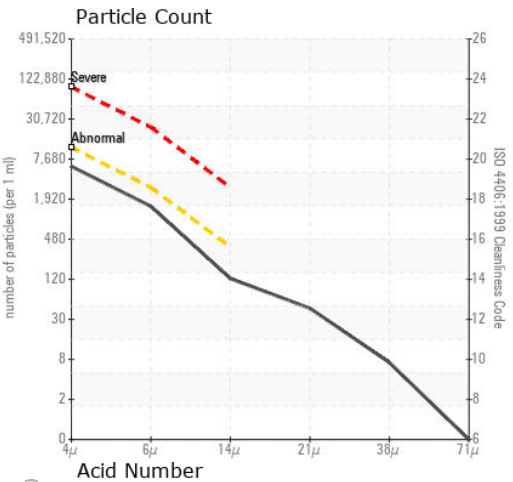

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0900473 **Received** : 02 Jul 2024
Lab Number : 02644870 **Tested** : 03 Jul 2024
Unique Number : 5802409 **Diagnosed** : 03 Jul 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: KF, PrtCount, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

APPLEBY RELIABILITY INC
UNIT 1 - 8250 209B STREET
LANGLEY, BC
CA V2Y 0J7
Contact: Doug Brougham
doug@applebyreliability.com
T: (778)846-1955
F: