




# OIL ANALYSIS REPORT

Sample Rating Trend

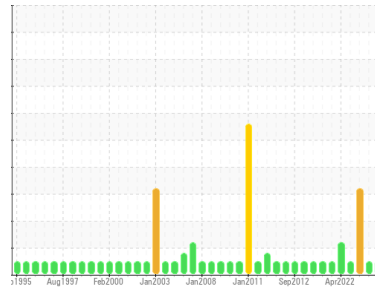

**NORMAL**



Area

**72 MACHINE ROOM**

Machine Id

**1st Press Section (Reducer) (S/N 725104)**

Component

**Gear Reducer**

Fluid

**ESSO SPARTAN EP 220 (20 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC</b>	WC	WC0789977
Sample Date	Client Info	<b>25 Jun 2024</b>	26 Dec 2023	08 May 2023
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	ABNORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2	
PQ	ASTM D8184*	<b>79</b>	156	▲ 284	
Iron	ppm	ASTM D5185(m) >250	<b>166</b>	168	153
Chromium	ppm	ASTM D5185(m) >5	<b>1</b>	1	<1
Nickel	ppm	ASTM D5185(m) >5	<b>2</b>	2	1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m) >50	<b>28</b>	27	29
Copper	ppm	ASTM D5185(m) >50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m) >5	<b>2</b>	2	2
Antimony	ppm	ASTM D5185(m) >5	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m) .5	<b>17</b>	16	12
Barium	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185(m) 1.7	<b>13</b>	12	9
Phosphorus	ppm	ASTM D5185(m) 250	<b>304</b>	316	331
Zinc	ppm	ASTM D5185(m) .3	<b>10</b>	8	7
Sulfur	ppm	ASTM D5185(m)	<b>14787</b>	15498	15006
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS




method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >60	<b>3</b>	4	3
Sodium	ppm	ASTM D5185(m)	<b>1</b>	1	2
Potassium	ppm	ASTM D5185(m) >20	<b>1</b>	1	<1

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974* 0.75	<b>0.70</b>	1.07	0.68



# OIL ANALYSIS REPORT

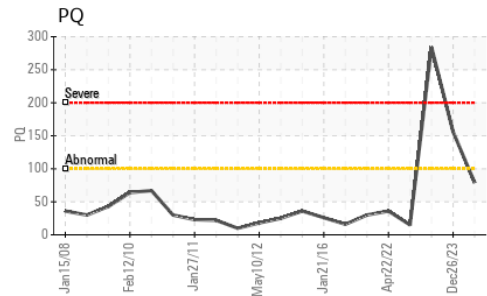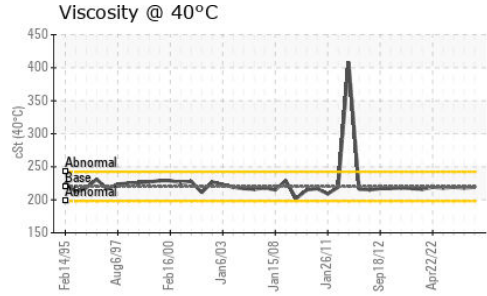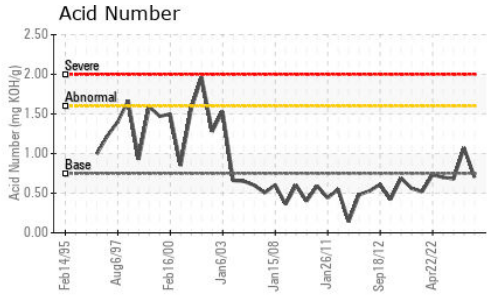






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>LIGHT</b>	VLITE ▲ MODER
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE
Silt	scalar	Visual*	NONE	<b>VLITE</b>	NONE
Debris	scalar	Visual*	NONE	<b>VLITE</b>	VLITE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	220	<b>219</b>	218

### SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color					
Bottom					
PrtFilter				no image	no image

### GRAPHS

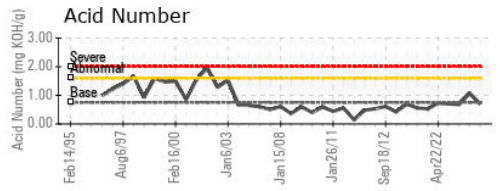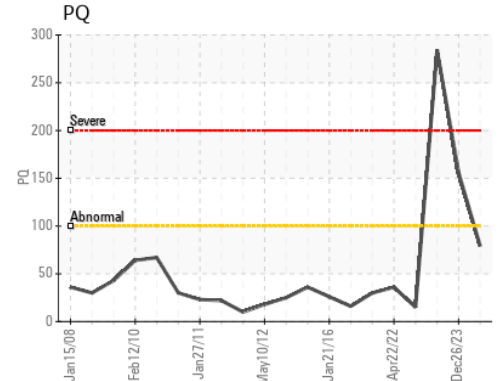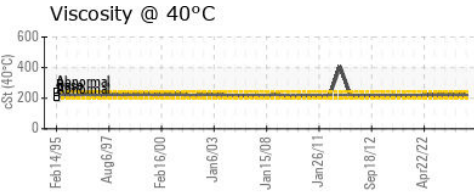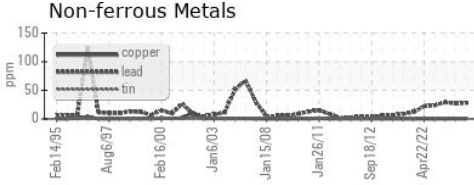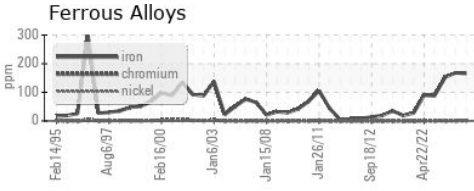

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC **Received** : 02 Jul 2024  
**Lab Number** : 02644964 **Tested** : 03 Jul 2024  
**Unique Number** : 5802503 **Diagnosed** : 03 Jul 2024 - Wes Davis  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**AV GROUP NB INC.**  
 103 PINDER ROAD,, NACKAWIC MILL  
 NACKAWIC, NB  
 CA E6G 1W4  
 Contact: Basil Fadulalla  
 basil.fadulalla@adityabirla.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.