

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



6 MILL
Component
Discharge Trunnion Bearing
Fluid
SHELL OMALA S2 GX 320 (--- GAL)

DIAGNOSIS

Machine Id

Recommendation

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		L		Jun2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0898810		
Sample Date		Client Info		24 Jun 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>2	NEG		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0		
Iron	ppm	ASTM D5185(m)	>20	2		
Chromium		ASTM D5185(m)	>20	0		
Nickel	ppm	ASTM D5185(m)	>20	ں <1		
Titanium	ppm	ASTM D5185(m)	220	0		
Silver	ppm	. ,		0		
Aluminum	ppm	ASTM D5185(m) ASTM D5185(m)	>20	_		
	ppm			<1 4		
Lead	ppm	ASTM D5185(m)	>20	-		
Copper	ppm	ASTM D5185(m)	>20	<1		
Tin	ppm	(/	>20	<1		
Antimony	ppm	ASTM D5185(m)		1		
Vanadium	ppm	ASTM D5185(m)		0		
Beryllium	ppm	ASTM D5185(m)		0		
Cadmium	ppm	ASTM D5185(m)		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	6.2	<1		
Barium	ppm	ASTM D5185(m)	0.0	0		
Molybdenum	ppm	ASTM D5185(m)	0	0		
Manganese	ppm	ASTM D5185(m)		0		
Magnesium	ppm	ASTM D5185(m)	0	<1		
Calcium	ppm	ASTM D5185(m)	0.0	3		
Phosphorus	ppm	ASTM D5185(m)	290	255		
Zinc	ppm	ASTM D5185(m)	3.8	5		
Sulfur	ppm	ASTM D5185(m)	8167	8750		
Lithium	ppm	ASTM D5185(m)		<1		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	3		
Sodium	ppm	ASTM D5185(m)		<1		
Potassium	ppm	ASTM D5185(m)	>20	0		
FLUID DEGRADA	ATION _	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.29		



OIL ANALYSIS REPORT

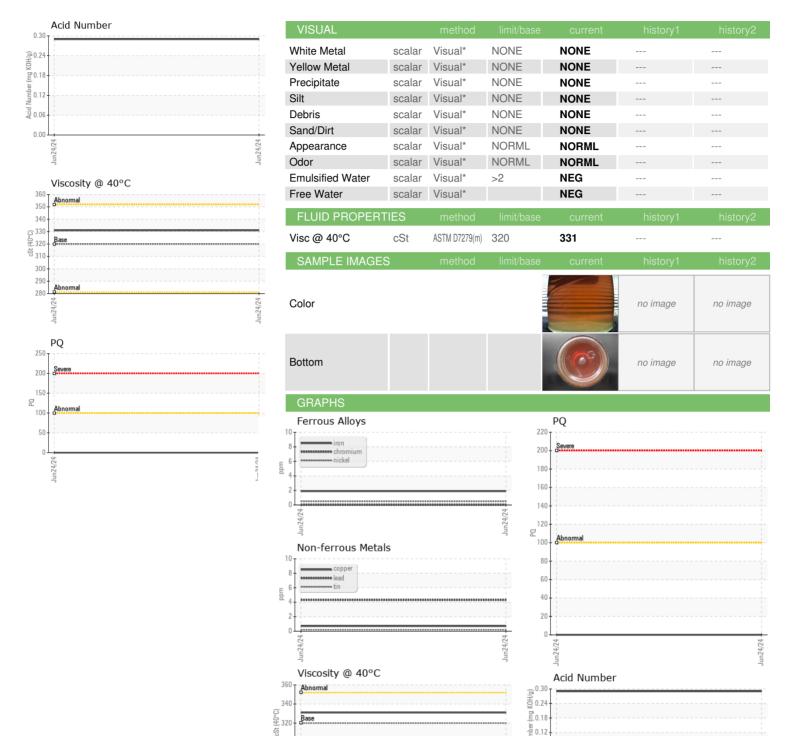



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number Unique Number : 5802556 Test Package : IND 2

: 02645017

280

: WC0898810

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Received : 02 Jul 2024

Tested : 04 Jul 2024 Diagnosed : 04 Jul 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.

0.06

0.00

Vale - Clarabelle Mill MTW (Mill, Tailings & Water) COPPER CLIFF, ON CA P0M 1N0

Contact: Guy Gauthier guy.gauthier@vale.com T: (705)682-5646

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

F: (705)682-6273