




OIL ANALYSIS REPORT

Sample Rating Trend

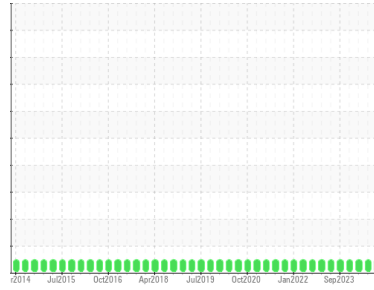

NORMAL



Area

8

Machine Id

8-2-301 FM #2 Symetro

Component

Gearbox

Fluid

MOBIL MOBILGEAR 600 XP 320 (1200 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC	WC0925373	WC0902101
Sample Date	Client Info	02 Jul 2024	08 Apr 2024	20 Feb 2024
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m) >200	2	14	14
Chromium	ppm	ASTM D5185(m) >15	0	0	0
Nickel	ppm	ASTM D5185(m) >15	<1	0	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >25	<1	<1	<1
Lead	ppm	ASTM D5185(m) >100	0	6	6
Copper	ppm	ASTM D5185(m) >200	<1	<1	<1
Tin	ppm	ASTM D5185(m) >25	0	0	0
Antimony	ppm	ASTM D5185(m) >5	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m) 57	15	20	19
Barium	ppm	ASTM D5185(m) 0.0	0	<1	0
Molybdenum	ppm	ASTM D5185(m) 2.0	0	0	0
Manganese	ppm	ASTM D5185(m) 0.0	0	<1	0
Magnesium	ppm	ASTM D5185(m) 0.0	<1	<1	1
Calcium	ppm	ASTM D5185(m) 42	9	6	7
Phosphorus	ppm	ASTM D5185(m) 399	302	217	218
Zinc	ppm	ASTM D5185(m) 13	1	7	7
Sulfur	ppm	ASTM D5185(m) 13649	13888	8908	9116
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS





method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >50	7	2	1
Sodium	ppm	ASTM D5185(m)	0	<1	<1
Potassium	ppm	ASTM D5185(m) >20	<1	<1	<1

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	255083	35289	37587
Particles >6µm	ASTM D7647 >320000	118742	7293	7286
Particles >14µm	ASTM D7647 >160000	10256	257	331
Particles >21µm	ASTM D7647 >40000	2480	35	78
Particles >38µm	ASTM D7647 >10000	127	2	2
Particles >71µm	ASTM D7647 >2500	10	1	1
Oil Cleanliness	ISO 4406 (c) >--/25/24	25/24/21	22/20/15	22/20/16



OIL ANALYSIS REPORT

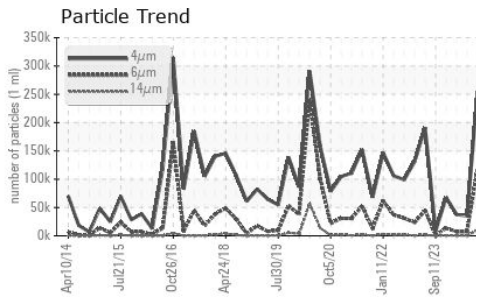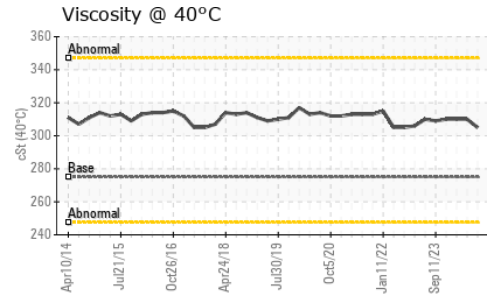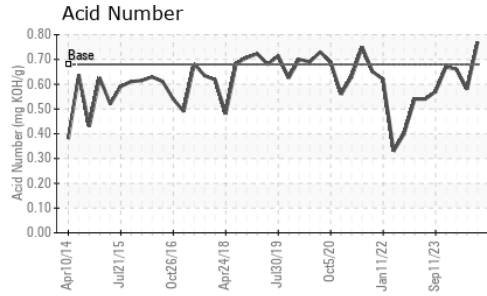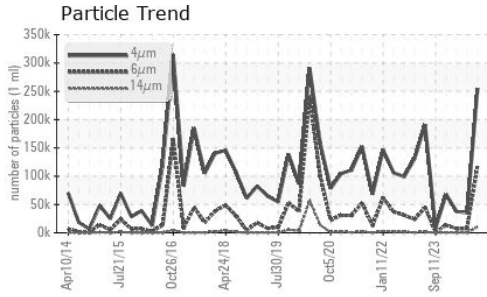


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.68	0.77	0.58	0.66






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	VLITE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	VLITE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	VLITE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	275	305	310	310

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

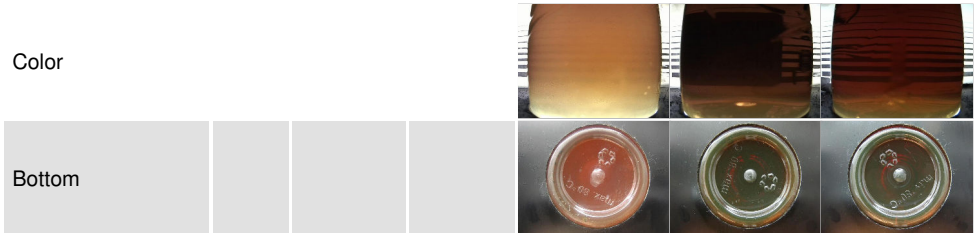

GRAPHS

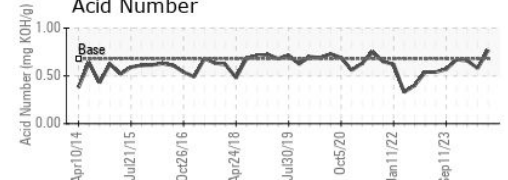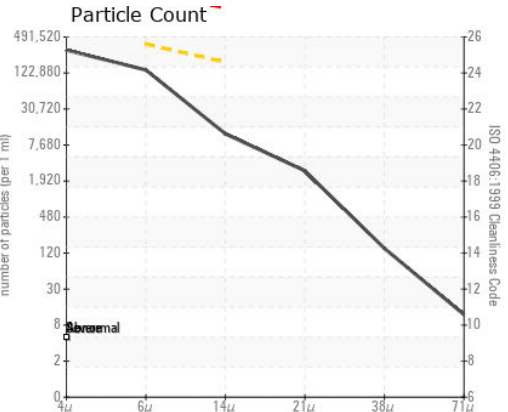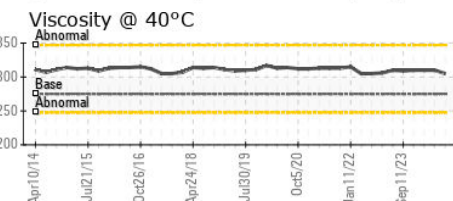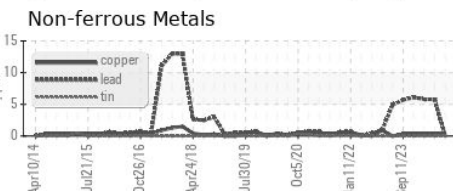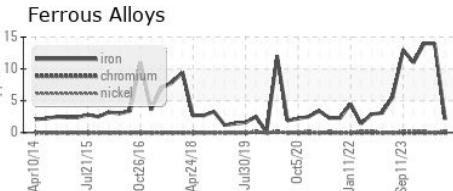

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC
Lab Number : 02645315
Unique Number : 5802854
Test Package : IND 2 (Additional Tests: TAN Man)
Received : 03 Jul 2024
Tested : 04 Jul 2024
Diagnosed : 04 Jul 2024 - Wes Davis

ST. MARYS CEMENT CO.
 400 BOWMANVILLE AVENUE
 BOWMANVILLE, ON
 CA L1C 7B5
 Contact: Lou Traiforos
 lou.traiforos@vcimentos.com
 T: (905)440-5874
 F: (905)623-4695

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.