




# OIL ANALYSIS REPORT

Sample Rating Trend

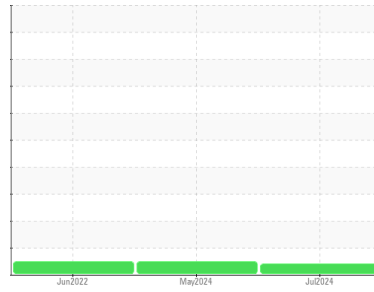

INSOLUBLES



Machine Id

## SAB1 G2 GOVERNER

Component

Governor System

Fluid

PETRO CANADA TURBOFLO XL46 (--- LTR)

### DIAGNOSIS

#### Recommendation

We recommend an early resample to monitor this condition. No other corrective action is recommended at this time. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

#### Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

#### Contaminants

MPC (Membrane Patch Colorimetry) test indicates a light concentration of varnish present.

#### Oil Condition

Rust Prevention test (ASTM D665) indicates the oil retains good anti-corrosion properties. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

Sample Number	Client Info	method	limit/base	current	history1	history2
WC0952387	Client Info			WC0952387	WC0438488	PP
03 Jul 2024	Client Info			03 Jul 2024	15 May 2024	27 Jun 2022
0	Client Info			0	0	0
0	Client Info			0	0	0
N/A	Client Info			N/A	N/A	N/A
MARGINAL				MARGINAL	NORMAL	NORMAL

### WEAR METALS

WEAR METALS	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	0	0
Iron	ppm ASTM D5185(m)	>50	<1	<1	<1
Chromium	ppm ASTM D5185(m)	>10	0	0	0
Nickel	ppm ASTM D5185(m)	>10	<1	0	0
Titanium	ppm ASTM D5185(m)		0	0	0
Silver	ppm ASTM D5185(m)		0	0	0
Aluminum	ppm ASTM D5185(m)	>3	<1	0	0
Lead	ppm ASTM D5185(m)	>75	0	0	<1
Copper	ppm ASTM D5185(m)	>15	<1	<1	<1
Tin	ppm ASTM D5185(m)	>55	0	0	0
Antimony	ppm ASTM D5185(m)	>5	0	0	0
Vanadium	ppm ASTM D5185(m)		0	0	0
Beryllium	ppm ASTM D5185(m)		0	0	0
Cadmium	ppm ASTM D5185(m)		0	0	0

### ADDITIVES

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)		<1	<1	<1
Barium	ppm ASTM D5185(m)		0	0	0
Molybdenum	ppm ASTM D5185(m)		0	0	0
Manganese	ppm ASTM D5185(m)		0	0	0
Magnesium	ppm ASTM D5185(m)		0	1	0
Calcium	ppm ASTM D5185(m)		1	3	<1
Phosphorus	ppm ASTM D5185(m)		9	12	9
Zinc	ppm ASTM D5185(m)	0	4	6	4
Sulfur	ppm ASTM D5185(m)		671	650	698
Lithium	ppm ASTM D5185(m)		<1	<1	<1

### CONTAMINANTS

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m)	>8	0	0	0
Sodium	ppm ASTM D5185(m)		<1	<1	<1
Potassium	ppm ASTM D5185(m)	>20	<1	<1	<1
Water	% ASTM D6304*	>0.1	0.002	---	0.001
ppm Water	ppm ASTM D6304*	>1000	19	---	10.2


### INFRA-RED

INFRA-RED	method	limit/base	current	history1	history2
Soot %	% ASTM D7844*		0	---	0
Nitration	Abs/cm ASTM D7624*		1.8	---	2.1
Sulfation	Abs/.1mm ASTM D7415*		10.6	---	11.6




# OIL ANALYSIS REPORT


## ▲ Varnish Potential

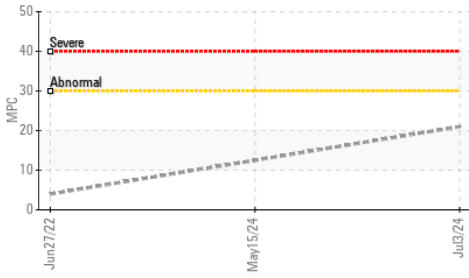


## FT-IR (Direct Trend)

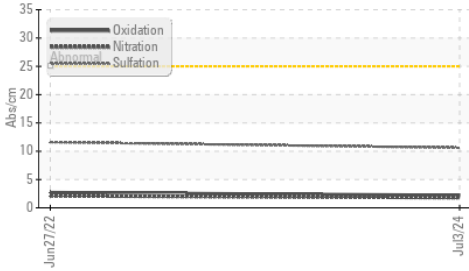


## RPVOT

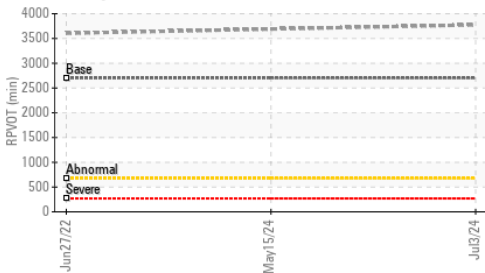

## Remaining Life (RULER)

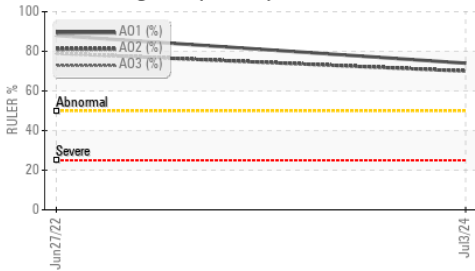

## Foaming SEQ I/II/III

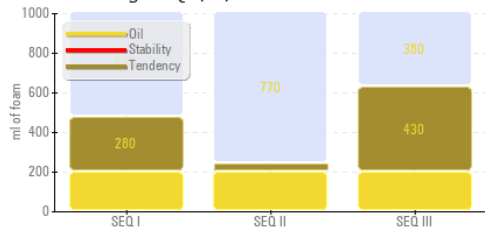

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>1170</b>	694	375
Particles >6µm	ASTM D7647	>640	<b>343</b>	227	140
Particles >14µm	ASTM D7647	>80	<b>33</b>	22	21
Particles >21µm	ASTM D7647	>20	<b>7</b>	6	6
Particles >38µm	ASTM D7647	>4	<b>1</b>	1	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>17/16/12</b>	17/15/12	16/14/12


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*		<b>2.2</b>	---	2.7
Acid Number (AN)	mg KOH/g ASTM D974*	0.04	<b>0.06</b>	0.04	0.09
Anti-Oxidant 1	% ASTM D6971*	<25	<b>74</b>	---	88
Anti-Oxidant 2	% ASTM D6971*	<25	<b>70</b>	---	79
MPC Varnish Potential	Scale ASTM D7843(m)*	>15	<b>▲ 21</b>	---	4

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar Visual*	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	46.39	<b>45.5</b>	45.6	44.1
Visc @ 100°C	cSt ASTM D7279(m)	6.79	<b>6.8</b>	---	6.9
Viscosity Index (VI)	Scale ASTM D2270*	100	<b>103</b>	---	112
Separability	oil/h <sub>2</sub> o/em ASTM D1401*	40/40/0	<b>41/39/0 (20)</b>	---	41/39/0 (20)
Air Release Time	min ASTM D3427*	4	<b>4.40</b>	---	4.60
Foam Tendency	I/II/III ASTM D892*	0	<b>280/40/430</b>	---	410/30/120
Foam Stability	I/II/III ASTM D892*	0	<b>0/0/0</b>	---	0/0/0
ASTM Color	scalar ASTM D1500*	0.5	<b>&lt;2.0</b>	---	<1.0
Rust Prevention	PASS/FAIL ASTM D665*		<b>PASS</b>	---	PASS
Oxidation Test (RPVOT)	minutes ASTM D2272*	2700	<b>3775</b>	---	3605

SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	% ASTM D893(m)*		<b>0.009</b>	---	0.031
Toluene Insolubles	% ASTM D893(m)*		<b>0.005</b>	---	0.015

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

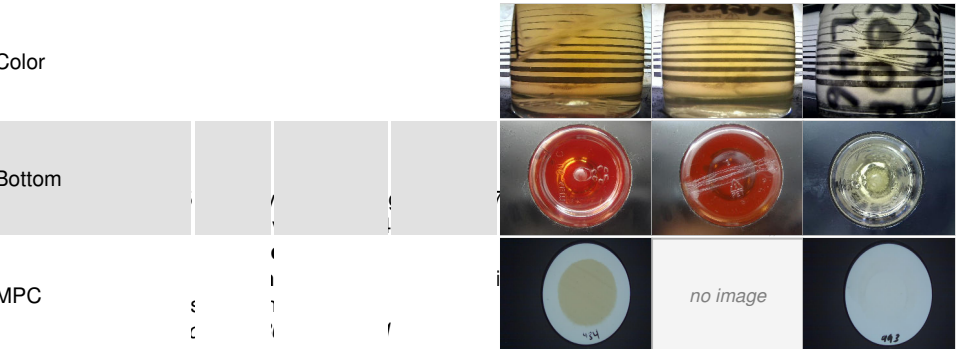

Laboratory Sample No. : \ Lab Number : ( Unique Number : 5 Test Package : / MPC

To discuss this sample report, cc

Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Validity of results and interpretation are based on the sample and information as supplied.




T: (905)357-0322

F: (905)374-5466



# FERROGRAPHY REPORT

Machine Id  
**SAB1 G2 GOVERNER**  
 Component  
**Governor System**  
 Fluid  
**PETRO CANADA TURBOFLO XL46 (--- LTR)**

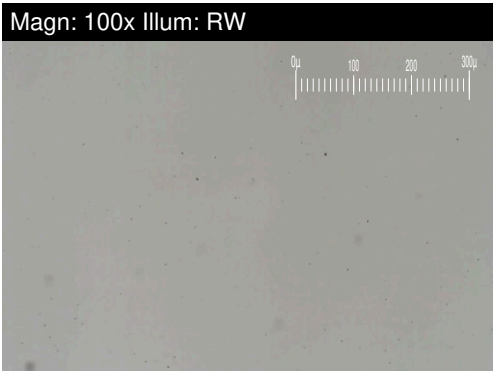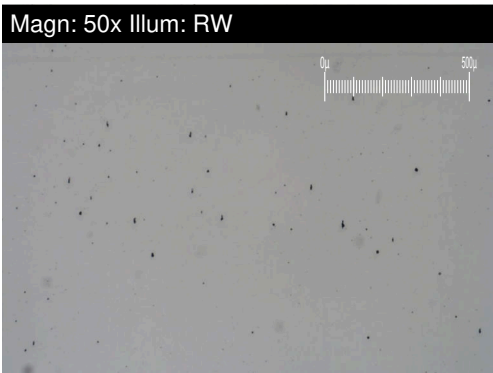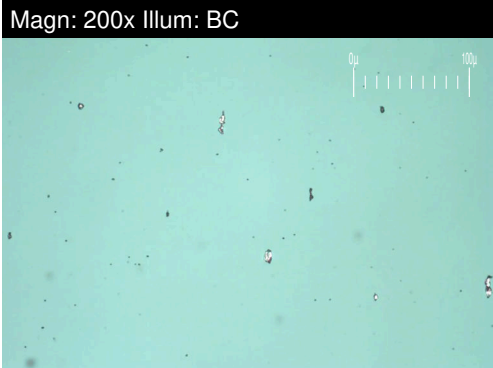

DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>2.0</b>	---	1.4
Small Particles		DR-Ferr*		<b>1.3</b>	---	0.2
Total Particles		DR-Ferr*	>---	<b>3.3</b>	---	1.6
Large Particles Percentage	%	DR-Ferr*		<b>21.2</b>	---	75
Severity Index		DR-Ferr*		<b>1</b>	---	2

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>2</b>		1
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		<b>1</b>		1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>1</b>		
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*				1

### WEAR

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

