

OIL ANALYSIS REPORT

SAB1 **SAB1 G6 Governor**

Hydraulic System

DIAGNOSIS

Recommendation

ESSO TERESSO ISO 46 (1600 LTR)

Sample Rating Trend



SAMPLE INFORMATION method

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

Wear

Component wear rates appear to be normal (unconfirmed).

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sample Number		Client Info		WC0933975	WC0812560	WC0642848
Sample Date		Client Info		03 Jul 2024	15 May 2024	21 Dec 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL
CONTAMINATION	1	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	<1	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	0	<1
Lead	ppm	ASTM D5185(m)	>20	0	0	0
Copper	ppm	ASTM D5185(m)	>20	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>20	0	0	0
Antimony Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m) ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0
ADDITIVES	ррпп	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	<1	0
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	0	0
Calcium	ppm	ASTM D5185(m)	0	<1	0	<1
Phosphorus	ppm	ASTM D5185(m)	2.4	7	6	6
Zinc	ppm	ASTM D5185(m)	0	1	1	<1
Sulfur	ppm	ASTM D5185(m)		709	672	742
Lithium	ppm	ASTM D5185(m)		<1	<1	<1
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	0	0	<1
Sodium	ppm	ASTM D5185(m)		0	0	0
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	363	228	▲ 8493
Particles >6µm		ASTM D7647	>640	102	94	1210
Particles >14μm		ASTM D7647	>80	9	12	21
Particles >21µm		ASTM D7647	>20	1	3	4
Particles >38μm		ASTM D7647	>4	0	1	1
Particles >71μm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>18/16/13	16/14/10	15/14/11	△ 20/17/12



OIL ANALYSIS REPORT

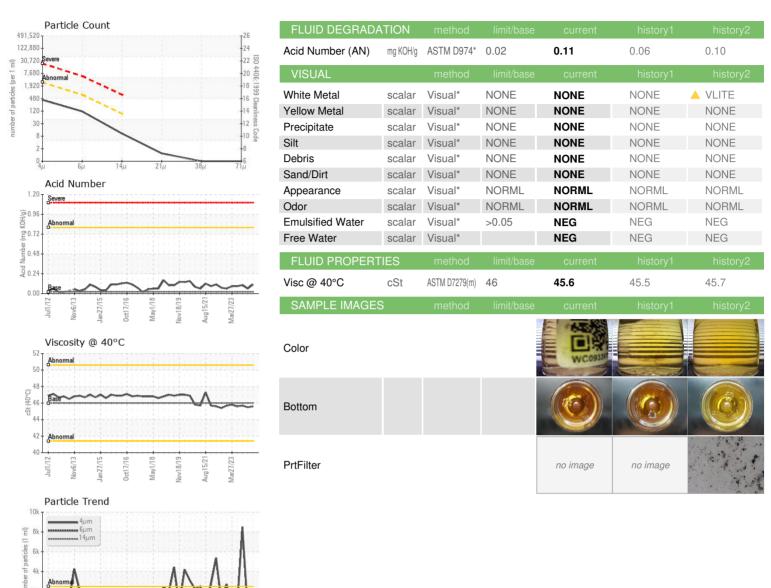



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No.

: WC0933975 Lab Number : 02645449

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Received : 04 Jul 2024 **Tested** : 05 Jul 2024

Unique Number : 5802988 Diagnosed

Test Package : IND 2 (Additional Tests: TAN Man) To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

Ontario Power Generation

NIAGARA PLANT GROUP,, 14000 NIAGARA PKWY NIAGARA ON THE LAKE, ON : 05 Jul 2024 - Kevin Marson

CA LOS 1J0 Contact: Michael Brochu mike.brochu@opg.com

T: (905)357-0322 F: (905)374-5466

Submitted By: ?