




OIL ANALYSIS REPORT

Sample Rating Trend

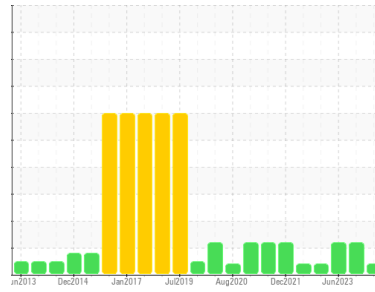

ADDITIVES



Area
BRUCE A/2/71210
 Machine Id
2-71210-P3-PM Lo Brg Level
 Component
Lower Bearing
 Fluid
ESSO TERESSO ISO 68 (--- GAL)

DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC	WC0871685	WC0801483
Sample Date	Client Info			05 Jun 2024	30 Nov 2023	19 Jun 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ATTENTION	ABNORMAL	ATTENTION






WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>10	0	0	0
Chromium	ppm	ASTM D5185(m)	>5	0	0	0
Nickel	ppm	ASTM D5185(m)	>5	<1	0	0
Titanium	ppm	ASTM D5185(m)	>5	0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	0
Aluminum	ppm	ASTM D5185(m)	>5	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>5	4	▲ 10	● 7
Copper	ppm	ASTM D5185(m)	>5	<1	<1	0
Tin	ppm	ASTM D5185(m)	>5	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	4.5	<1	<1	<1
Barium	ppm	ASTM D5185(m)	0.4	0	<1	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	0	<1
Calcium	ppm	ASTM D5185(m)	0	<1	<1	<1
Phosphorus	ppm	ASTM D5185(m)	0.7	● 8	● 8	● 8
Zinc	ppm	ASTM D5185(m)	0	<1	<1	2
Sulfur	ppm	ASTM D5185(m)	1315	1077	1113	1076
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>5	0	0	0
Sodium	ppm	ASTM D5185(m)	>5	0	0	0
Potassium	ppm	ASTM D5185(m)	>20	0	0	0
Water	%	ASTM D6304*	>0.005	0.001	0.004	0.001
ppm Water	ppm	ASTM D6304*	>50	12	43	6.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	1567	293	366
Particles >6µm		ASTM D7647	>1300	321	94	104
Particles >14µm		ASTM D7647	>320	17	9	9
Particles >21µm		ASTM D7647	>80	6	3	2
Particles >38µm		ASTM D7647	>20	1	1	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/15	18/16/11	15/14/10	16/14/10

OIL ANALYSIS REPORT

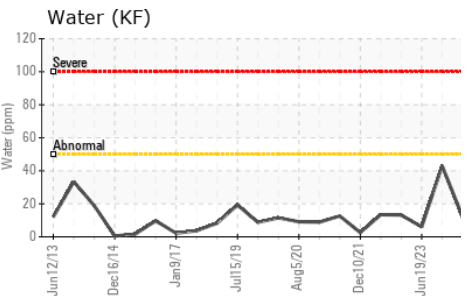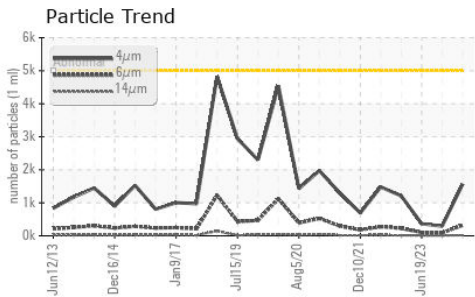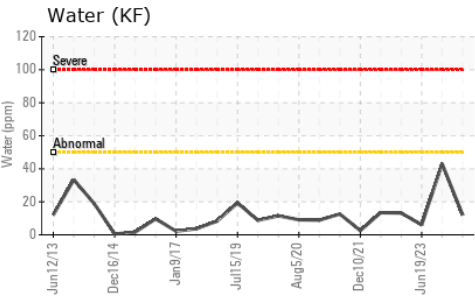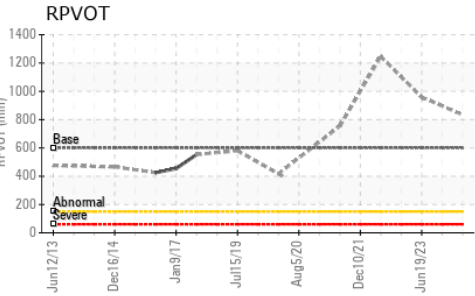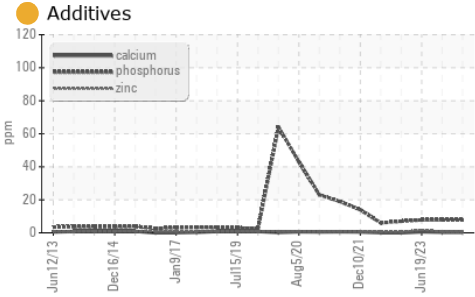





FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.02	0.08	0.15	0.09

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	VLITE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.005	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	67.0	66.7	66.6
Oxidation Test (RPVOT)	minutes	ASTM D2272*	600	834	---	959

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

GRAPHS

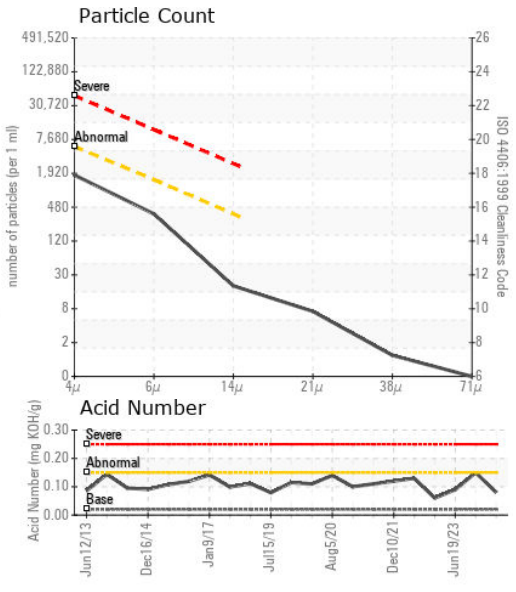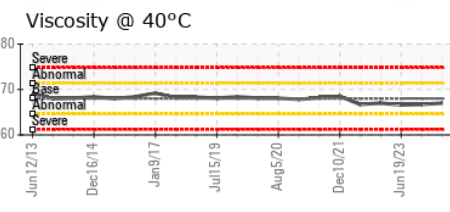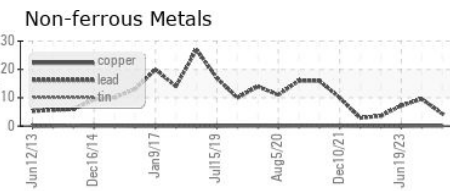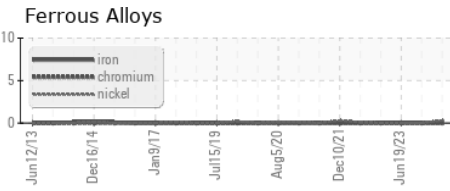

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC
Lab Number : 02645504
Unique Number : 5803043
Test Package : IND 2 (Additional Tests: RPVOT, TAN Man)

Bruce Power - Bruce A PdM
 P.O.Box 1540, 177 Tie Road, RM-222 U2 Column 2N11 615'
 Tiverton, ON
 CA N0G 2T0
 Contact: Pierre Adouki
 pierre.adouki@brucepower.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T: (519)361-2673
 F: