




# OIL ANALYSIS REPORT



Area  
**ATCO PARK Ch #1 Circ 1 [GTT224-470 866446]**  
 Machine Id  
**YORK 11531064774699(1,1)**  
 Component  
**Chiller**  
 Fluid  
**YORK TYPE L (--- GAL)**

### Sample Rating Trend

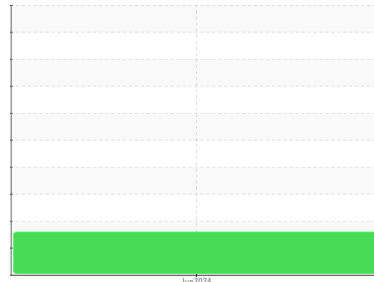

WATER



### DIAGNOSIS

#### Recommendation

If not recently done change any filter driers to reduce moisture level. We recommend an early resample to monitor this condition.

#### Wear

All component wear rates are normal.

#### Contamination

The elevated moisture content is associated with POE oils which are hygroscopic, and can absorb moisture from sampling and processing.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GTT0002683</b>	---	---
Sample Date	Client Info		<b>26 Jun 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	<b>0</b>	---	---
Chromium	ppm	ASTM D5185(m) >2	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)	<b>0</b>	---	---
Titanium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m) >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m) >3	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185(m) >2	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m) >8	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185(m) >4	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Zinc	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Sulfur	ppm	ASTM D5185(m) 10	<b>21</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>8</b>	---	---
Sodium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
ppm Water	ppm	ASTM D6304* >300	<b>430</b>	---	---



### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.02	<b>0.01</b>	---	---

# OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	120	<b>102</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS



**Sample No.** : GTT0002683  
**Lab Number** : 02645684  
**Unique Number** : 5803223  
**Test Package** : IND 2 ( Additional Tests: KF, TAN Man )  
**Received** : 04 Jul 2024  
**Tested** : 09 Jul 2024  
**Diagnosed** : 09 Jul 2024 - Bill Quesnel

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

**Ainsworth Electric - Calgary**  
 100-2588 27th St NE  
 Calgary, AB  
 CA T1Y 7G1  
 Contact: Service Manager

T:  
F: