




OIL ANALYSIS REPORT

Sample Rating Trend

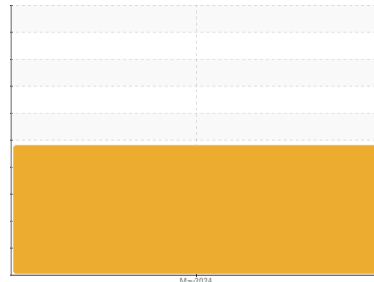

FUEL



Area
COUNTY OF SIMCOE [OR89760]

Machine Id
TWM03960

Component
Diesel Engine

Fluid
{not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

We advise that you check the fuel injection system. We advise that you check the air filter, air induction system, and any areas where dirt may enter the component. We recommend that you drain the oil from the component if this has not already been done. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of fuel present in the oil. There is a moderate concentration of dirt present in the oil. Tests confirm the presence of fuel in the oil.

▲ Fluid Condition

Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PP	---	---
Sample Date	Client Info		08 May 2024	---	---
Machine Age	hrs	Client Info	5422	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			SEVERE	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >100	7	---	---
Chromium	ppm	ASTM D5185(m) >20	<1	---	---
Nickel	ppm	ASTM D5185(m) >4	0	---	---
Titanium	ppm	ASTM D5185(m)	<1	---	---
Silver	ppm	ASTM D5185(m) >3	0	---	---
Aluminum	ppm	ASTM D5185(m) >20	<1	---	---
Lead	ppm	ASTM D5185(m) >40	<1	---	---
Copper	ppm	ASTM D5185(m) >330	5	---	---
Tin	ppm	ASTM D5185(m) >15	<1	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	33	---	---
Barium	ppm	ASTM D5185(m)	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	24	---	---
Manganese	ppm	ASTM D5185(m)	<1	---	---
Magnesium	ppm	ASTM D5185(m)	297	---	---
Calcium	ppm	ASTM D5185(m)	1027	---	---
Phosphorus	ppm	ASTM D5185(m)	552	---	---
Zinc	ppm	ASTM D5185(m)	641	---	---
Sulfur	ppm	ASTM D5185(m)	1499	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	▲ 29	---	---
Sodium	ppm	ASTM D5185(m)	4	---	---
Potassium	ppm	ASTM D5185(m) >20	2	---	---
Fuel	%	ASTM D7593* >5	▲ 43.3	---	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	0	---	---
Nitration	Abs/cm	ASTM D7624* >20	5.7	---	---
Sulfation	Abs.1mm	ASTM D7415* >30	17.6	---	---



OIL ANALYSIS REPORT

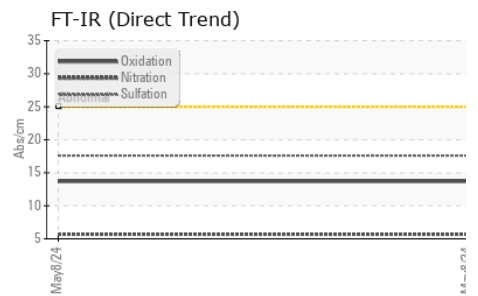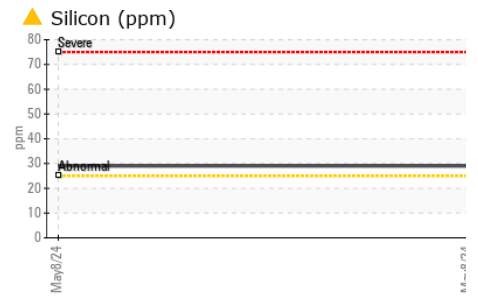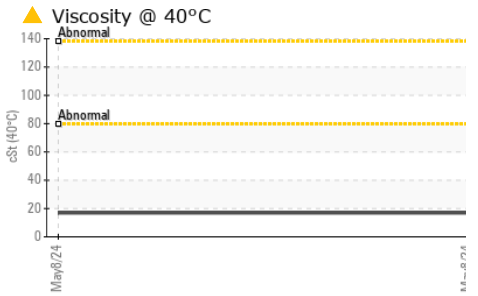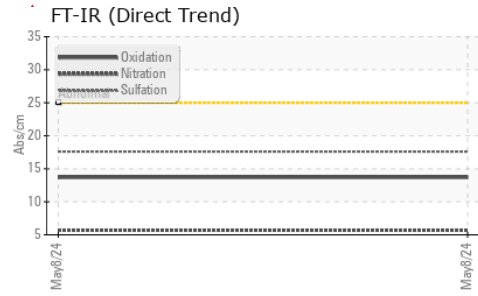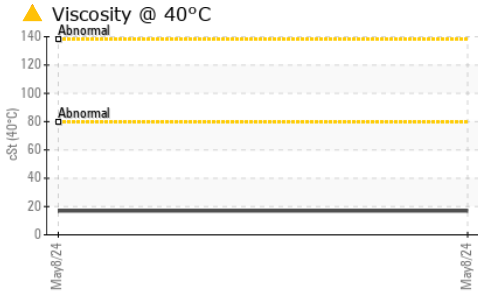


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	13.7	---	---

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	LIGHT	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	▲ 16.9	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	▲ 4.2	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	161	---	---

GRAPHS

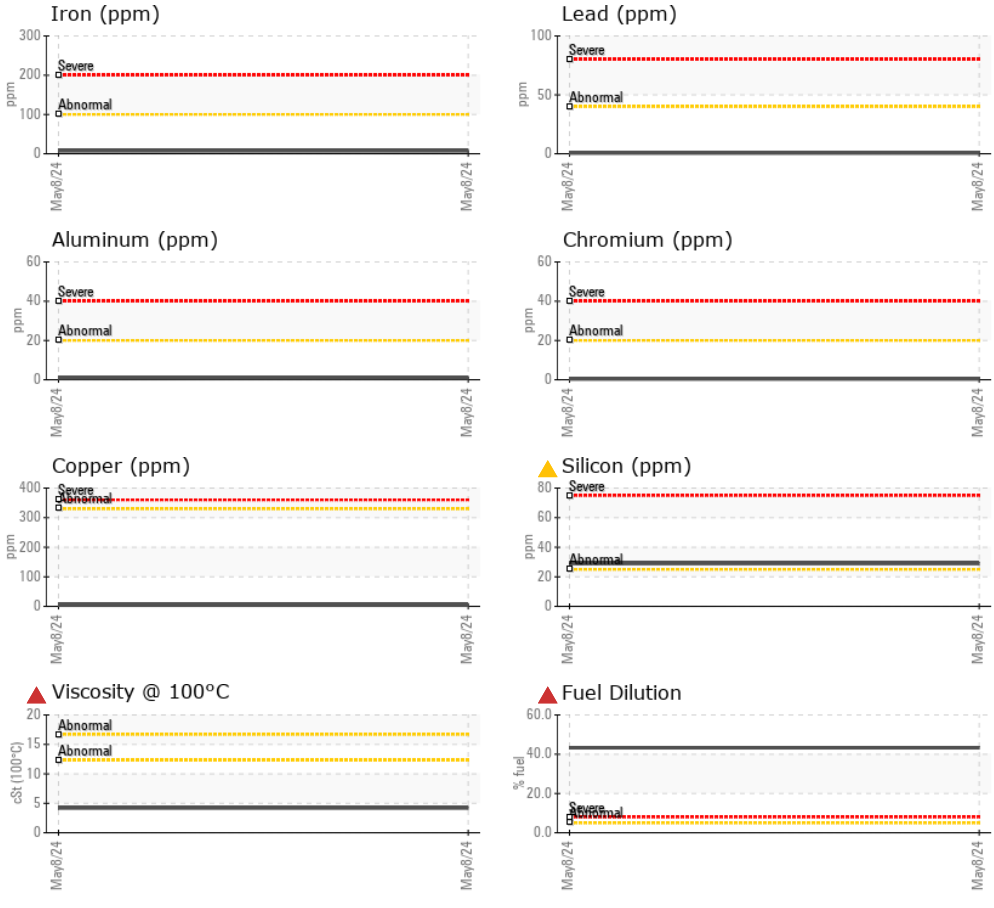

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP
Lab Number : 02645760
Unique Number : 5803299
Test Package : MOB 1 (Additional Tests: FuelDilution, KV40, PercentFuel, VI, Visual)

Toromont CAT - Power Systems
 288 Orenda Rd.
 Brampton, ON
 CA L6T 1E9
 Contact: Scott McMahon
 smcmahon@toromont.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.