




OIL ANALYSIS REPORT

Sample Rating Trend

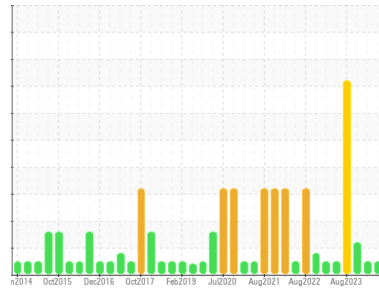

NORMAL



Area
BRUCE B/0B/54600
 Machine Id
0B-54600-SG8-Avon Aux
 Component
Tank Jet Turbine
 Fluid
SHELL AEROSHELL 500 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.
 NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0566939	WC0566927	WC0628147
Sample Date	Client Info			02 Jul 2024	12 Mar 2024	28 Nov 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	MARGINAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>2	<1	0	0
Chromium	ppm	ASTM D5185(m)	>1	0	0	0
Nickel	ppm	ASTM D5185(m)	>1	0	0	0
Titanium	ppm	ASTM D5185(m)	>5	0	0	0
Silver	ppm	ASTM D5185(m)	>2	0	0	<1
Aluminum	ppm	ASTM D5185(m)	>1	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>2	0	<1	0
Copper	ppm	ASTM D5185(m)	>1	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>1	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	<1	<1
Barium	ppm	ASTM D5185(m)	0	0	0	<1
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	0	0
Calcium	ppm	ASTM D5185(m)	0	0	0	0
Phosphorus	ppm	ASTM D5185(m)	1000	976	1009	999
Zinc	ppm	ASTM D5185(m)	5	<1	<1	<1
Sulfur	ppm	ASTM D5185(m)	0	1	0	6
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>5	<1	<1	<1
Sodium	ppm	ASTM D5185(m)	>5	<1	0	<1
Potassium	ppm	ASTM D5185(m)	>20	0	<1	0
Water	%	ASTM D6304*	>0.05	0.054	0.031	0.040
ppm Water	ppm	ASTM D6304*	>500	542	314	407

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	1512	1472	1320
Particles >6µm		ASTM D7647	>1300	173	201	206
Particles >14µm		ASTM D7647	>320	7	9	13
Particles >21µm		ASTM D7647	>80	3	4	3
Particles >38µm		ASTM D7647	>20	1	1	0
Particles >71µm		ASTM D7647	>4	0	1	0
Oil Cleanliness		ISO 4406 (c)	>19/17/15	18/15/10	18/15/10	18/15/11


Particle Filter (Magn: 200 x)






OIL ANALYSIS REPORT


Flash Point (°C)

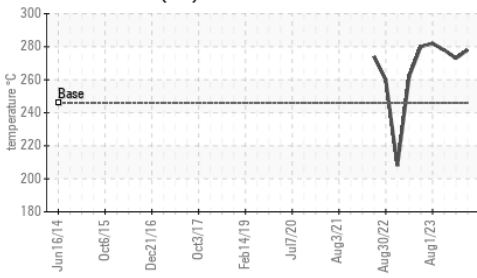


Particle Count

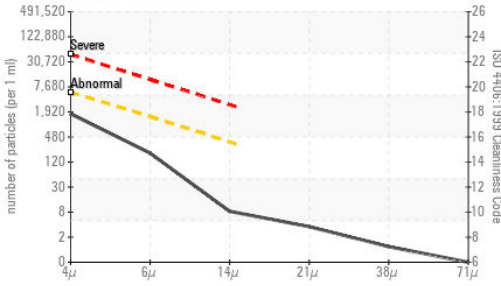


Acid Number

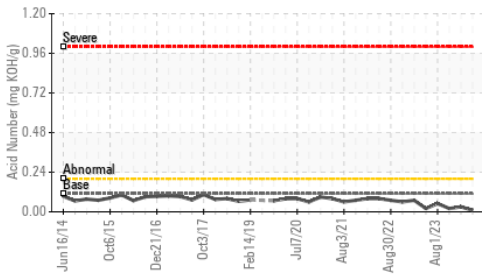

Water (KF)

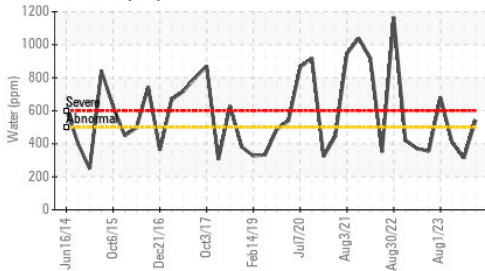

Viscosity @ 100°C

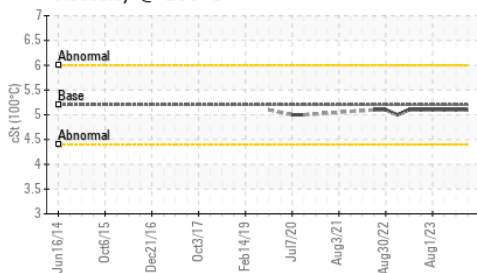


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974*	0.11	0.01	0.03	0.02

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	NONE	▲ VLITE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	25.3	25.5	25.6	25.9
Visc @ 100°C	cSt	ASTM D7279(m)	5.2	5.1	5.1	5.1
Viscosity Index (VI)	Scale	ASTM D2270*	141	131	130	127
COC Flash Point	°C	ASTM D92*	246	278	273	278

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

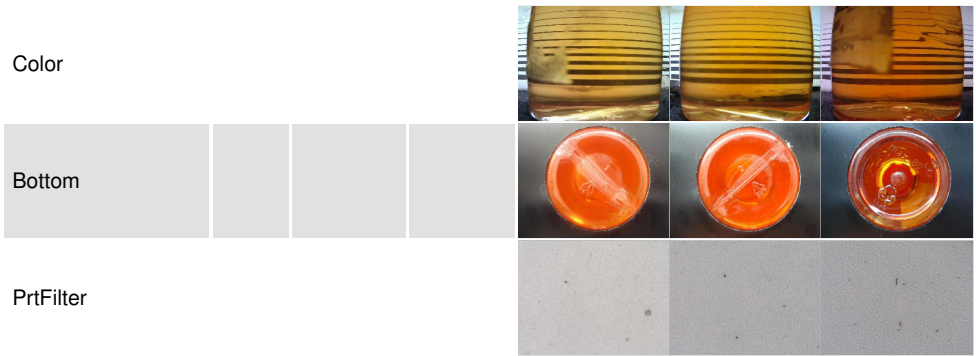

PrtFilter



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0566939
Lab Number : 02645873
Unique Number : 5811425
Test Package : IND2+ (Additional Tests: BottomAnalysis, PrtFilter, Spat, VI, Visual)

Bruce Power - Bruce A PdM
 P.O.Box 1540, 177 Tie Road, RM-222 U2 Column 2N11 615'
 Tiverton, ON
 CA N0G 2T0
 Contact: Andrew Roffey
 andrew.roffey@brucepower.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T: (519)361-2673 x:17186
 F: