

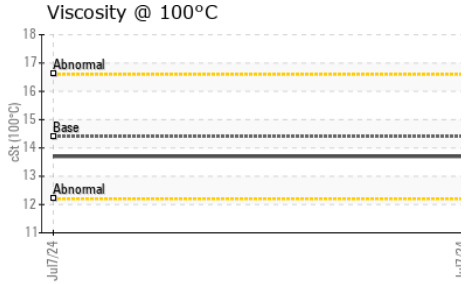


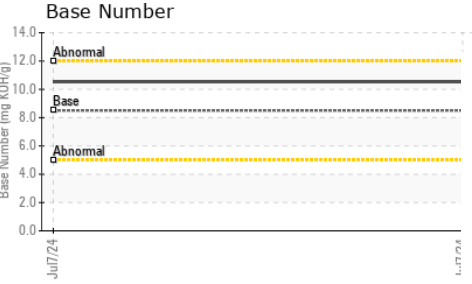

OIL ANALYSIS REPORT








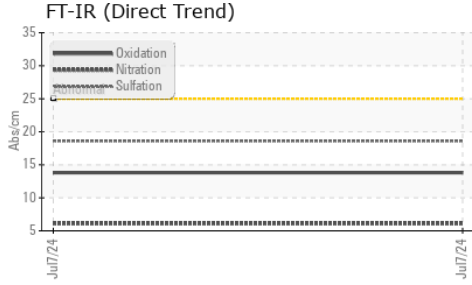


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	13.8	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*	8.5	10.54	---	---

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.7	---	---

GRAPHS

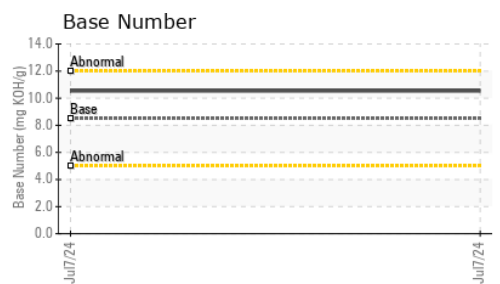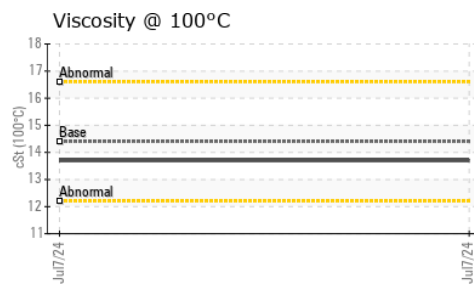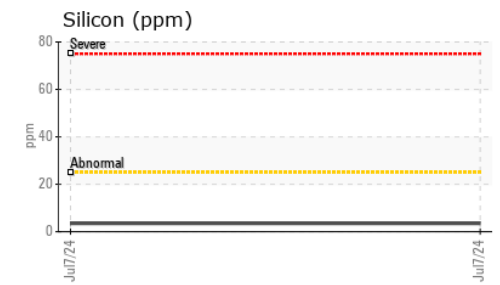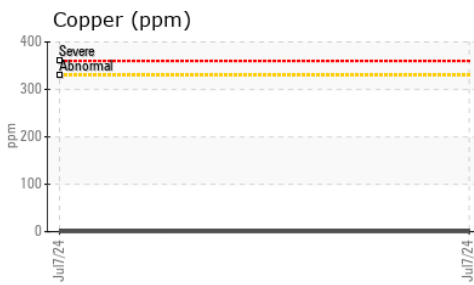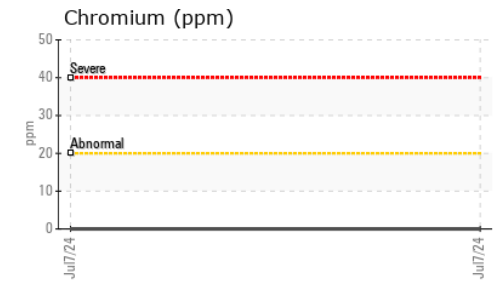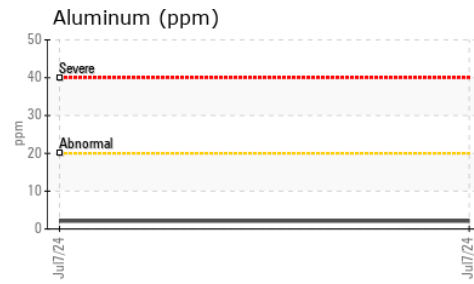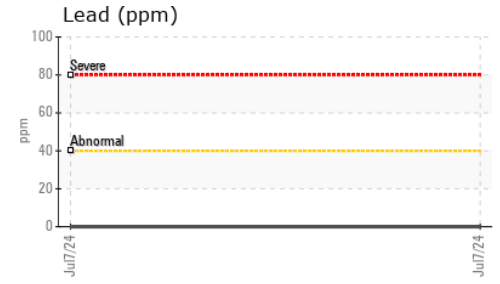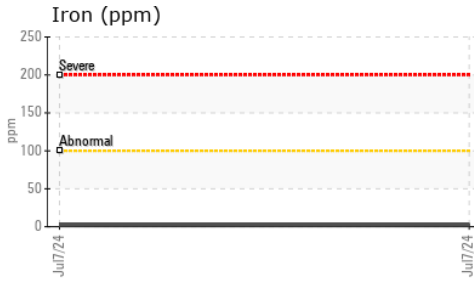

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0944084 **Received** : 08 Jul 2024
Lab Number : **02646182** **Tested** : 09 Jul 2024
Unique Number : 5811734 **Diagnosed** : 09 Jul 2024 - Wes Davis
Test Package : MOB 2

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

GENREP LIMITED
 25 GIFFORD STREET
 NEPEAN, ON
 CA K2E 7S3
 Contact: Carmen Lavryssen
 servicedesk@genrep.com
 T: (613)225-9244
 F: (613)225-4690