



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Area

Machine Id

**TRADITION FINE FOODS [4501256261]**

Component

**Compressor**

Fluid

**MYCOM MYCOLD AB68 (--- LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0948665</b>	---	---
Sample Date	Client Info			<b>28 Jun 2024</b>	---	---
Machine Age	hrs	Client Info		<b>5835</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		<b>0</b>	---	---
Iron	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185(m)	>10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185(m)	>25	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	---	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>0</b>	---	---
Barium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Calcium	ppm	ASTM D5185(m)		<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	2.3	<b>2</b>	---	---
Zinc	ppm	ASTM D5185(m)		<b>2</b>	---	---
Sulfur	ppm	ASTM D5185(m)	26	<b>5</b>	---	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>2</b>	---	---
Sodium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Water	%	ASTM D6304*	>0.1	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304*	>1000	<b>30</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.01	<b>0.01</b>	---	---



# OIL ANALYSIS REPORT

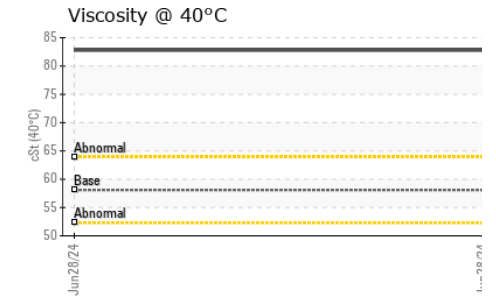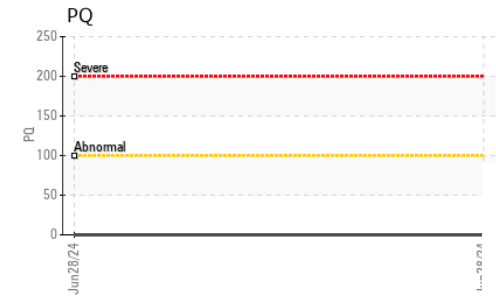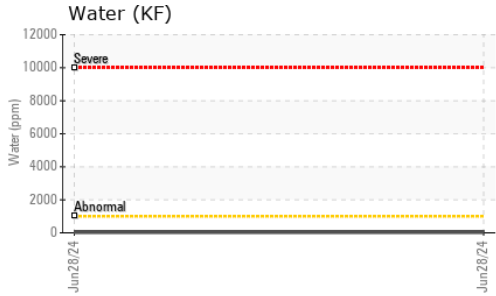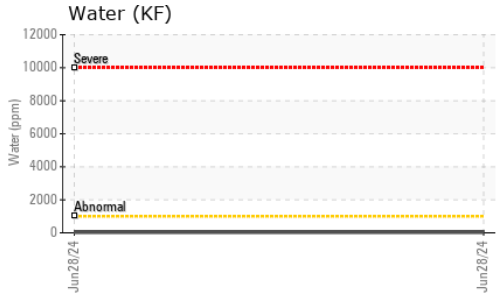

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	VLITE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	VLITE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.1	NEG	---
Free Water	scalar	Visual*		NEG	---






FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	58.09	82.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

**Color**

	no image	no image
<b>Bottom</b>		no image

## GRAPHS

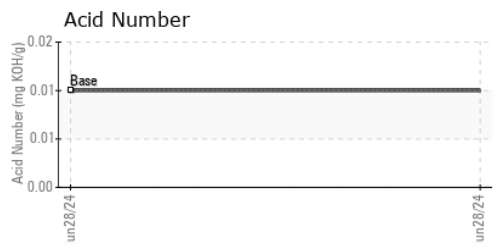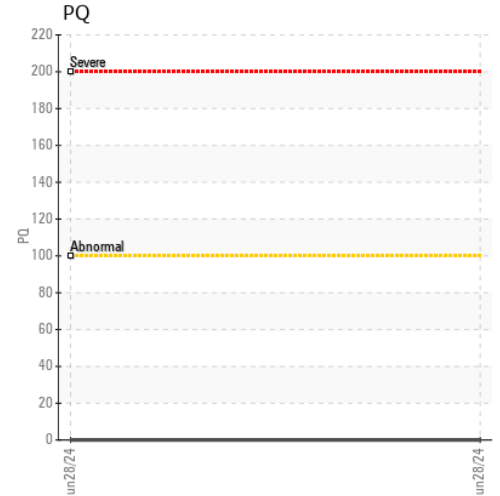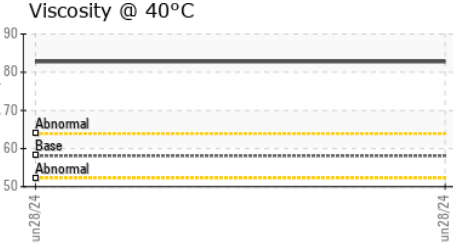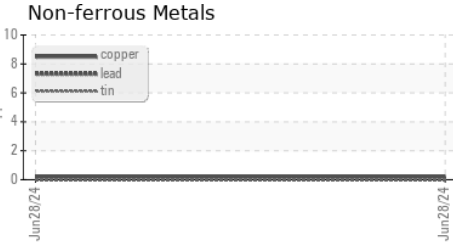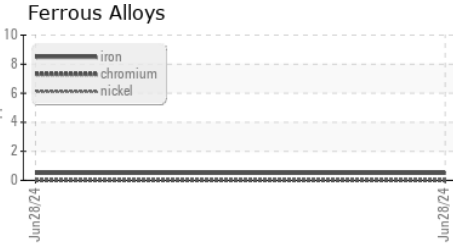

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0948665 **Received** : 08 Jul 2024  
**Lab Number** : 02646265 **Tested** : 11 Jul 2024  
**Unique Number** : 5811817 **Diagnosed** : 11 Jul 2024 - Bill Quesnel  
**Test Package** : IND 2 ( Additional Tests: KF )

**CIMCO Refrigeration**  
 1551 Corporate Drive  
 Burlington, ON  
 CA L7L 6M3  
 Contact: DAVID PARISE  
 DPARISE@ToROMONT.COM  
 T: (416)465-7581  
 F: (416)465-8815

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.