




OIL ANALYSIS REPORT



Area
[26914]
 Machine Id
CARRIER 365 POW CHILLER (S/N 3811Q21049)
 Component
Compressor
 Fluid
COMP OIL (POE) ISO 68 (12 GAL)

Sample Rating Trend

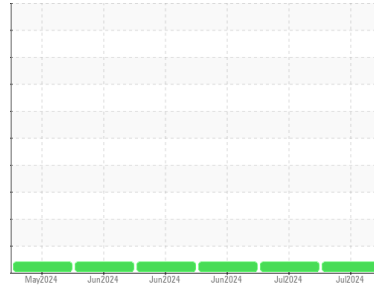

VISCOSITY



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

Viscosity of sample indicates oil is within ISO 46 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	PP0001136	PP0001139	PP0001129	
Sample Date	Client Info	08 Jul 2024	02 Jul 2024	26 Jun 2024	
Machine Age	hrs	Client Info	14307	0	14035
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A	
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL	

WEAR METALS

method	limit/base	current	history1	history2	
PQ	ASTM D8184*	0	0	0	
Iron	ppm	ASTM D5185(m) >50	1	1	1
Chromium	ppm	ASTM D5185(m) >10	0	0	0
Nickel	ppm	ASTM D5185(m)	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >25	0	<1	<1
Lead	ppm	ASTM D5185(m) >25	0	0	0
Copper	ppm	ASTM D5185(m) >50	<1	<1	<1
Tin	ppm	ASTM D5185(m) >15	0	<1	0
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m) 5	<1	1	<1
Barium	ppm	ASTM D5185(m) 5	2	0	0
Molybdenum	ppm	ASTM D5185(m) 5	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m) 5	<1	0	0
Calcium	ppm	ASTM D5185(m) 5	0	0	0
Phosphorus	ppm	ASTM D5185(m) 400	1734	1780	1842
Zinc	ppm	ASTM D5185(m) 5	1	2	2
Sulfur	ppm	ASTM D5185(m) 100	25	25	28
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS





method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >25	18	20	19
Sodium	ppm	ASTM D5185(m)	0	0	0
Potassium	ppm	ASTM D5185(m) >20	<1	<1	<1
Water	%	ASTM D6304* >0.1	0.043	0.022	0.016
ppm Water	ppm	ASTM D6304* >1000	436	226	164

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974* 0.40	0.07	0.10	0.09




OIL ANALYSIS REPORT

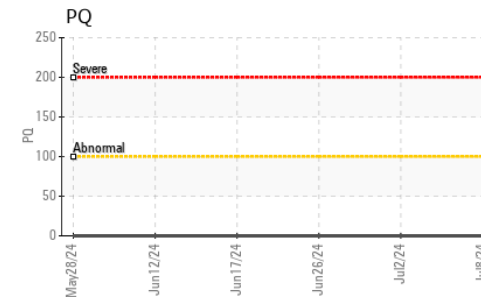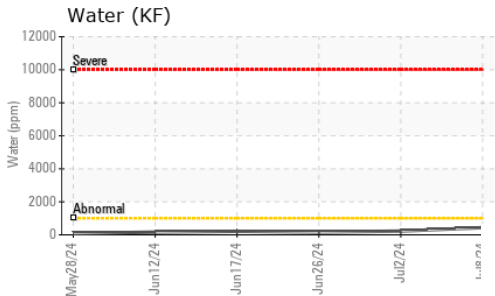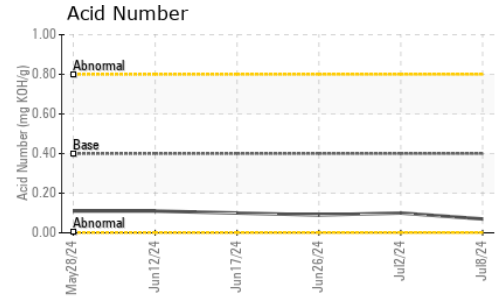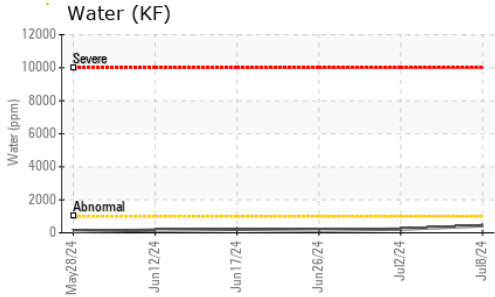






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	FREON
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68 ▲ 47.0	▲ 42.6	▲ 48.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

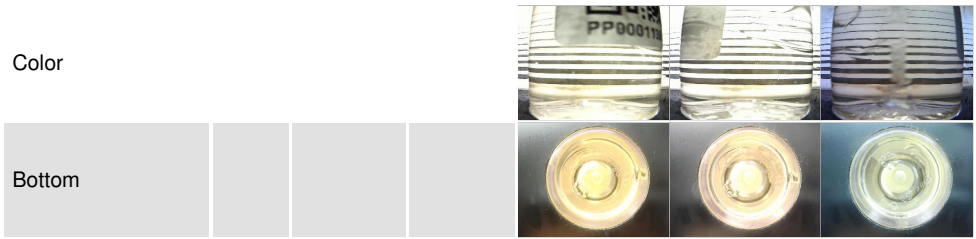

GRAPHS

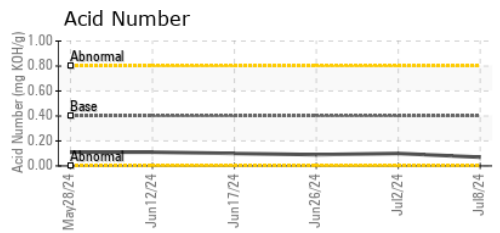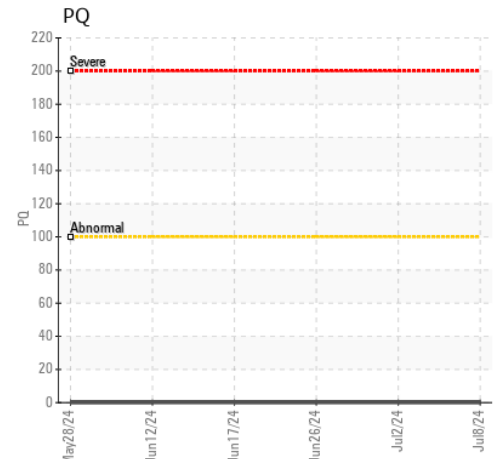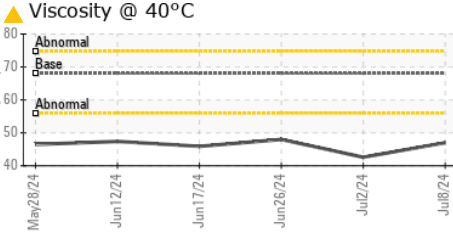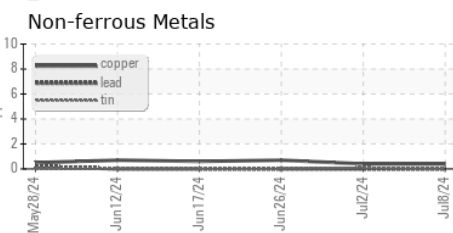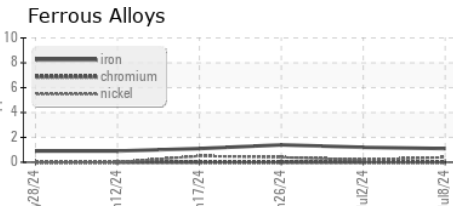

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP0001136 **Received** : 09 Jul 2024
Lab Number : 02646721 **Tested** : 12 Jul 2024
Unique Number : 5812273 **Diagnosed** : 12 Jul 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: KF, TAN Man)

Complete Chiller Solutions
 8-4444 Eastgate Parkway
 Mississauga, ON
 CA L4W 4T6
 Contact: Neil Patten
 neil@complete-cs.ca
 T: (905)629-8585
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.