




# OIL ANALYSIS REPORT

## Sample Rating Trend

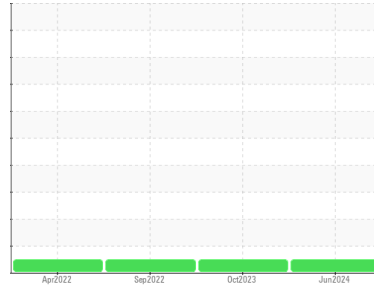

**NORMAL**



Area

**Hull 2**

Machine Id

**EH-G3-NDE (1)**

Component

**Bearing**

Fluid

**MOBIL DTE EXCEL ISO 68 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.  
NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

#### Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

#### Contaminants

There is no indication of any contamination in the oil.

#### Oil Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0736164</b>	WC0815809	WC0736145
Sample Date	Client Info			<b>25 Jun 2024</b>	19 Oct 2023	02 Sep 2022
Machine Age	mths	Client Info		<b>39</b>	31	18
Oil Age	mths	Client Info		<b>39</b>	31	18
Oil Changed	Client Info			<b>N/A</b>	Not Changd	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	0
Lead	ppm	ASTM D5185(m)	>20	<b>5</b>	6	4
Copper	ppm	ASTM D5185(m)	>20	<b>19</b>	18	12
Tin	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	1	1
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Barium	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	<1
Calcium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0
Phosphorus	ppm	ASTM D5185(m)		<b>115</b>	133	135
Zinc	ppm	ASTM D5185(m)		<b>49</b>	60	65
Sulfur	ppm	ASTM D5185(m)		<b>479</b>	529	522
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	.2	<b>0.09</b>	0.08	0.11




# OIL ANALYSIS REPORT

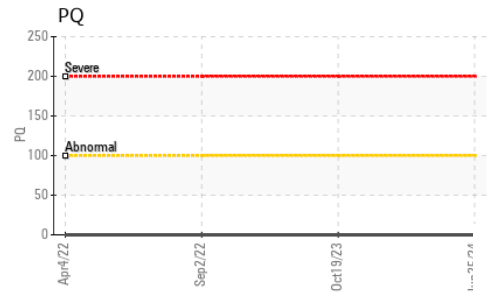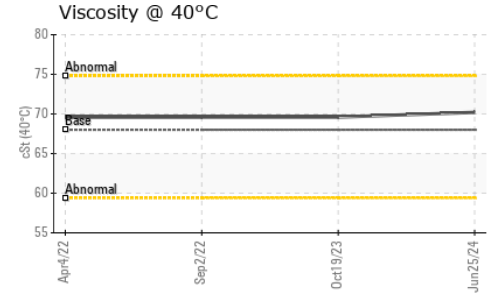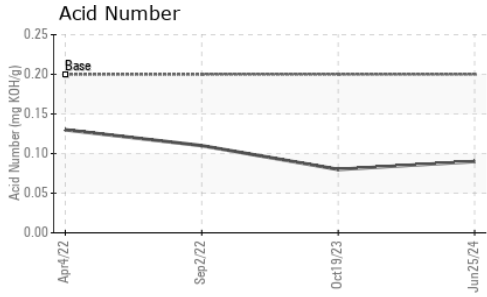






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	VLITE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	70.2	69.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

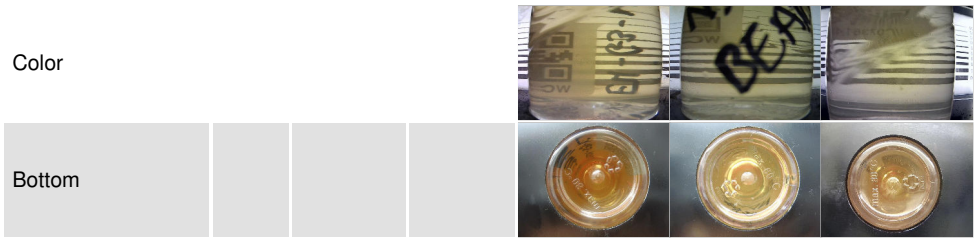

## GRAPHS

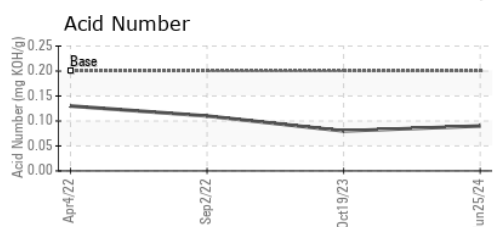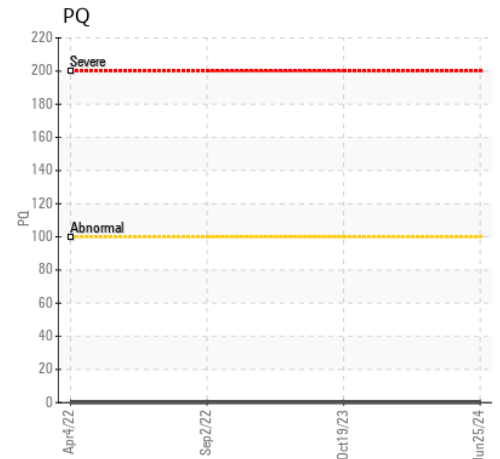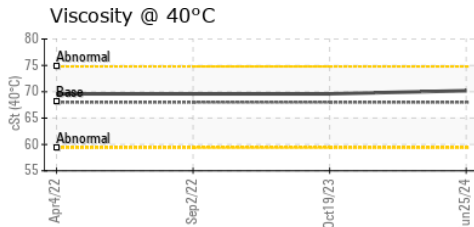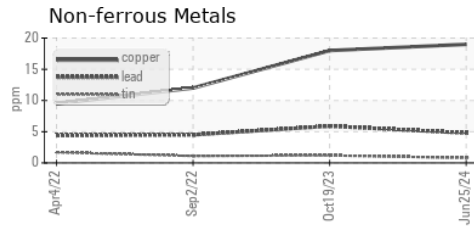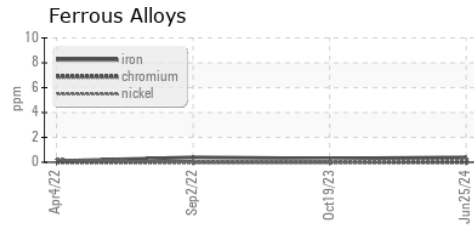

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0736164      **Received** : 09 Jul 2024  
**Lab Number** : 02646735      **Tested** : 12 Jul 2024  
**Unique Number** : 5812287      **Diagnosed** : 12 Jul 2024 - Kevin Marson  
**Test Package** : IND 3 ( Additional Tests: TAN Man )

**Portage Power - Energy Ottawa**  
 4 Booth Street  
 Ottawa, ON  
 CA K1R 6K8  
 Contact: Oluseyi Smith  
 oluseyismith@portagepower.com


To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.




# FERROGRAPHY REPORT

Area  
**Hull 2**  
 Machine Id  
**EH-G3-NDE (1)**  
 Component  
**Bearing**  
 Fluid  
**MOBIL DTE EXCEL ISO 68 (--- GAL)**


Magn: 200x Illum: BC

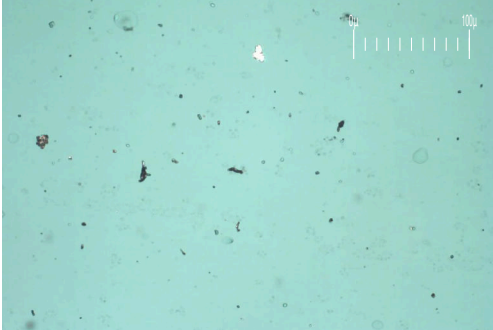

Magn: 50x Illum: RW

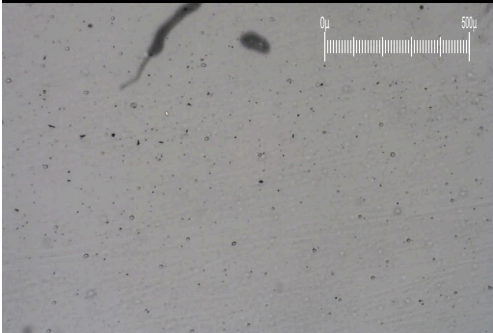

Magn: 100x Illum: RW

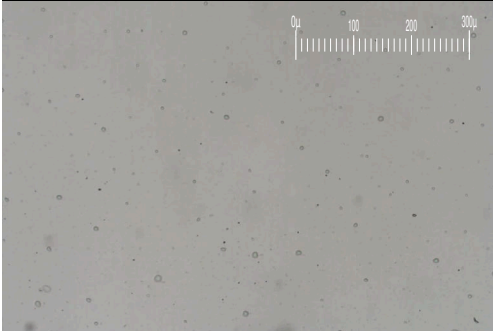


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		3.6	2.6	8.1
Small Particles		DR-Ferr*		3.4	1.1	7.8
Total Particles		DR-Ferr*	>---	7	3.7	15.9
Large Particles Percentage	%	DR-Ferr*		2.9	40.5	1.9
Severity Index		DR-Ferr*		1	4	2

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		1	1	1
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		1	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				1
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1	1	1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		2	2	1

## WEAR

All component wear rates are normal. The ferroggraphy results are normal indicating no abnormal wear in the system.

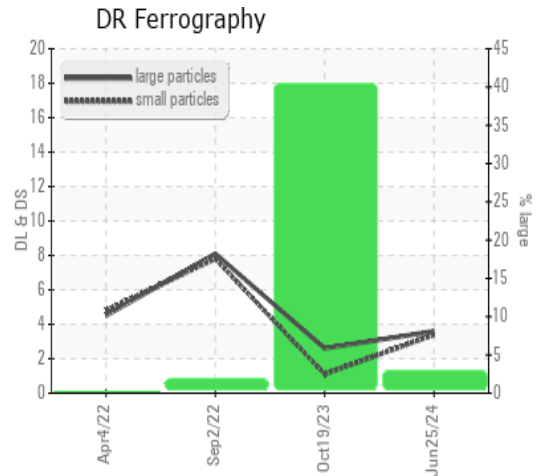

*This page left intentionally blank*