




FUEL REPORT

Sample Rating Trend

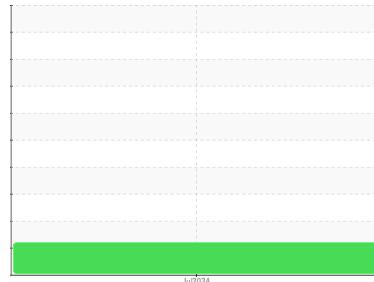

ISO



Area
[AS76200]

Machine Id
5666

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. We advise that you filter this fluid before use. We recommend you service the filters on this component. Resample at the next service interval to monitor.

Contaminants

There is a light amount of silt (particulates < 14 microns in size) present in the fuel. The water content is negligible.

Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PP	---	---
Sample Date	Client Info			10 Jul 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				ATTENTION	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.839	0.853	---	---
Fuel Color	text	Visual Screen*	Yellow	Yellow	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	2.9	---	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	64.9	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	10	9	---	---

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	178	---	---
5% Distillation Point	°C	ASTM D2887*		207	---	---
10% Distill Point	°C	ASTM D2887*	201	218	---	---
15% Distillation Point	°C	ASTM D2887*		227	---	---
20% Distill Point	°C	ASTM D2887*	216	236	---	---
30% Distill Point	°C	ASTM D2887*	230	252	---	---
40% Distill Point	°C	ASTM D2887*	243	266	---	---
50% Distill Point	°C	ASTM D2887*	255	280	---	---
60% Distill Point	°C	ASTM D2887*	267	295	---	---
70% Distill Point	°C	ASTM D2887*	280	310	---	---
80% Distill Point	°C	ASTM D2887*	295	322	---	---
85% Distillation Point	°C	ASTM D2887*		328	---	---
90% Distill Point	°C	ASTM D2887*	310	334	---	---
95% Distillation Point	°C	ASTM D2887*		342	---	---
Final Boiling Point	°C	ASTM D2887*	341	361	---	---






IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	37.7	34	---	---
Cetane Index		ASTM D4737*	<40.0	47	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	0	---	---
Sodium	ppm	ASTM D5185(m)	<0.1	0	---	---
Potassium	ppm	ASTM D5185(m)	<0.1	<1	---	---
Water	%	ASTM D6304*	<0.05	0.011	---	---
ppm Water	ppm	ASTM D6304*	<500	115	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	3671	---	---
Particles >6µm		ASTM D7647	>640	1059	---	---
Particles >14µm		ASTM D7647	>80	74	---	---
Particles >21µm		ASTM D7647	>20	14	---	---
Particles >38µm		ASTM D7647	>4	1	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	19/17/13	---	---






FUEL REPORT

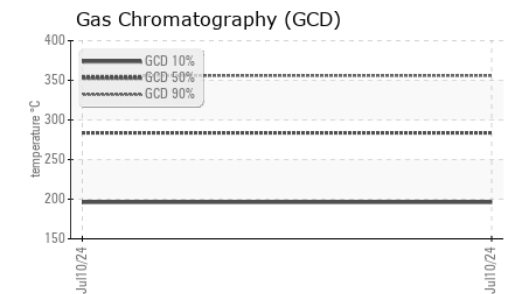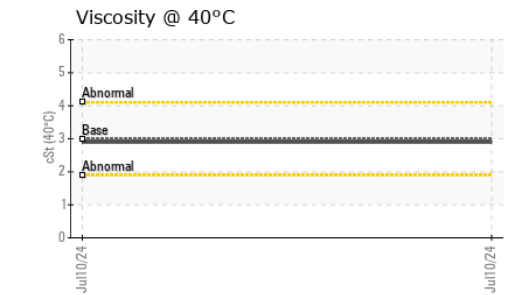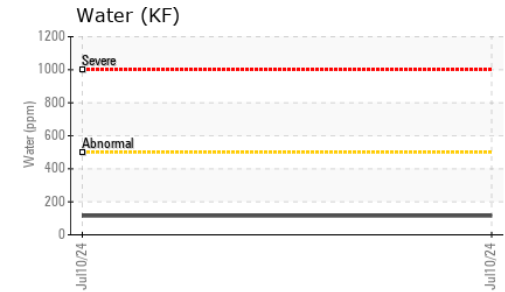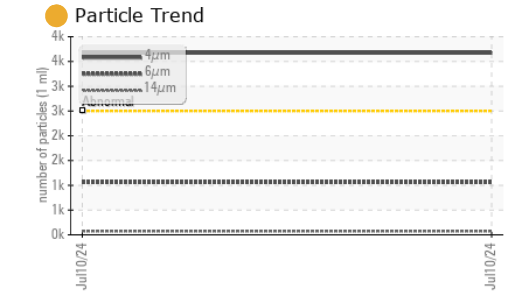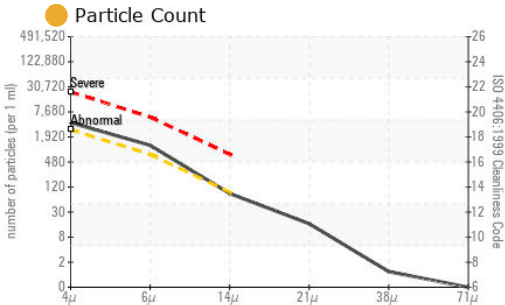

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---
Iron	ppm	ASTM D5185(m)	<0.1	0	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

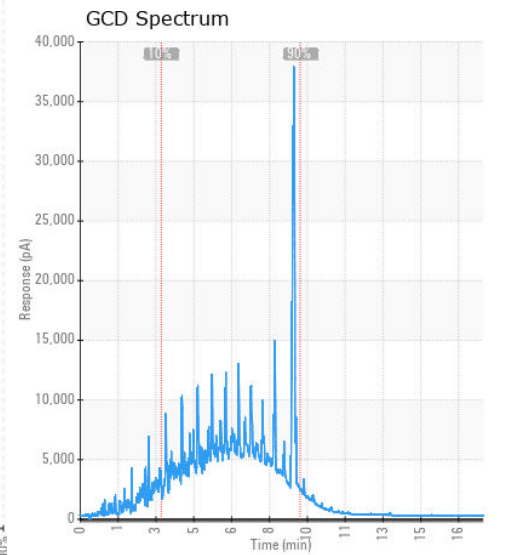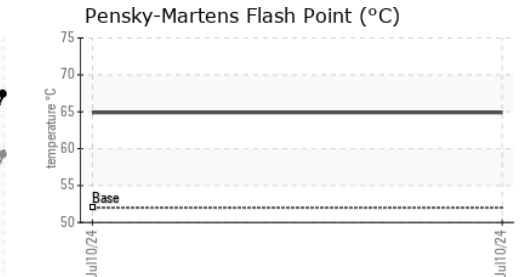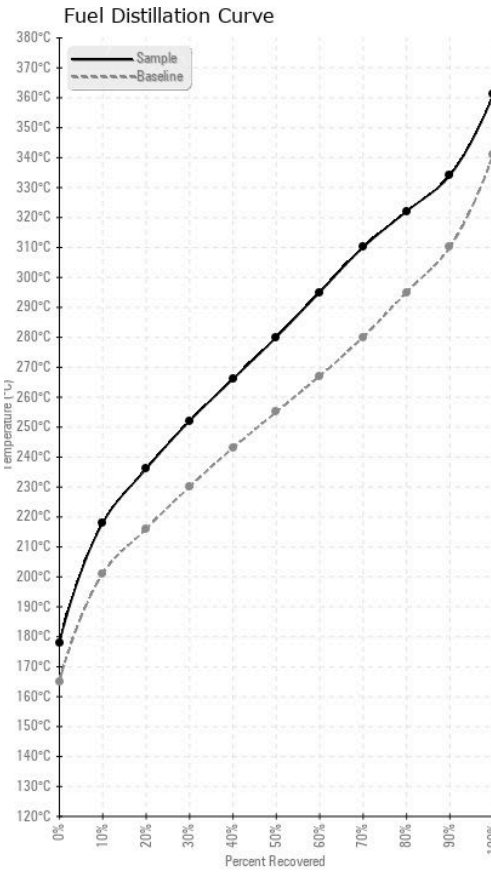

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP
Lab Number : 02647455
Unique Number : 5813007
Test Package : FUEL (Additional Tests: CC Flash, PrtCount)

Received : 11 Jul 2024
Tested : 15 Jul 2024
Diagnosed : 15 Jul 2024 - Kevin Marson

Brandt Tractor Ltd.
 7 Cochren Drive
 Ayr, ON
 CA N0B 1E0

Contact: Aaron Dellanno
 adellanno@brandt.ca
 T: (519)622-7799

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.