




OIL ANALYSIS REPORT

Sample Rating Trend

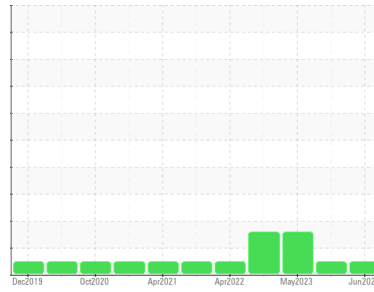

NORMAL



Area

Firewater

Machine Id

V411201A FWP PACKAGE A

Component

Diesel Engine

Fluid

MOBIL DELVAC MX EXTRA 0W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | PP14000179 | PP13932690 | PP13869146 |
| Sample Date | Client Info | | 16 Jun 2024 | 25 Nov 2023 | 30 May 2023 |
| Machine Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Changed | Client Info | | N/A | N/A | N/A |
| Sample Status | | | NORMAL | NORMAL | ABNORMAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel | WC Method | >5 | <1.0 | <1.0 | <1.0 |
| Water | WC Method | >0.2 | NEG | NEG | NEG |
| Glycol | WC Method | | NEG | NEG | NEG |

WEAR METALS

| | method | limit/base | current | history1 | history2 | |
|-----------|--------|---------------|---------|--------------|----------|----|
| Iron | ppm | ASTM D5185(m) | >100 | 4 | 3 | 5 |
| Chromium | ppm | ASTM D5185(m) | >20 | 0 | 0 | <1 |
| Nickel | ppm | ASTM D5185(m) | >4 | <1 | <1 | <1 |
| Titanium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) | >3 | 0 | <1 | <1 |
| Aluminum | ppm | ASTM D5185(m) | >20 | 0 | 2 | 3 |
| Lead | ppm | ASTM D5185(m) | >40 | 0 | <1 | <1 |
| Copper | ppm | ASTM D5185(m) | >330 | 0 | 6 | 10 |
| Tin | ppm | ASTM D5185(m) | >15 | 0 | <1 | <1 |
| Antimony | ppm | ASTM D5185(m) | | <1 | 0 | 0 |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 | |
|------------|--------|---------------|---------|--------------|----------|------|
| Boron | ppm | ASTM D5185(m) | | 0 | 2 | 2 |
| Barium | ppm | ASTM D5185(m) | | 0 | <1 | 0 |
| Molybdenum | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185(m) | | 9 | 9 | 7 |
| Calcium | ppm | ASTM D5185(m) | | 2218 | 2142 | 2147 |
| Phosphorus | ppm | ASTM D5185(m) | | 925 | 908 | 958 |
| Zinc | ppm | ASTM D5185(m) | | <1 | 1072 | 1084 |
| Sulfur | ppm | ASTM D5185(m) | | 3156 | 3046 | 3025 |
| Lithium | ppm | ASTM D5185(m) | | 0 | <1 | <1 |

CONTAMINANTS




| | method | limit/base | current | history1 | history2 | |
|-----------|--------|---------------|---------|--------------|----------|------|
| Silicon | ppm | ASTM D5185(m) | >25 | 0 | 10 | ▲ 27 |
| Sodium | ppm | ASTM D5185(m) | | 0 | 2 | 2 |
| Potassium | ppm | ASTM D5185(m) | >20 | <1 | <1 | <1 |

INFRA-RED

| | method | limit/base | current | history1 | history2 | |
|-----------|---------|-------------|---------|-------------|----------|------|
| Soot % | % | ASTM D7844* | >3 | 0 | 0 | 0 |
| Nitration | Abs/cm | ASTM D7624* | >20 | 7.2 | 6.3 | 6.0 |
| Sulfation | Abs.1mm | ASTM D7415* | >30 | 16.3 | 16.3 | 16.5 |



OIL ANALYSIS REPORT


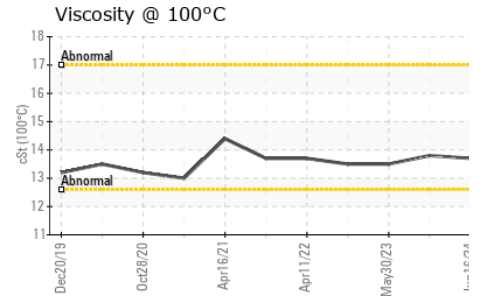
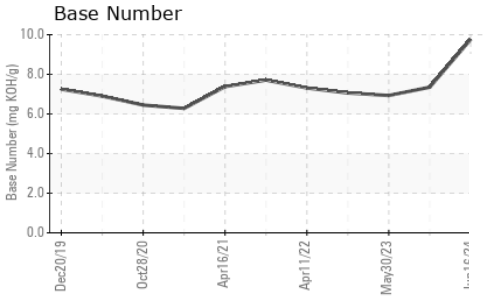
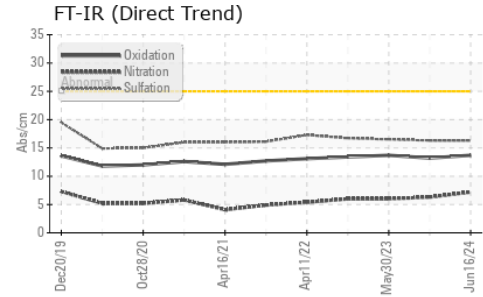


| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|-------------|------------|-------------|----------|----------|
| Oxidation | Abs./1mm | ASTM D7414* | >25 | 13.7 | 13.2 | 13.7 |
| Base Number (BN) | mg KOH/g | ASTM D2896* | | 9.76 | 7.35 | 6.93 |

| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|------------|----------|----------|
| Emulsified Water | scalar | Visual* | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |

| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
|------------------|-----|---------------|------------|-------------|----------|----------|
| Visc @ 100°C | cSt | ASTM D7279(m) | | 13.7 | 13.8 | 13.5 |

GRAPHS

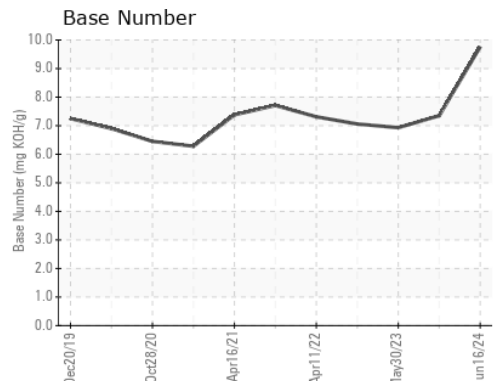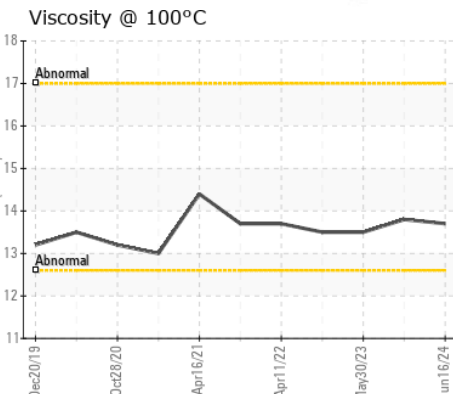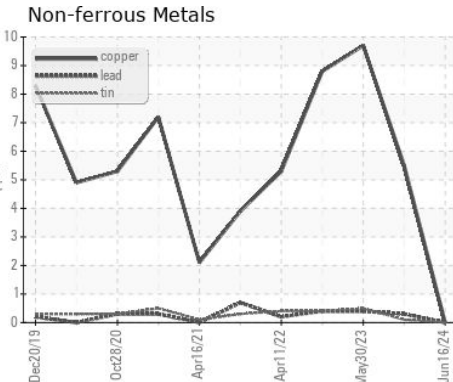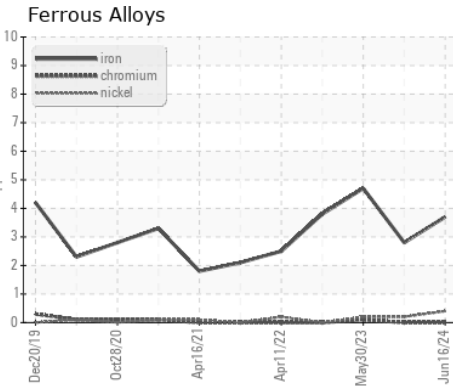

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP14000179
Lab Number : 02647731
Unique Number : 5813283
Test Package : MAR 2
Received : 15 Jul 2024
Tested : 15 Jul 2024
Diagnosed : 15 Jul 2024 - Wes Davis

ExxonMobil Canada East Ltd.
 Hebron-Materials and Repair Coordin, Suite 1000, 100 New Gow
 St. John`s, NL
 CA A1C 6K3
 Contact: Liam Maher
 liam.m.maher@exxonmobil.com
 T: (709)273-3729
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.