OIL ANALYSIS REPORT

Sample Rating Trend

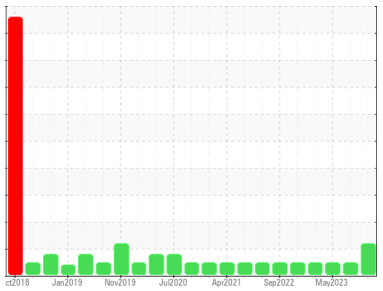

VISUAL METAL

Area
Power Generation
Machine Id
V837270 STANDBY POWER GENERATION 4160B PACKAGE
Component
Lube System
Fluid
MOBIL DTE OIL MEDIUM (113 LTR)

DIAGNOSIS

Recommendation
We advise that you check for visible metal particles in the oil. We recommend an early resample to monitor this condition.

Wear
Light concentration of visible metal present.

Contamination
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. NOTE: An increase in the particle count is noted.

Fluid Condition
The AN level is acceptable for this fluid.

Particle Filter (Magn: 100 x)

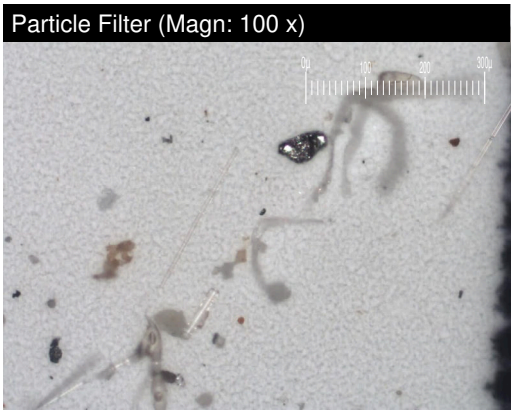

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**PP14001678**	PP13932690	PP13869146
Sample Date		Client Info		**08 Jun 2024**	25 Nov 2023	30 May 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**MARGINAL**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	**<1**	0	<1
Chromium	ppm	ASTM D5185(m)	>10	**0**	0	0
Nickel	ppm	ASTM D5185(m)	>10	**<1**	<1	<1
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**<1**	<1	<1
Aluminum	ppm	ASTM D5185(m)	>10	**<1**	0	<1
Lead	ppm	ASTM D5185(m)	>20	**<1**	1	1
Copper	ppm	ASTM D5185(m)	>20	**42**	43	37
Tin	ppm	ASTM D5185(m)	>10	**0**	<1	<1
Antimony	ppm	ASTM D5185(m)		**0**	0	0
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		**0**	<1	0
Barium	ppm	ASTM D5185(m)		**0**	0	0
Molybdenum	ppm	ASTM D5185(m)		**0**	0	0
Manganese	ppm	ASTM D5185(m)		**0**	0	0
Magnesium	ppm	ASTM D5185(m)		**<1**	0	0
Calcium	ppm	ASTM D5185(m)		**<1**	<1	1
Phosphorus	ppm	ASTM D5185(m)		**90**	91	95
Zinc	ppm	ASTM D5185(m)		**95**	99	98
Sulfur	ppm	ASTM D5185(m)		**1183**	1309	1137
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	**5**	6	5
Sodium	ppm	ASTM D5185(m)		**<1**	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	**<1**	0	<1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	**3198**	837	499
Particles >6µm		ASTM D7647	>1300	**816**	187	106
Particles >14µm		ASTM D7647	>160	**75**	9	9
Particles >21µm		ASTM D7647	>40	**32**	2	3
Particles >38µm		ASTM D7647	>10	**8**	0	0
Particles >71µm		ASTM D7647	>3	**1**	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	**19/17/13**	17/15/10	16/14/10

OIL ANALYSIS REPORT

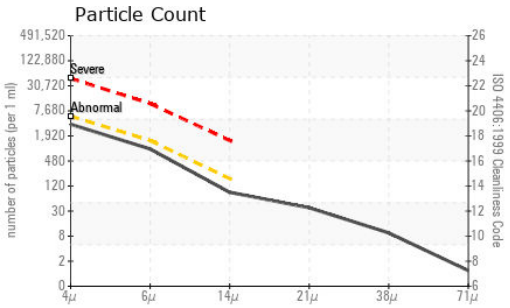

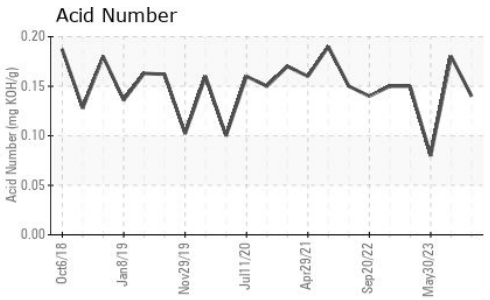

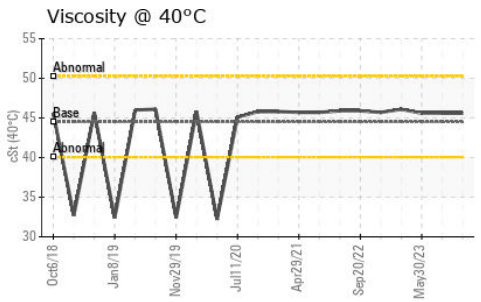

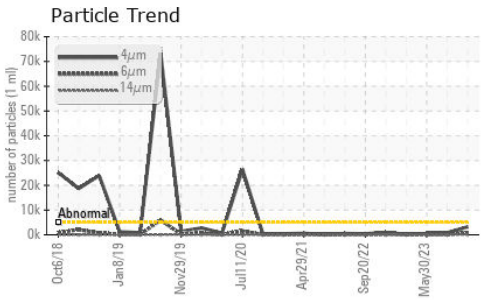

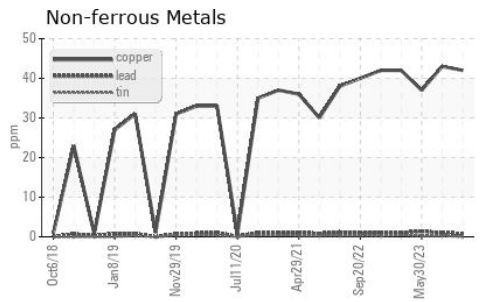

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		**0.14**	0.18	0.08

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	▲ **VLITE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	**NEG**	NEG	NEG
Free Water	scalar	Visual*		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	44.5	**45.6**	45.6	45.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			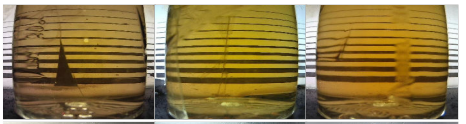		
Bottom					
PrtFilter				*no image*	*no image*

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP14001678
Lab Number : 02647839
Unique Number : 5813391
Test Package : MAR 2 (Additional Tests: Bottom, BottomAnalysis, FILTERPATCH, PrtFilter)

Received : 15 Jul 2024
Tested : 17 Jul 2024
Diagnosed : 17 Jul 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

ExxonMobil Canada East Ltd.
Hebron-Materials and Repair Coordin, Suite 1000, 100 New Gow
St. John`s, NL
CA A1C 6K3
Contact: Liam Maher
liam.m.maher@exxonmobil.com
T: (709)273-3729
F: