




# OIL ANALYSIS REPORT

Sample Rating Trend

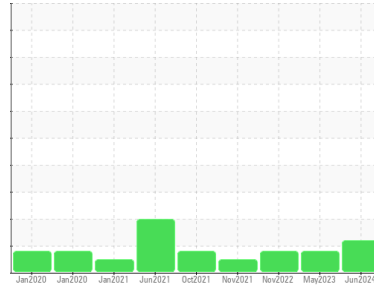

ISO



Area

Firewater

Machine Id

V411201D FWP PACKAGE D

Component

Hydraulic System

Fluid

MOBIL DTE 10 EXCEL 32 (--- LTR)

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PP14005838	PP13869146	PP13819709
Sample Date	Client Info		20 Jun 2024	30 May 2023	12 Nov 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ATTENTION

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	NEG	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>20	1	<1	<1
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)	>10	<1	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>10	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>20	0	<1	0
Copper	ppm	ASTM D5185(m)	>20	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>10	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		<1	1	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		<1	<1	<1
Calcium	ppm	ASTM D5185(m)	120	96	92	100
Phosphorus	ppm	ASTM D5185(m)	475	472	499	518
Zinc	ppm	ASTM D5185(m)		31	27	29
Sulfur	ppm	ASTM D5185(m)	1275	1274	1233	1313
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>15	1	2	2
Sodium	ppm	ASTM D5185(m)		2	2	2
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1


## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 23596	▲ 10503	● 5055
Particles >6µm	ASTM D7647	>1300	● 1879	925	690
Particles >14µm	ASTM D7647	>160	33	15	51
Particles >21µm	ASTM D7647	>40	10	3	15
Particles >38µm	ASTM D7647	>10	2	0	2
Particles >71µm	ASTM D7647	>3	1	0	1
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 22/18/12	▲ 21/17/11	● 20/17/13




# OIL ANALYSIS REPORT


### Particle Trend

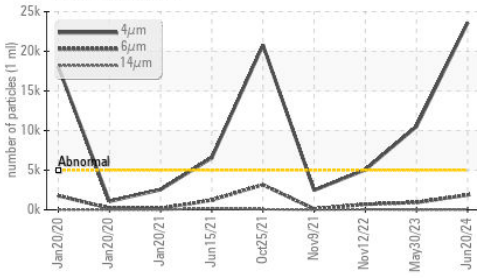


### Particle Trend

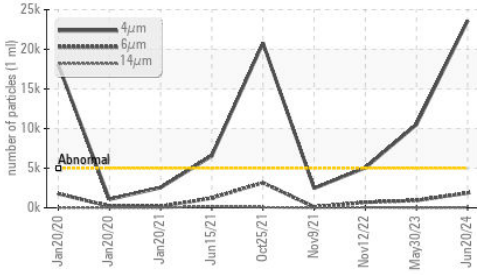

### Acid Number

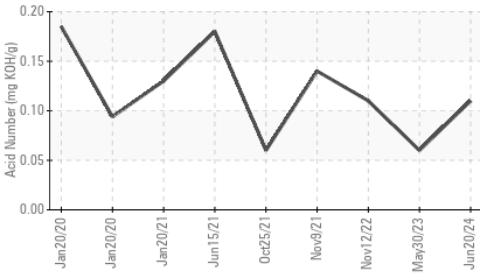

### Viscosity @ 40°C

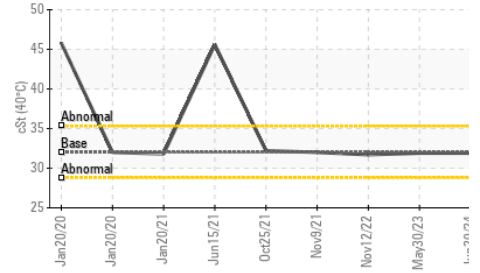

### FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D974*	<b>0.11</b>	0.06	0.11


### VISUAL

method	limit/base	current	history1	history2
White Metal	Visual*	NONE	NONE	NONE
Yellow Metal	Visual*	NONE	NONE	NONE
Precipitate	Visual*	NONE	NONE	NONE
Silt	Visual*	NONE	NONE	NONE
Debris	Visual*	NONE	NONE	NONE
Sand/Dirt	Visual*	NONE	NONE	NONE
Appearance	Visual*	NORML	NORML	NORML
Odor	Visual*	NORML	NORML	NORML
Emulsified Water	Visual*	>0.05	NEG	NEG
Free Water	Visual*	NEG	NEG	NEG

### FLUID PROPERTIES


method	limit/base	current	history1	history2
Visc @ 40°C cSt	ASTM D7279(m)	<b>31.9</b>	31.9	31.7

### SAMPLE IMAGES

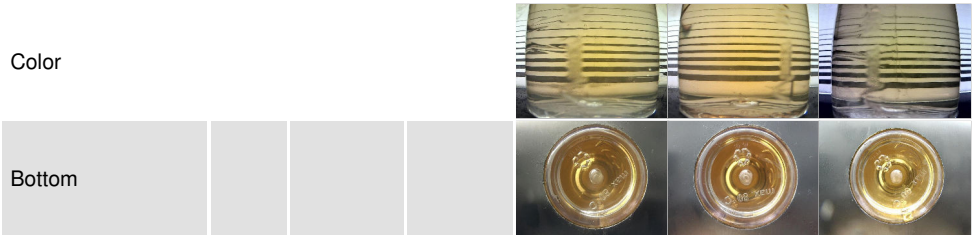


### GRAPHS


#### Ferrous Alloys

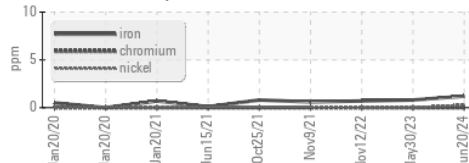


#### Non-ferrous Metals

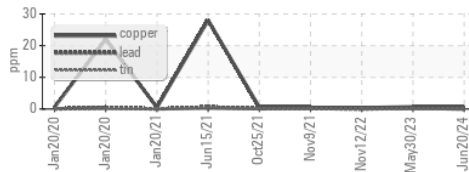


#### Viscosity @ 40°C

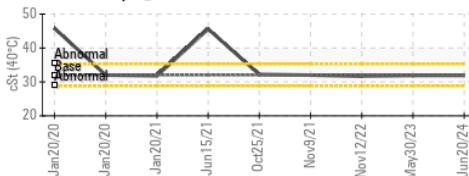

#### Particle Count

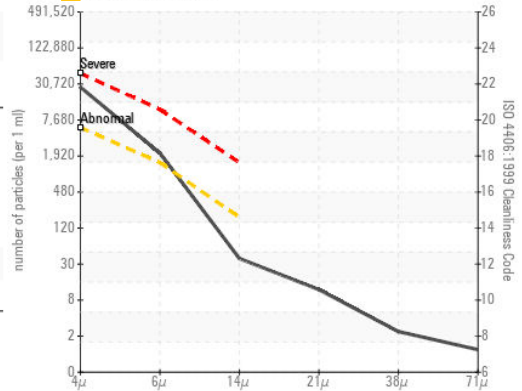

#### Acid Number

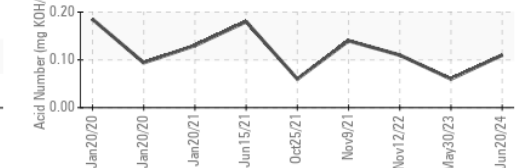

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PP14005838  
**Lab Number** : 02647847  
**Unique Number** : 5813399  
**Test Package** : MAR 2 ( Additional Tests: Bottom, TAN Man )

**ExxonMobil Canada East Ltd.**  
 Hebron-Materials and Repair Coordin, Suite 1000, 100 New Gow  
 St. John's, NL  
 CA A1C 6K3  
 Contact: Liam Maher  
 liam.m.maher@exxonmobil.com  
 T: (709)273-3729  
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.