




OIL ANALYSIS REPORT

Sample Rating Trend

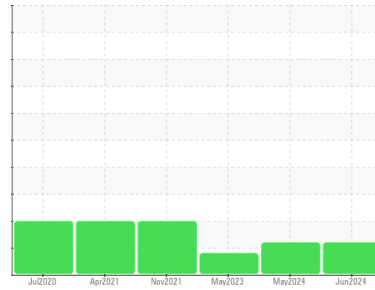

ISO



Area

A22

Machine Id

SPG-4160A RESERVOIR (S/N CAHE-V837240)

Component

Hydraulic System

Fluid

MOBIL DTE 10 EXCEL 32 (113 LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PP14005838	PP13994698	PP13869146
Sample Date	Client Info	20 Jun 2024	12 May 2024	30 May 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ATTENTION

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m) >20	1	1	<1
Chromium	ppm	ASTM D5185(m) >10	0	0	0
Nickel	ppm	ASTM D5185(m) >10	<1	0	0
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	<1
Aluminum	ppm	ASTM D5185(m) >10	2	2	<1
Lead	ppm	ASTM D5185(m) >20	0	0	2
Copper	ppm	ASTM D5185(m) >20	1	1	38
Tin	ppm	ASTM D5185(m) >10	0	0	<1
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	<1	<1	0
Barium	ppm	ASTM D5185(m)	1	1	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	<1	<1	0
Calcium	ppm	ASTM D5185(m) 120	94	93	1
Phosphorus	ppm	ASTM D5185(m) 475	477	482	99
Zinc	ppm	ASTM D5185(m)	27	27	95
Sulfur	ppm	ASTM D5185(m) 1275	1294	1247	1142
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >15	<1	<1	4
Sodium	ppm	ASTM D5185(m)	2	2	<1
Potassium	ppm	ASTM D5185(m) >20	<1	<1	<1


FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	▲ 26238	▲ 20127	980
Particles >6µm	ASTM D7647	>1300	● 1398	● 1362	260
Particles >14µm	ASTM D7647	>160	39	42	27
Particles >21µm	ASTM D7647	>40	15	12	8
Particles >38µm	ASTM D7647	>10	2	2	1
Particles >71µm	ASTM D7647	>3	0	1	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 22/18/12	▲ 22/18/13	17/15/12




OIL ANALYSIS REPORT


Particle Trend

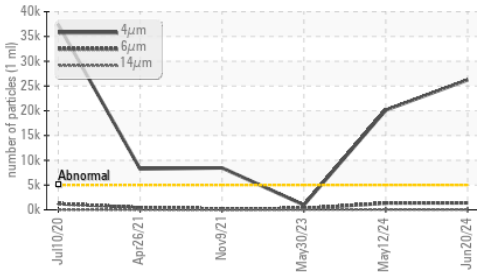


Particle Trend

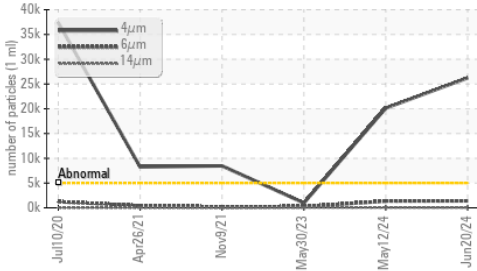

Acid Number

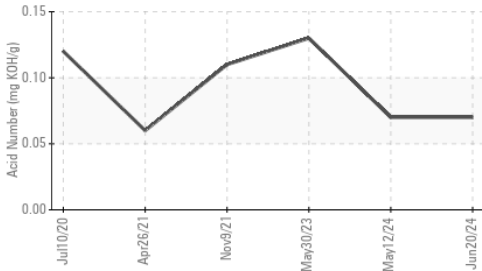

Viscosity @ 40°C

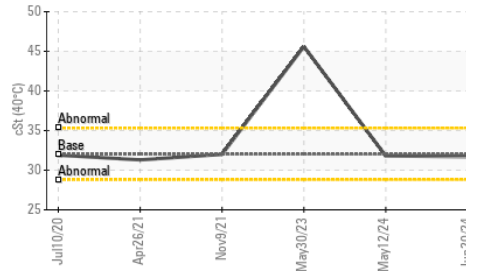

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D974*	0.07	0.07	0.13


VISUAL

method	limit/base	current	history1	history2	
White Metal	scalar Visual*	NONE	VLITE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.05	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES


method	limit/base	current	history1	history2
Visc @ 40°C cSt	ASTM D7279(m)	32	31.8	45.6

SAMPLE IMAGES

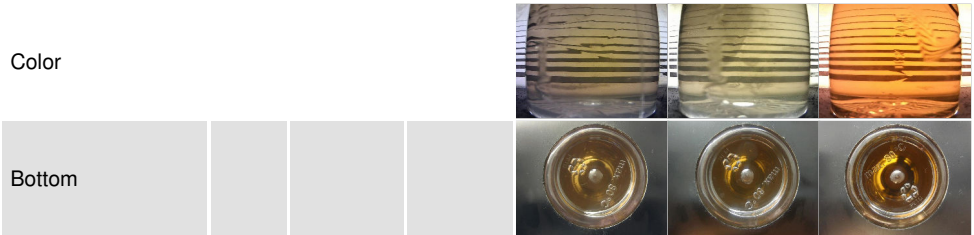


GRAPHS


Ferrous Alloys

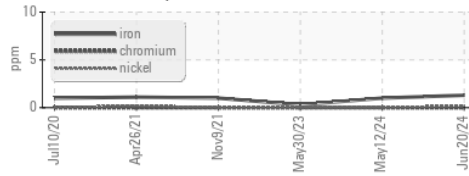


Non-ferrous Metals

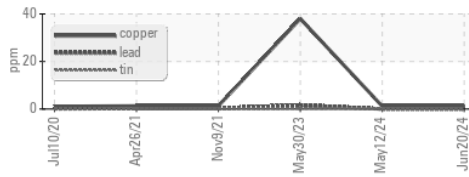


Viscosity @ 40°C

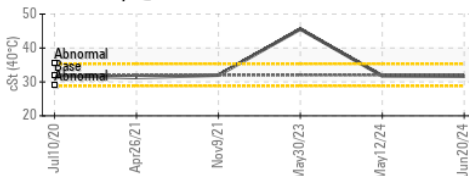

Particle Count

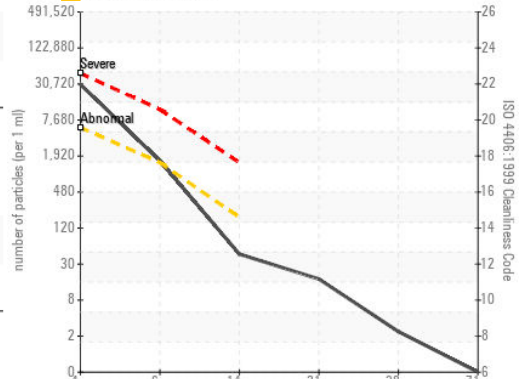

Acid Number

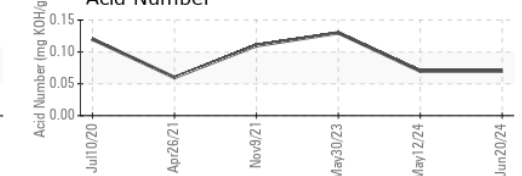

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP14005838 **Received** : 15 Jul 2024
Lab Number : **02647855** **Tested** : 16 Jul 2024
Unique Number : 5813407 **Diagnosed** : 16 Jul 2024 - Kevin Marson
Test Package : MAR 2 (Additional Tests: Bottom)

ExxonMobil Canada East Ltd.
 Hebron-Materials and Repair Coordin, Suite 1000, 100 New Gow
 St. John's, NL
 CA A1C 6K3
 Contact: Liam Maher
 liam.m.maher@exxonmobil.com
 T: (709)273-3729
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.