




# OIL ANALYSIS REPORT

Sample Rating Trend

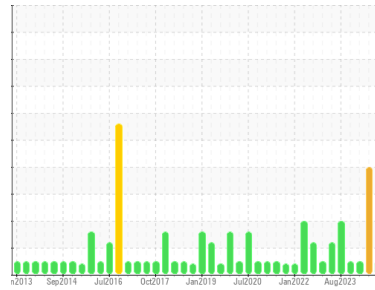

**NORMAL**



Area

## System 43 - Water Injection

Machine Id

## Z-4305A Pump / Motor Lubricating Oil

Component

Pump

Fluid

IRVING HYDRAULIC OIL LP 32 (1950 LTR)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0936441</b>	WC0783214	WC0873622
Sample Date	Client Info		<b>24 Jun 2024</b>	04 Apr 2024	13 Dec 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	SEVERE	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>75	<b>0</b>	0	0
Chromium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>5	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185(m)	>15	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)		<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	0
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>1</b>	2	2
Calcium	ppm	ASTM D5185(m)		<b>50</b>	50	51
Phosphorus	ppm	ASTM D5185(m)		<b>331</b>	336	341
Zinc	ppm	ASTM D5185(m)	400	<b>404</b>	419	413
Sulfur	ppm	ASTM D5185(m)		<b>1322</b>	1388	1503
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

### CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Sodium	ppm	ASTM D5185(m)		<b>3</b>	3	2
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	3
Water	%	ASTM D6304*	>.1	<b>0.003</b>	0.003	0.003
ppm Water	ppm	ASTM D6304*	>1000	<b>34</b>	29	33

### FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>966</b>	▲ 18483	3172
Particles >6µm	ASTM D7647	>1300	<b>180</b>	▲ 6495	944
Particles >14µm	ASTM D7647	>160	<b>17</b>	▲ 763	57
Particles >21µm	ASTM D7647	>40	<b>7</b>	▲ 339	12
Particles >38µm	ASTM D7647	>10	<b>1</b>	▲ 75	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	5	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>17/15/11</b>	▲ 21/20/17	19/17/13



# OIL ANALYSIS REPORT

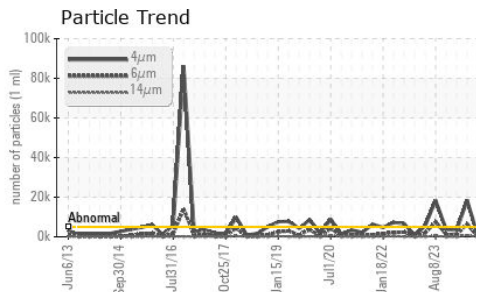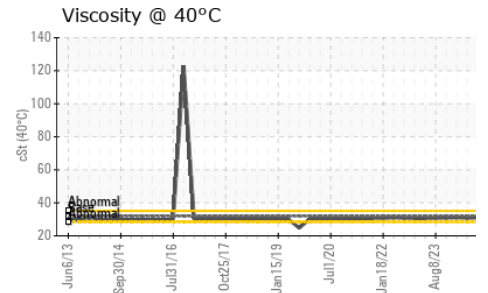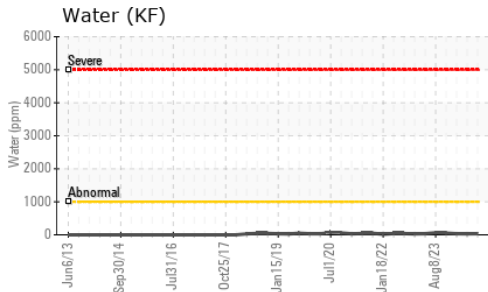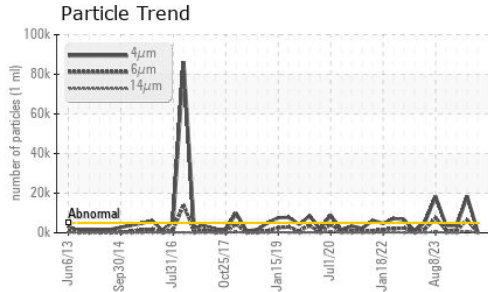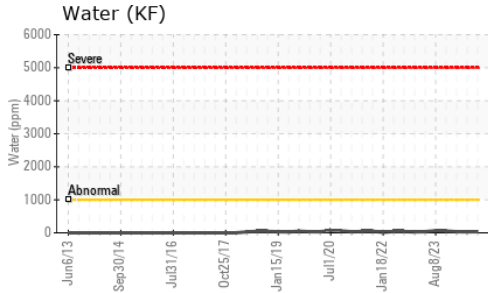


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		<b>0.34</b>	0.35	0.38






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	VLITE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	31.9	<b>30.9</b>	30.7	31.0

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

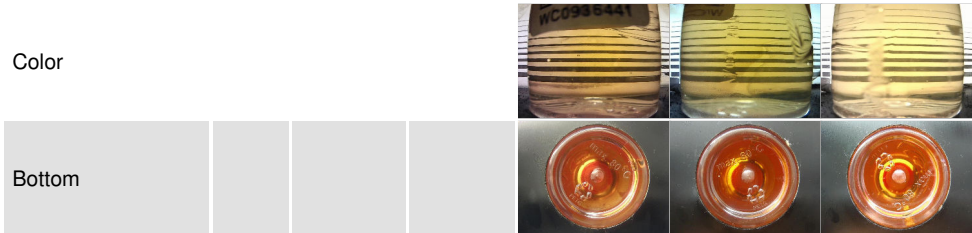

## GRAPHS

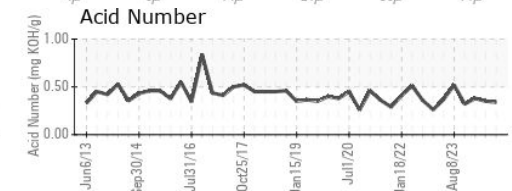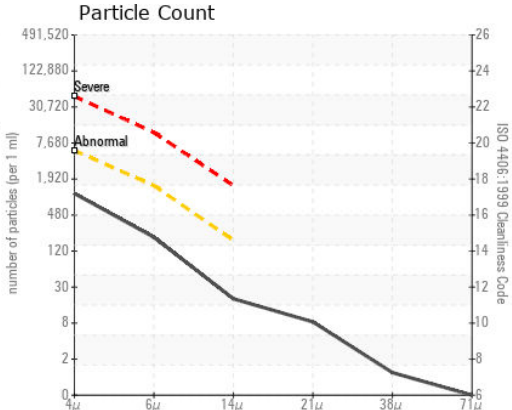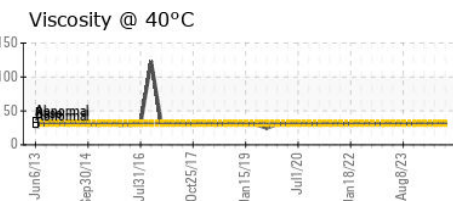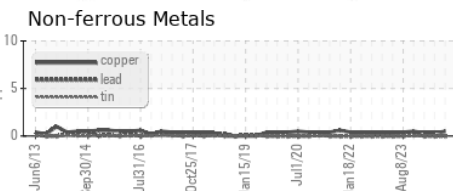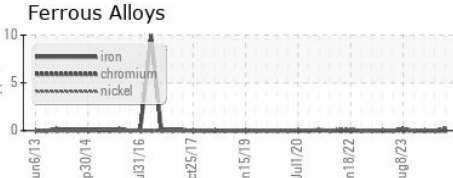

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0936441  
**Lab Number** : 02647861  
**Unique Number** : 5813413  
**Test Package** : MAR 2 ( Additional Tests: KF )  
**Received** : 15 Jul 2024  
**Tested** : 16 Jul 2024  
**Diagnosed** : 16 Jul 2024 - Wes Davis

**HIBERNIA MGMT & DEVELOPMENT CO. LTD**  
 SUITE 1000,, 100 NEW GOWER STREET  
 ST.JOHN'S, NL  
 CA A1C 6K3  
 Contact: Sam Nash  
 samantha.m.nash@exxonmobil.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.