

No relevant graphs to display

RECOMMENDATION	PROBLEMATIC TEST RESULTS							
We recommend that you drain the oil from the	Sample Status	Sample Status		NORMAL	NORMAL			
component if this has not already been done. We	Ferrous Sliding	Scale 0-10 ASTM D7684*	1					

component if this has not already been done. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS							
Sample Status			SEVERE	NORMAL	NORMAL		
Ferrous Sliding	Scale 0-10	ASTM D7684*	<mark>▲</mark> 1				
Ferrous Cutting	Scale 0-10	ASTM D7684*	A 1				

Customer Id: TRADIE Sample No.: WC0815291 Lab Number: 02648103 Test Package: AVI 3



To manage this report scan the QR code

To discuss the diagnosis or test data: Kevin Marson +1 (289)291-4644 x4644 Kevin.Marson@wearcheck.com

To change component or sample information: Gloria Gonzalez +1 (289)291-4643 x4643 gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Fluid			?	We recommend that you drain the oil from the component if this has not already been done.		
Resample			?	We recommend an early resample to monitor this condition.		

HISTORICAL DIAGNOSIS



29 May 2024 Diag: Kevin Marson

Resample at the next service interval to monitor. All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system. The water content is negligible. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

22 Apr 2024 Diag: Kevin Marson

NORMAL

Resample at the next service interval to monitor. All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system. The water content is negligible. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



10 Mar 2024 Diag: Kevin Marson

Resample at the next service interval to monitor.All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system. The water content is negligible. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





Report Id: TRADIE [WCAMIS] 02648103 (Generated: 07/18/2024 13:13:24) Rev: 1



OIL ANALYSIS REPORT

(C-GSUR) [C-GSUR] DEHAVILLAND DASH8-102 PCE-120217

Right Jet Turbine

EASTMAN TURBO OIL 2380 (21 LTR)

DIAGNOSIS

Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

🔺 Wear


Wear particle analysis indicates that the ferrous cutting particles are severe. Wear particle analysis indicates that the ferrous sliding particles are abnormal. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces.

Contaminants

The water content is negligible. There is no indication of any contamination in the oil.

Oil Condition


The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

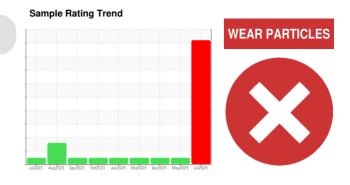



SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0815291	WC0815297	WC0815300
Sample Date		Client Info		05 Jul 2024	29 May 2024	22 Apr 2024
TSN	hrs	Client Info		29800	29706	29606
TSO	hrs	Client Info		7608	7514	7415
Oil Age	hrs	Client Info		7608	7514	7415
Oil Changed		Client Info		Not Changd	N/A	Not Changd
Sample Status				SEVERE	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>8	<1	0	0
Chromium	ppm	ASTM D5185(m)	>2	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	<1	0	0
Titanium	ppm	ASTM D5185(m)	>2	0	0	0
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>2	0	0	0
Lead	ppm	ASTM D5185(m)	>3	0	0	0
Copper	ppm	ASTM D5185(m)	>3	<1	0	0
Tin	ppm	ASTM D5185(m)	>2	0	0	0
Antimony	ppm	ASTM D5185(m)		<1	<1	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	4	<1	<1
Barium	ppm	ASTM D5185(m)	0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	<1	<1
Calcium	ppm	ASTM D5185(m)	0	<1	0	0
Phosphorus	ppm	ASTM D5185(m)	2500	2481	2496	2584
Zinc	ppm	ASTM D5185(m)	0	<1	<1	<1
Sulfur	ppm	ASTM D5185(m)	0	4	5	0
Lithium	ppm	ASTM D5185(m)		<1	<1	<1
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>8	0	0	0
Sodium	ppm	ASTM D5185(m)		<1	0	0
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Water	%	ASTM D6304*	>0.08	0.080	0.047	0.017
ppm Water	ppm	ASTM D6304*	>800	808	471	171
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.43	0.21	0.23	0.24




OIL ANALYSIS REPORT










E A

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.08	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	24.2	23.9	24.2	24.3
Visc @ 100°C	cSt	ASTM D7279(m)	4.97	5.0	5.0	5.0
Viscosity Index (VI)	Scale	ASTM D2270*	134	140	136	135
SAMPLE IMAGES	6	method	limit/base	current	history1	history2
Color						

Bottom

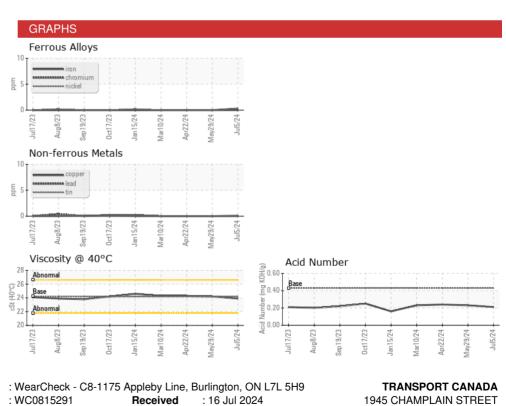

: 18 Jul 2024

: 18 Jul 2024 - Kevin Marson

1945 CHAMPLAIN STREET DIEPPE, NB CA E1A 7P5 Contact: Marc Justin Leblanc marcjustin.leblanc@tc.gc.ca T: (506)851-6945 F: (506)851-2996

Laboratory : WearChee Sample No. : WC08152 Laboratory Unique Number : 5813655 Test Package : AVI 3 To discuss this sample report, contact Cus

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

Tested

Diagnosed

Report Id: TRADIE [WCAMIS] 02648103 (Generated: 07/18/2024 13:13:24) Rev: 1


Contact/Location: Marc Justin Leblanc - TRADIE

FERROGRAPHY REPORT

Area (C-GSUR) [C-GSUR] DEHAVILLAND DASH8-102 PCE-120217

Right Jet Turbine


EASTMAN TURBO OIL 2380 (21 LTR)



Magn: 50x Illum: RW




Magn: 100x Illum: RW



DR-FERROGRAP	ΉY	method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		2.3	1.9	1.0
Small Particles		DR-Ferr*		1.7	2.1	1.2
Total Particles		DR-Ferr*	>	4	4	2.2
Large Particles Percentage	%	DR-Ferr*		15	0	0
Severity Index		DR-Ferr*		1	0	0
FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		3	1	1
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*		A 1		
Ferrous Rolling	Scale 0-10	ASTM D7684*		1	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		1		
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1		
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1	1	1

WEAR

Wear particle analysis indicates that the ferrous cutting particles are severe. Wear particle analysis indicates that the ferrous sliding particles are abnormal. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces.



This page left intentionally blank