




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

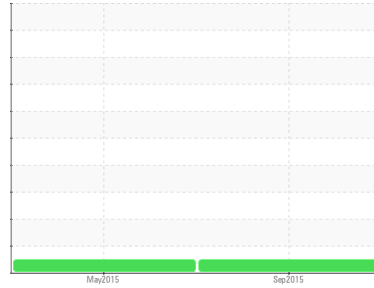

Machine Id
KAESER C-1R (S/N 1022)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system is acceptable. There is no indication of any contamination in the component.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history 1	history 2
Sample Number	Client Info			WCI2214382	WCI2258496	---
Sample Date	Client Info			29 Sep 2015	28 May 2015	---
Machine Age	hrs	Client Info		13629	10821	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				NORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<1	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	<1	---
Titanium	ppm	ASTM D5185m	>3	0	<1	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	0	<1	---
Lead	ppm	ASTM D5185m	>10	0	2	---
Copper	ppm	ASTM D5185m	>50	3	<1	---
Tin	ppm	ASTM D5185m	>10	0	<1	---
Antimony	ppm	ASTM D5185m		0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	<1	---

ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	90	4	0	---
Calcium	ppm	ASTM D5185m	2	0	0	---
Phosphorus	ppm	ASTM D5185m		0	3	---
Zinc	ppm	ASTM D5185m		169	2	---
Sulfur	ppm	ASTM D5185m		17303	0	---





CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	2	<1	---
Sodium	ppm	ASTM D5185m		3	<1	---
Potassium	ppm	ASTM D5185m	>20	3	0	---

FLUID CLEANLINESS		method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		358	89	---
Particles >6µm		ASTM D7647	>1300	195	48	---
Particles >14µm		ASTM D7647	>80	33	8	---
Particles >21µm		ASTM D7647	>20	11	2	---
Particles >38µm		ASTM D7647	>4	1	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	16/15/12	14/13/10	---

FLUID DEGRADATION		method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.405	0.538	---



OIL ANALYSIS REPORT


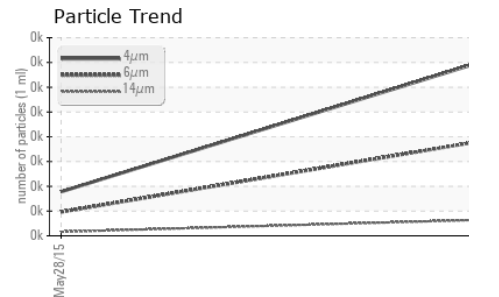
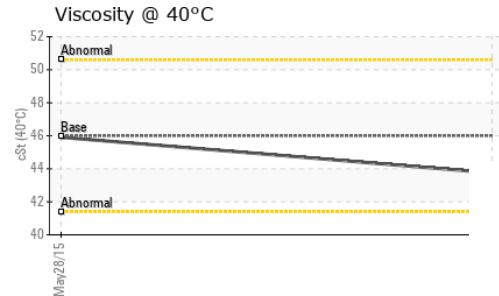
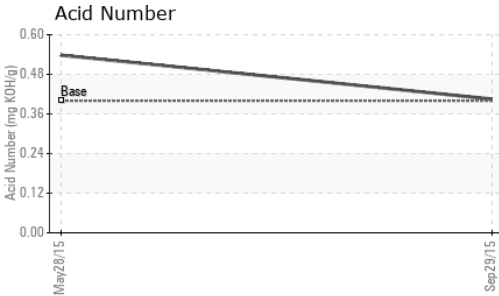
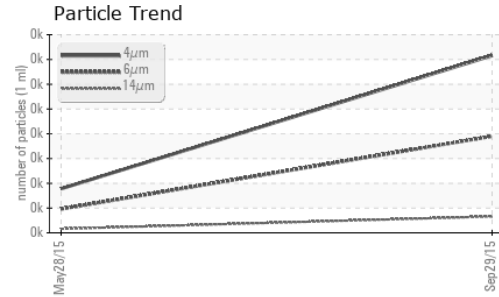


VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	46	43.75	45.91

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
Color				no image	no image
Bottom				no image	no image

GRAPHS

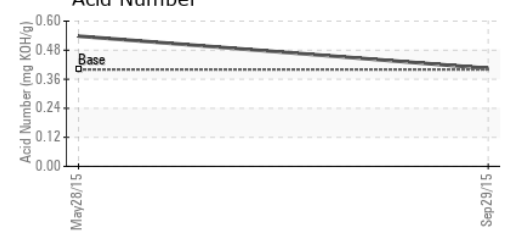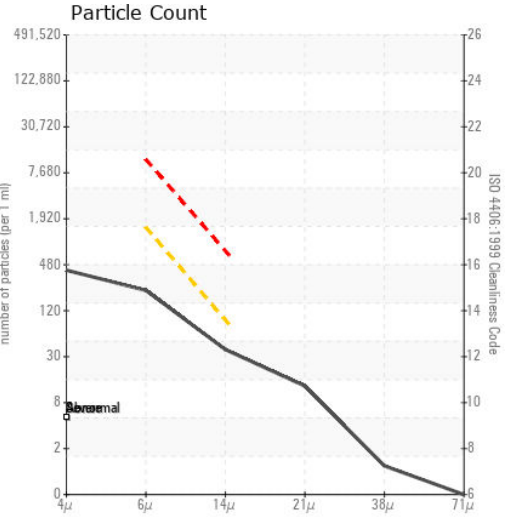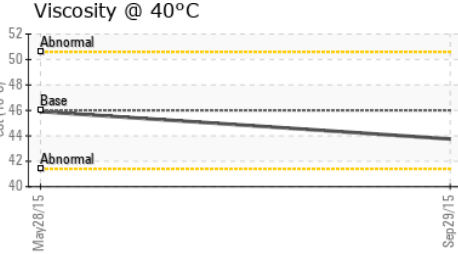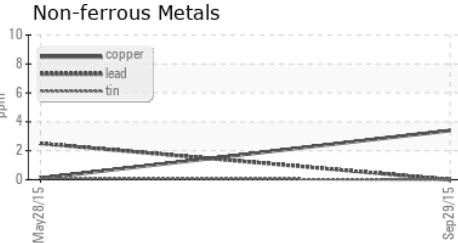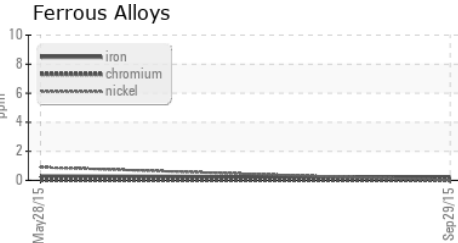

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC12214382 **Received** : 06 Nov 2015
Lab Number : 03859148 **Diagnosed** : 10 Nov 2015
Unique Number : 7199383 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

WESTLAKE CHEMICAL
 2290 CALLAHAN RD
 LONGVIEW, TX
 US 75607
 Contact: ROB WALLIN
 rwallin@westlake.com
 T: (903)242-7576
 F: (903)758-9521