


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

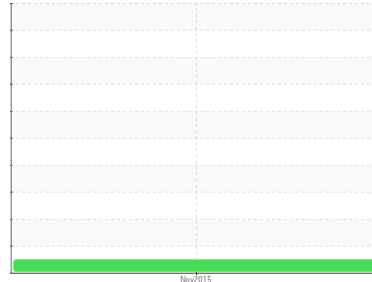

Machine Id
NOT GIVEN MHI007423 (S/N UNKNOWN - NO INFO ON BOTTLE)

Component
Wind Turbine Gearbox

Fluid
MOBIL MOBILGEAR SHC XMP 320 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			MHI007423	---	---
Sample Date	Client Info			23 Nov 2015	---	---
Machine Age	hrs	Client Info		47697	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				NORMAL	---	---






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184	>200	18.0	---	---
Iron	ppm	ASTM D5185m	>200	7	---	---
Chromium	ppm	ASTM D5185m		<1	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m		<1	---	---
Lead	ppm	ASTM D5185m		2	---	---
Copper	ppm	ASTM D5185m	>75	14	---	---
Tin	ppm	ASTM D5185m		<1	---	---
Antimony	ppm	ASTM D5185m		0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m	0	0	---	---
Phosphorus	ppm	ASTM D5185m	485	249	---	---
Zinc	ppm	ASTM D5185m	0	12	---	---
Sulfur	ppm	ASTM D5185m		3013	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	<1	---	---
Sodium	ppm	ASTM D5185m	>15	<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304	>0.1	0.002	---	---
ppm Water	ppm	ASTM D6304	>1000	20	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		602	---	---
Particles >6µm		ASTM D7647	>5000	328	---	---
Particles >14µm		ASTM D7647	>640	55	---	---
Particles >21µm		ASTM D7647	>160	18	---	---
Particles >38µm		ASTM D7647	>40	2	---	---
Particles >71µm		ASTM D7647	>10	0	---	---
Oil Cleanliness		ISO 4406 (c)	>--/19/16	16/16/13	---	---

OIL ANALYSIS REPORT

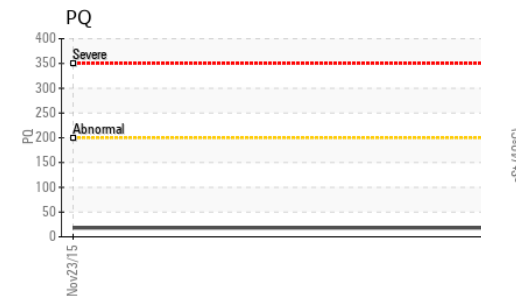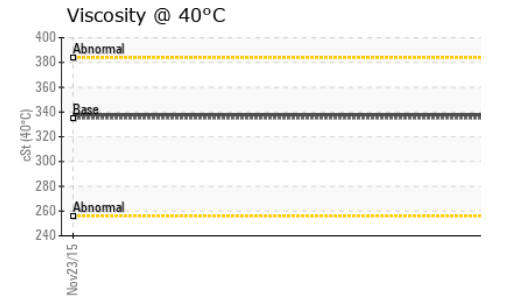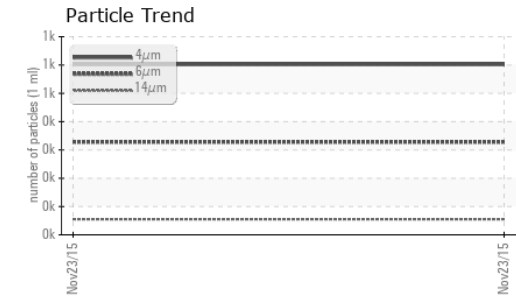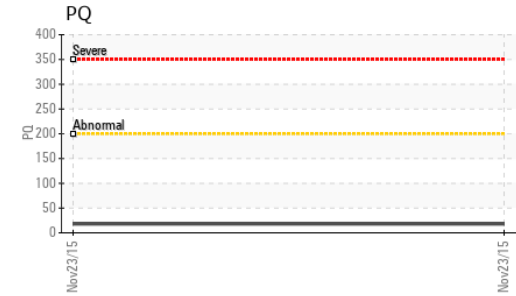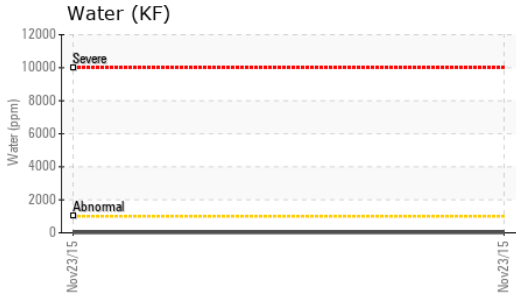

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	1.14	---	---






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	337.8	---	---

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

GRAPHS

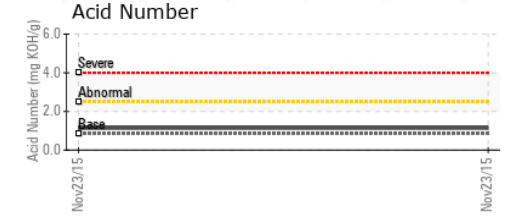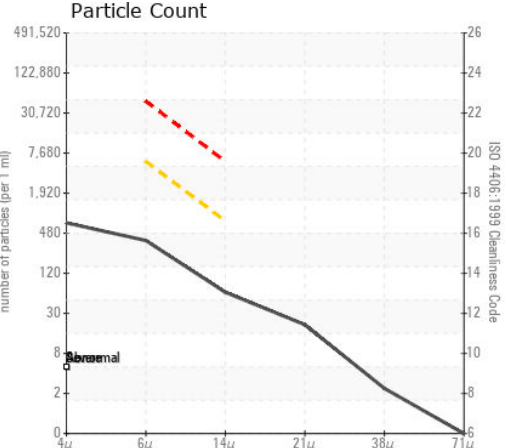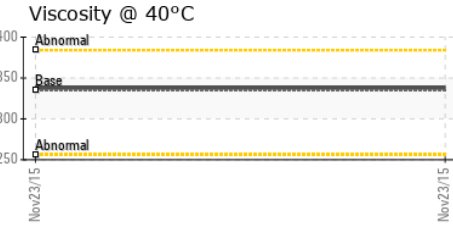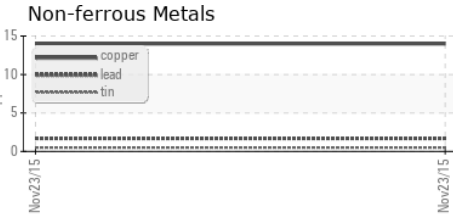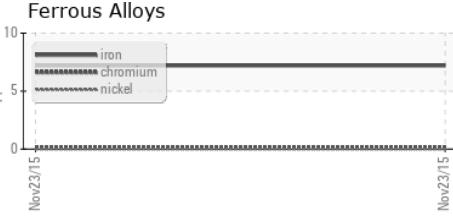

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MH1007423 **Received** : 07 Jan 2016
Lab Number : 03896667 **Diagnosed** : 08 Jan 2016
Unique Number : 7256958 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

DIAMOND WTG - DILLON
P.O. BOX 880
DESERT HOT SPRINGS, CA
US 92240
Contact: DANIEL BOYD
daniel.boyd@diamondwtg.com
T: (760)329-7171
F: (760)329-7122

To discuss this sample report, contact Customer Service at 1-800-237-1369.
* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)