


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

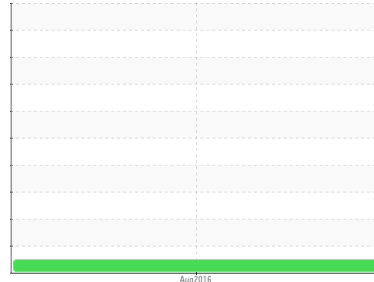

Area
OKLAHOMA CITY DIVISION - TO2 [GE SPS DIVISION]
Machine Id
LUBSOIL SYN 2068 FLUID ISO 68 - THRUST CHAMBER OIL
Component
New (Unused) Oil
Fluid
{not provided} (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		TO2006720	---	---
Sample Date	Client Info		23 Aug 2016	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >10	<1	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m >2	<1	---	---
Titanium	ppm	ASTM D5185m >2	0	---	---
Silver	ppm	ASTM D5185m >2	<1	---	---
Aluminum	ppm	ASTM D5185m >10	<1	---	---
Lead	ppm	ASTM D5185m >10	0	---	---
Copper	ppm	ASTM D5185m >50	0	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Antimony	ppm	ASTM D5185m	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<1	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	0	---	---
Calcium	ppm	ASTM D5185m	0	---	---
Phosphorus	ppm	ASTM D5185m	161	---	---
Zinc	ppm	ASTM D5185m	<1	---	---
Sulfur	ppm	ASTM D5185m	1364	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	0	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	0	---	---
Water	%	ASTM D6304	0.004	---	---
ppm Water	ppm	ASTM D6304	40	---	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	875	---	---
Particles >6µm	ASTM D7647	>1300	477	---	---
Particles >14µm	ASTM D7647	>160	81	---	---
Particles >21µm	ASTM D7647	>40	27	---	---
Particles >38µm	ASTM D7647	>10	4	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	17/16/14	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.356	---	---

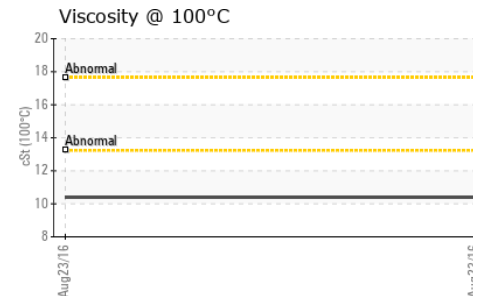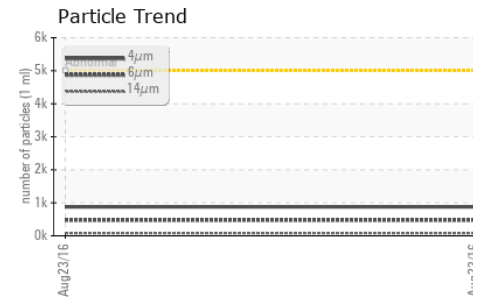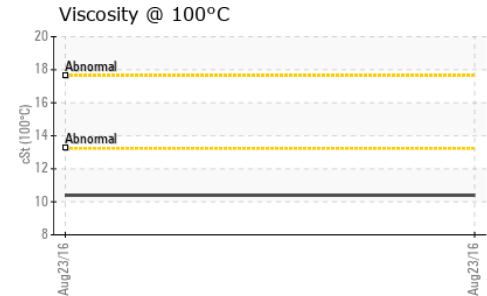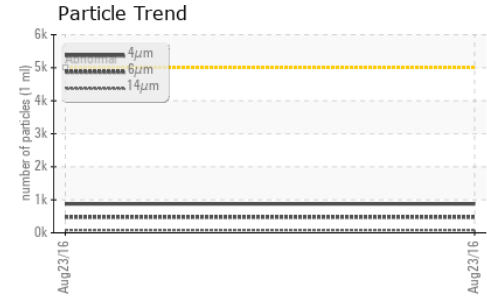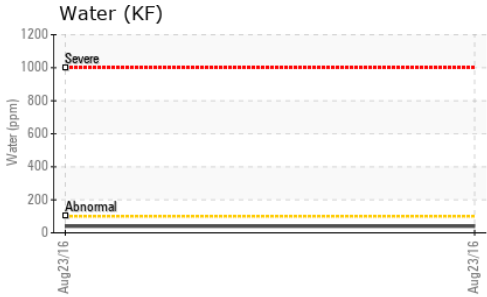

OIL ANALYSIS REPORT








VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual		NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.64	---	---
Visc @ 100°C	cSt	ASTM D445	10.4	---	---
Viscosity Index (VI)	Scale	ASTM D2270	146	---	---

SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

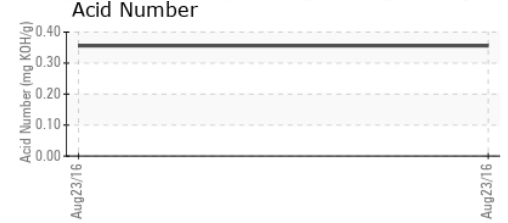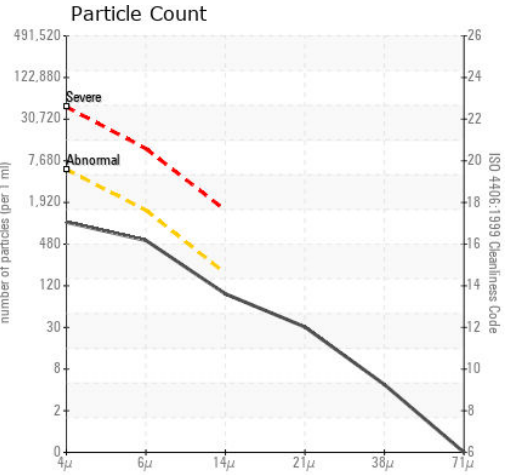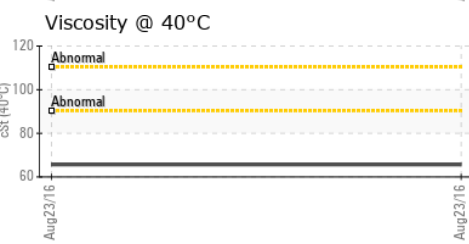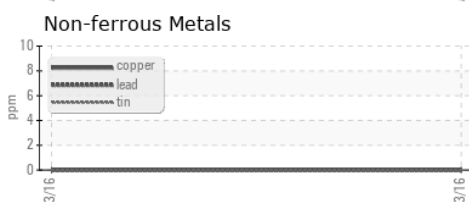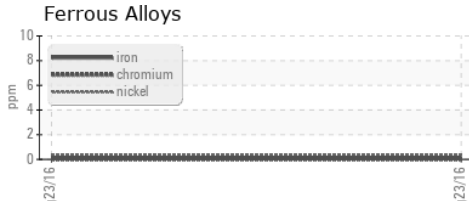

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO2006720 **Received** : 30 Aug 2016
Lab Number : 04055760 **Tested** : 01 Sep 2016
Unique Number : 7516323 **Diagnosed** : 01 Sep 2016 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

TULCO OILS INC CORPORATE - BASELINE SAMPLES
 5240 EAST PINE
 TULSA, OK
 US 74115
 Contact: DARRYL THOMPSON

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: