

# **OIL ANALYSIS REPORT**

Sample Rating Trend **NORMAL** 

# Machine Id KAESER BSD 50 5667465 (S/N 1569)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system is acceptable. There is no indication of any contamination in the component.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Oct2016	<del></del>	
SAMPLE INFORM	MATION	method				history2
Sample Number		Client Info		KC52794		
Sample Date		Client Info		14 Oct 2016		
Machine Age	hrs	Client Info		3214		
Oil Age	hrs	Client Info		3214		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	5		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m		16		
Tin	ppm	ASTM D5185m	>10	<1		
Antimony	ppm	ASTM D5185m	710	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	6		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	45		
Zinc	ppm	ASTM D5185m	0	31		
CONTAMINANTS		method	limit/base	current	history1	history2
					History	HISTOLYZ
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m	00	6		
Potassium	ppm	ASTM D5185m	>20	6		
Water	%	ASTM D6304	>0.05	0.013		
ppm Water	ppm	ASTM D6304	>500	130		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		410		
Particles >6µm		ASTM D7647		223		
Particles >14μm		ASTM D7647	>80	38		
Particles >21μm		ASTM D7647	>20	12		
Particles >38μm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>17/13	15/12		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.327



## **OIL ANALYSIS REPORT**

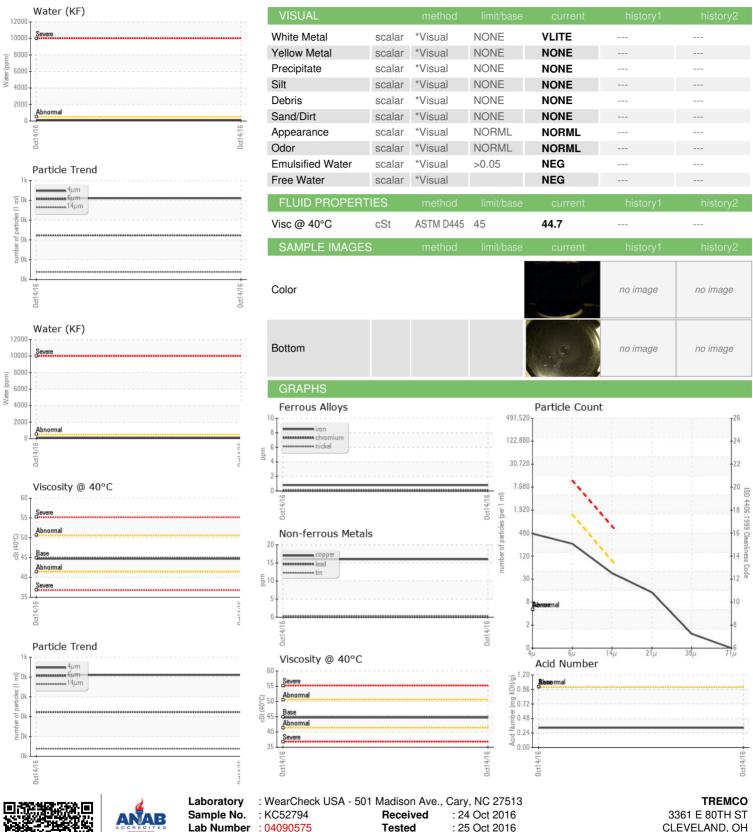



Certificate L2367

Lab Number

Test Package : IND 2

: 04090575 Unique Number : 7576227

**Tested** 

Diagnosed : 25 Oct 2016 - Don Baldridge CLEVELAND, OH US 44127

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: