



OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area

[71699956]

Machine Id

KAESER AC SK15 5255707 (S/N 1714)

Component

Compressor

Fluid

KAESER SIGMA (OEM) FG-460 (--- GAL)



DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCP59439	---	---
Sample Date	Client Info	17 Oct 2016	---	---
Machine Age	hrs	Client Info	12601	---
Oil Age	hrs	Client Info	3805	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ATTENTION	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	4	---
Chromium	ppm	ASTM D5185m >10	0	---
Nickel	ppm	ASTM D5185m >3	0	---
Titanium	ppm	ASTM D5185m >3	0	---
Silver	ppm	ASTM D5185m >2	0	---
Aluminum	ppm	ASTM D5185m >10	4	---
Lead	ppm	ASTM D5185m >10	<1	---
Copper	ppm	ASTM D5185m >50	6	---
Tin	ppm	ASTM D5185m >10	0	---
Antimony	ppm	ASTM D5185m	0	---
Vanadium	ppm	ASTM D5185m	0	---
Cadmium	ppm	ASTM D5185m	0	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---
Barium	ppm	ASTM D5185m	0	---
Molybdenum	ppm	ASTM D5185m	0	---
Manganese	ppm	ASTM D5185m	0	---
Magnesium	ppm	ASTM D5185m	<1	---
Calcium	ppm	ASTM D5185m	<1	---
Phosphorus	ppm	ASTM D5185m 500	246	---
Zinc	ppm	ASTM D5185m	255	---
Sulfur	ppm	ASTM D5185m	1166	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	---
Sodium	ppm	ASTM D5185m	<1	---
Potassium	ppm	ASTM D5185m >20	7	---
Water	%	ASTM D6304 >0.05	0.003	---
ppm Water	ppm	ASTM D6304 >500	30	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	910	---	---
Particles >6µm	ASTM D7647 >1300	495	---	---
Particles >14µm	ASTM D7647 >80	84	---	---
Particles >21µm	ASTM D7647 >20	28	---	---
Particles >38µm	ASTM D7647 >4	4	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	16/14	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	0.605	---

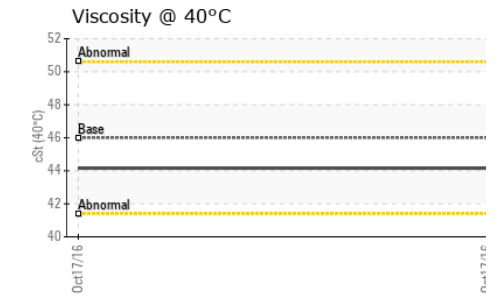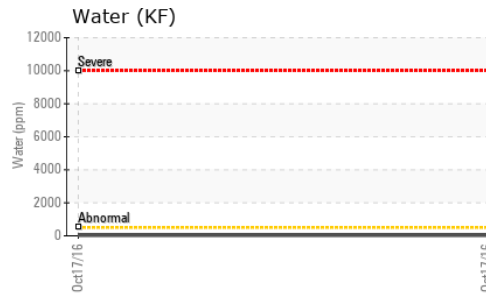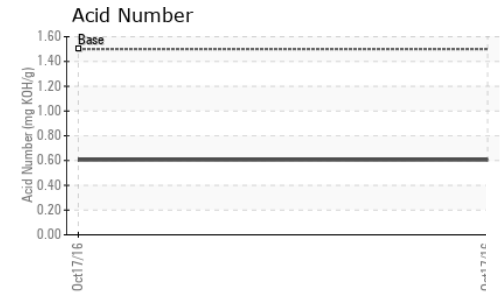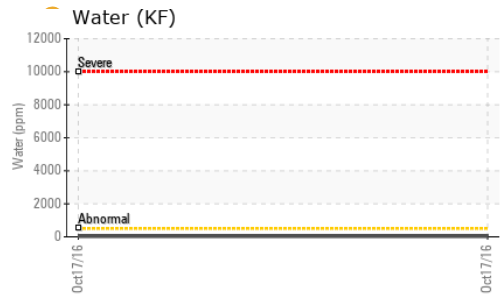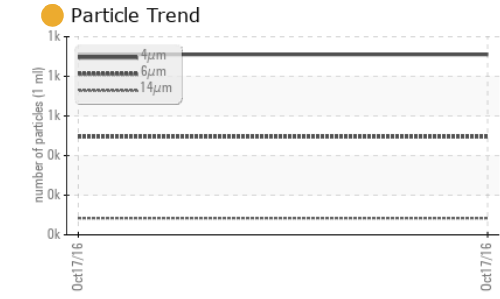

OIL ANALYSIS REPORT








VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.16	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

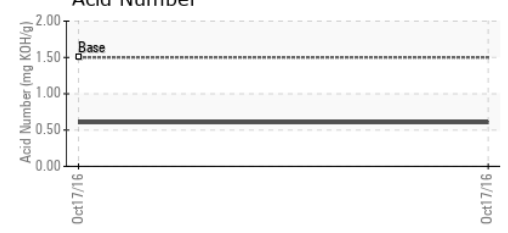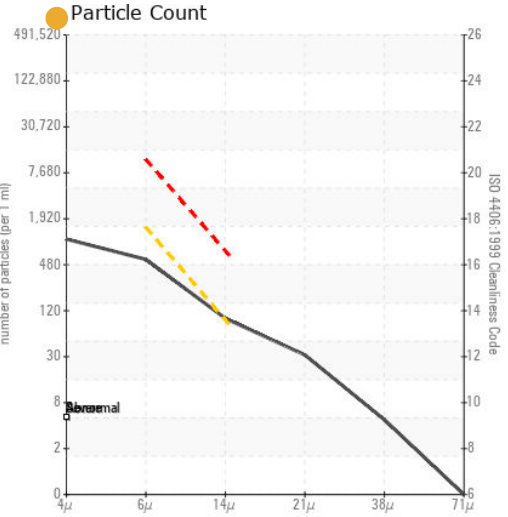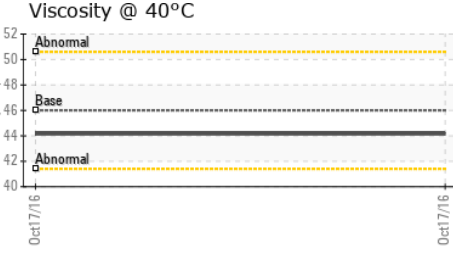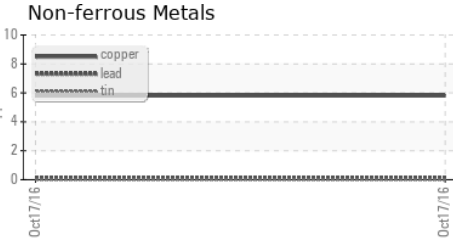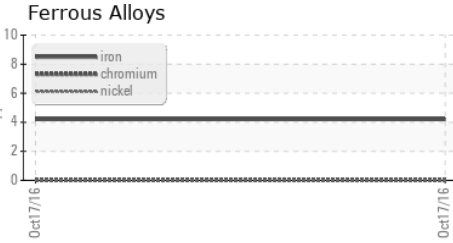

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP59439 **Received** : 02 Nov 2016
Lab Number : **04097116** **Tested** : 04 Nov 2016
Unique Number : 7582768 **Diagnosed** : 04 Nov 2016 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

DONSUEMOR INC
 2080 N LOOP RD
 ALAMEDA, CA
 US 94502
 Contact: J. KIRCHER
 jkircher@donsuemor.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)