



OIL ANALYSIS REPORT

Sample Rating Trend



ADDITIVES



Machine Id
KAESER SFC 18ST 5333860 (S/N 1013)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

▲ Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC52542	---	---
Sample Date	Client Info		28 Mar 2017	---	---
Machine Age	hrs	Client Info	603	---	---
Oil Age	hrs	Client Info	603	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	2	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m >3	0	---	---
Titanium	ppm	ASTM D5185m >3	0	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >10	0	---	---
Lead	ppm	ASTM D5185m >10	2	---	---
Copper	ppm	ASTM D5185m >50	<1	---	---
Tin	ppm	ASTM D5185m >10	<1	---	---
Antimony	ppm	ASTM D5185m	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---






ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<1	---	---
Barium	ppm	ASTM D5185m 90	51	---	---
Molybdenum	ppm	ASTM D5185m 0	0	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m 100	▲ 72	---	---
Calcium	ppm	ASTM D5185m 0	2	---	---
Phosphorus	ppm	ASTM D5185m 0	<1	---	---
Zinc	ppm	ASTM D5185m 0	6	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	---	---
Sodium	ppm	ASTM D5185m	15	---	---
Potassium	ppm	ASTM D5185m >20	1	---	---
Water	%	ASTM D6304 >0.05	0.029	---	---
ppm Water	ppm	ASTM D6304 >500	290	---	---

OIL ANALYSIS REPORT

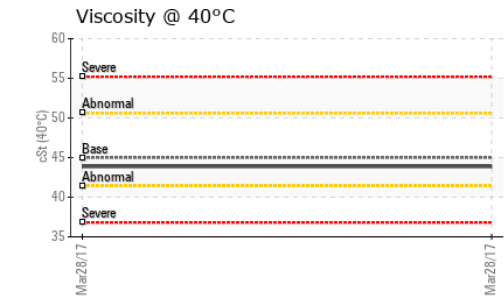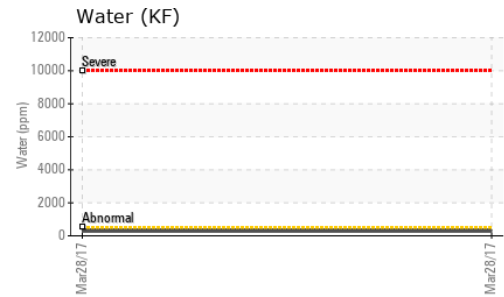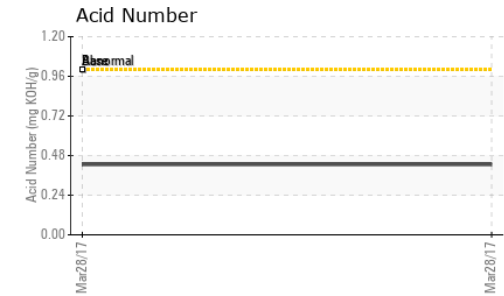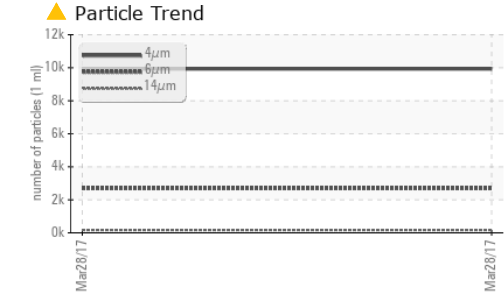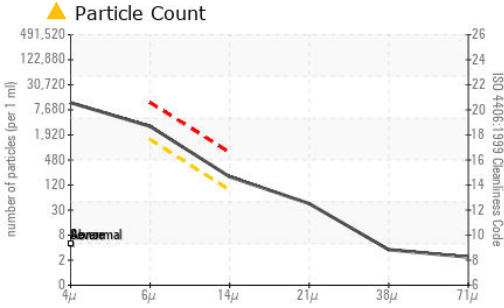

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC52542 **Received** : 10 Apr 2017
Lab Number : **04198714** **Tested** : 11 Apr 2017
Unique Number : 7757135 **Diagnosed** : 11 Apr 2017 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCountNAS)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ALRO STEEL
 4787 STATE RD
 CUYAHOGA FALLS, OH
 US 44223
 Contact:

T:
F:

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		9927	---	---
Particles >6µm	ASTM D7647	>1300	▲ 2691	---	---
Particles >14µm	ASTM D7647	>80	▲ 167	---	---
Particles >21µm	ASTM D7647	>20	▲ 38	---	---
Particles >38µm	ASTM D7647	>4	3	---	---
Particles >71µm	ASTM D7647	>3	2	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/15	---	---
Particles 5-15µm	count *NAS 1638	>1300	248207	---	---
Particles 15-25µm	count *NAS 1638	>80	12416	---	---
Particles 25-50µm	count *NAS 1638	>20	3340	---	---
Particles 50-100µm	count *NAS 1638	>4	62	---	---
Particles >100µm	count *NAS 1638	>3	194	---	---
NAS Code	*NAS 1638	>--/17/13	10	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	1.0	0.426	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	VLITE	---	---
Yellow Metal	scalar *Visual	NONE	NONE	---	---
Precipitate	scalar *Visual	NONE	NONE	---	---
Silt	scalar *Visual	NONE	NONE	---	---
Debris	scalar *Visual	NONE	NONE	---	---
Sand/Dirt	scalar *Visual	NONE	NONE	---	---
Appearance	scalar *Visual	NORML	NORML	---	---
Odor	scalar *Visual	NORML	NORML	---	---
Emulsified Water	scalar *Visual	>0.05	NEG	---	---
Free Water	scalar *Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	45	43.87	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image