

OIL ANALYSIS REPORT

Area [129128] 98194H

Component Compressor

VAC DEL ML20 (--- GAL)

Sample Rating Trend



SAMPLE INFORMATION method WCI2327654 Sample Number Client Info Recommendation Resample at the next service interval to monitor. Sample Date Client Info 10 Aug 2017 ---43606 Machine Age hrs Client Info All component wear rates are normal. Oil Age hrs Client Info 1411 Oil Changed Client Info **Not Changd** Contamination There is no indication of any contamination in the component. **Fluid Condition** The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


Sample Status		Oliciit iiilo		NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	60		
Tin	ppm	ASTM D5185m	>15	0		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		40		
Phosphorus	ppm	ASTM D5185m		324		
Zinc	ppm	ASTM D5185m		306		
Sulfur	ppm	ASTM D5185m		490		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4		
Cadium	10 10 100	ACTM DE10Em		10		

Silicon	ppm	ASTM D5185m	>25	4		
Sodium	ppm	ASTM D5185m		12		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2

Acid Number (AN) mg KOH/g ASTM D8045 0.358



OIL ANALYSIS REPORT

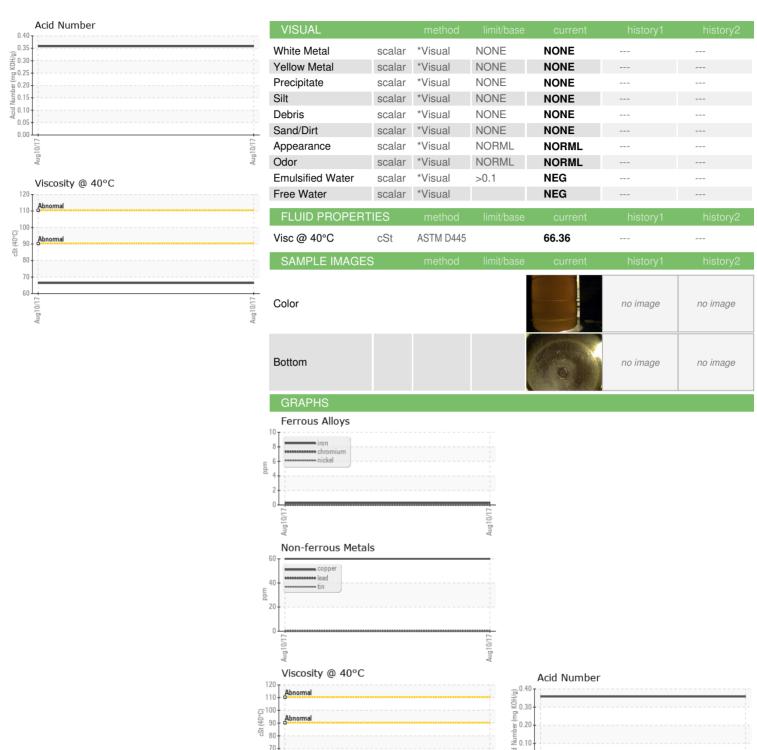





Laboratory Sample No. Lab Number Unique Number

: 7898933

60

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WCI2327654 : 04285453

Received Diagnosed

: 16 Aug 2017 : 18 Aug 2017 : Don Baldridge

Diagnostician

Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) **PRINSCO - FARGO**

4141 37TH ST N FARGO, ND US 58102

Contact: DAVID JENSEN davidj@prinsco.com

Contact/Location: DAVID JENSEN - PRIFAR

T: (701)293-2071 F: (701)293-2052