

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



GOULD PUMP 895-P001A

Component

Rear Bearing

ROYAL PURPLE SYNFILM 68 (4 LTR)

DIAGN	10 - 10
DIAGIN	

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2017		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP180555		
Sample Date		Client Info		23 Aug 2017		
Machine Age	hrs	Client Info		1749		
Oil Age	hrs	Client Info		1549		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<1		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	<1		
Lead	ppm	ASTM D5185m	>20	<1		
Copper	ppm	ASTM D5185m	>20	34		
Tin	ppm	ASTM D5185m	>20	6		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	87		
Calcium	ppm	ASTM D5185m		7		
Phosphorus	ppm	ASTM D5185m		8		
Zinc	ppm	ASTM D5185m		6		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.1	0.022		
ppm Water	ppm	ASTM D6304	>1000	220		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


0.339

Acid Number (AN)

mg KOH/g ASTM D8045 0.25



OIL ANALYSIS REPORT

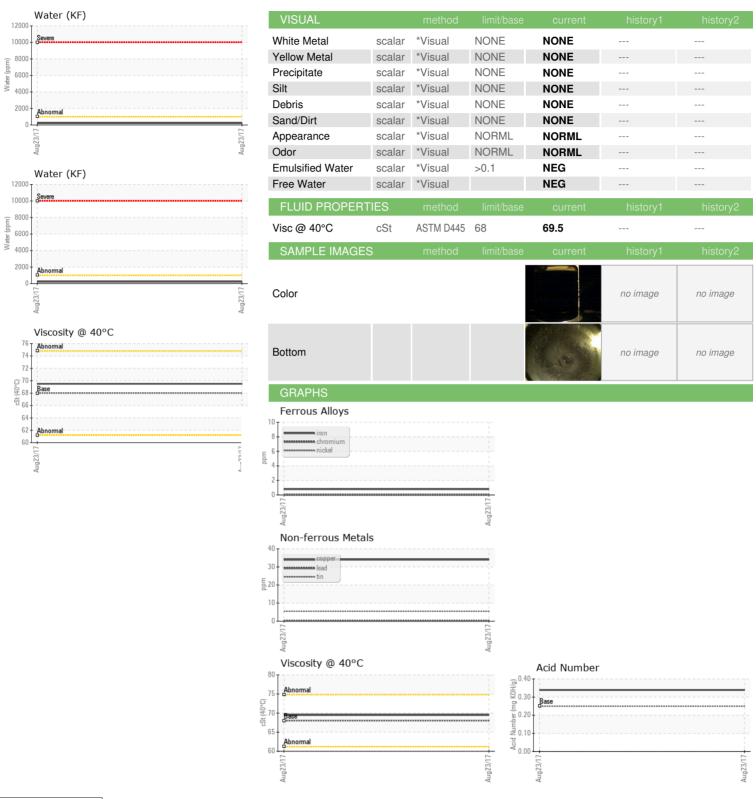





Certificate L2367

Laboratory Sample No. Lab Number

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : RP180555

: 04299483 Unique Number: 7923021

Received **Tested**

Test Package : IND 2

: 08 Sep 2017 : 11 Sep 2017 - Don Baldridge Diagnosed

: 07 Sep 2017

ACUEDUCTO LA ESPERANZA RDP CALCETA-MANTA-MANABI

ODEBRECHT, EC

Contact: CLEVER ALVES

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: