




# PROBLEM SUMMARY

## Sample Rating Trend

ISO




Area  
**[9381690]**  
 Machine Id  
**KAESER C-6F (S/N 752706)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

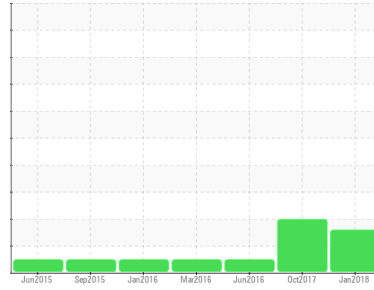

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

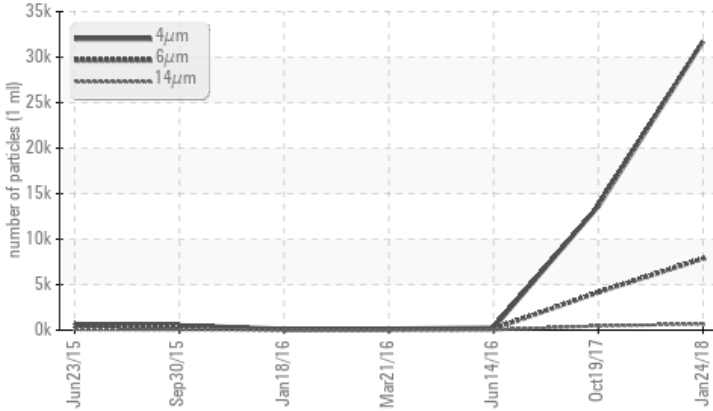

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ <b>7867</b>	▲ 4151	139
Particles >14µm	ASTM D7647	>80	▲ <b>675</b>	▲ 462	23
Particles >21µm	ASTM D7647	>20	▲ <b>225</b>	▲ 154	8
Particles >38µm	ASTM D7647	>4	▲ <b>22</b>	▲ 21	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>22/20/17</b>	▲ 21/19/16	15/14/12

Customer Id: WESLONWC  
 Sample No.: WCI2317639  
 Lab Number: 04413723  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	MISSED	Jun 27 2018	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

### 19 Oct 2017 Diag: Don Baldrige

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 14 Jun 2016 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 21 Mar 2016 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

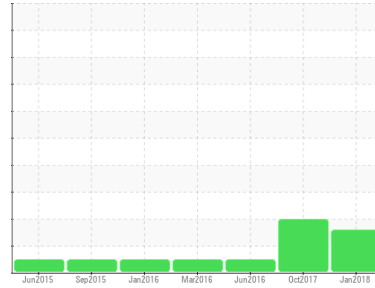

ISO



Area  
**[9381690]**  
 Machine Id  
**KAESER C-6F (S/N 752706)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number	Client Info		<b>WCI2317639</b>	WCI2328238	WCI2281999
Sample Date	Client Info		<b>24 Jan 2018</b>	19 Oct 2017	14 Jun 2016
Machine Age	hrs	Client Info	<b>82343</b>	81350	74010
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	<1	<1	1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	1
Lead	ppm	ASTM D5185m >10	0	<1	0
Copper	ppm	ASTM D5185m >50	2	2	3
Tin	ppm	ASTM D5185m >10	<1	1	0
Antimony	ppm	ASTM D5185m	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

## ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	1	<1	0
Barium	ppm	ASTM D5185m 90	14	60	9
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 90	56	81	24
Calcium	ppm	ASTM D5185m 2	0	<1	0
Phosphorus	ppm	ASTM D5185m	54	<1	33
Zinc	ppm	ASTM D5185m	5	6	28
Sulfur	ppm	ASTM D5185m	16445	5976	19261

## CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >25	2	0	<1
Sodium	ppm	ASTM D5185m	7	7	8
Potassium	ppm	ASTM D5185m >20	2	<1	2

## FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		<b>31724</b>	13601	256
Particles >6µm	ASTM D7647	>1300	▲ <b>7867</b>	▲ 4151	139
Particles >14µm	ASTM D7647	>80	▲ <b>675</b>	▲ 462	23
Particles >21µm	ASTM D7647	>20	▲ <b>225</b>	▲ 154	8
Particles >38µm	ASTM D7647	>4	▲ <b>22</b>	▲ 21	1
Particles >71µm	ASTM D7647	>3	▲ <b>2</b>	▲ 5	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>22/20/17</b>	▲ 21/19/16	15/14/12


## FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.383</b>	0.359	0.391




# OIL ANALYSIS REPORT


▲ Particle Trend

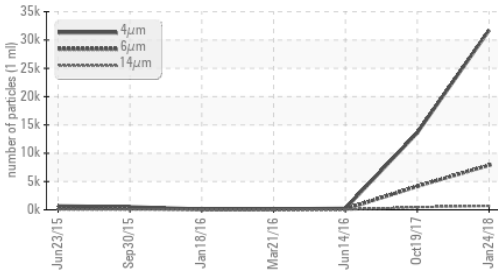


▲ Particle Trend

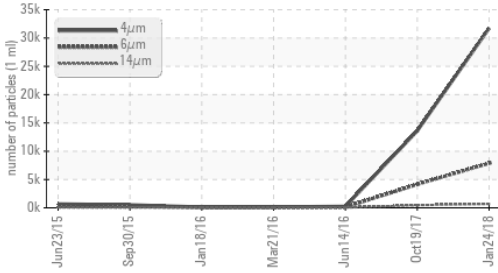

Acid Number

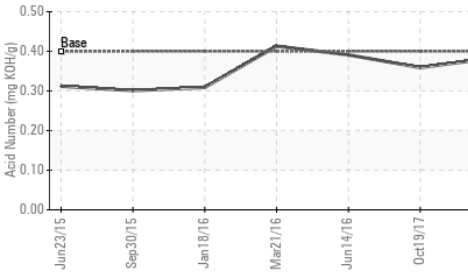


Viscosity @ 40°C

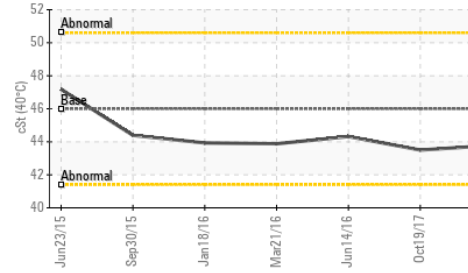

VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	VLITE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445 46	43.78	43.5	44.32

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

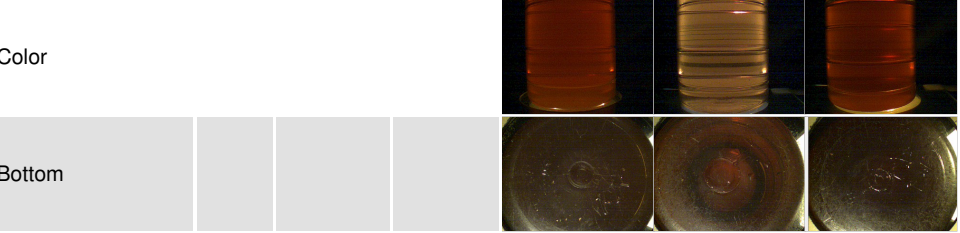


## GRAPHS


Ferrous Alloys

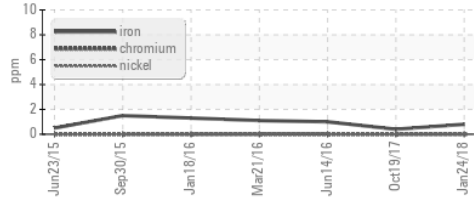


Non-ferrous Metals

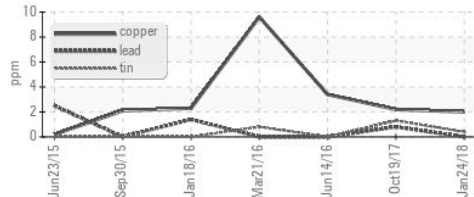


Viscosity @ 40°C

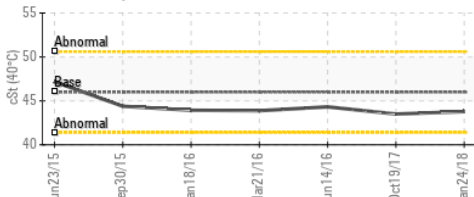

▲ Particle Count

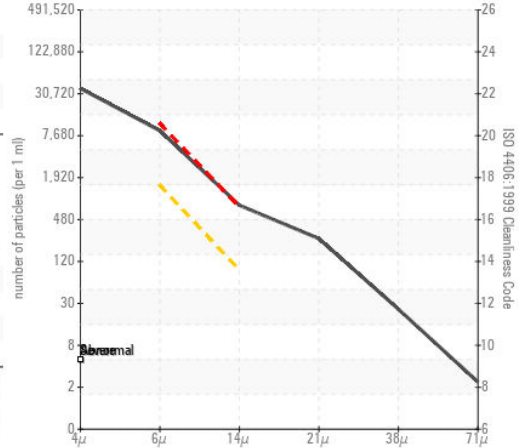

Acid Number

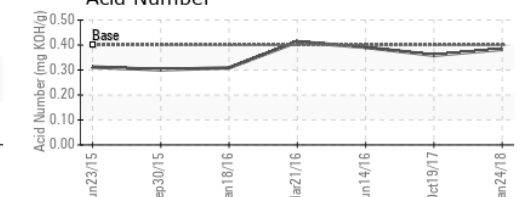

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC12317639 Received : 22 Feb 2018  
 Lab Number : 04413723 Diagnosed : 23 Feb 2018  
 Unique Number : 8107427 Diagnostician : Don Baldrige  
 Test Package : IND 2 ( Additional Tests: PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

2290 CALLAHAN RD  
 LONGVIEW, TX  
 US 75607  
 Contact: ROB WALLIN  
 rwallin@westlake.com  
 T: (903)242-7576  
 F: (903)758-9521