



PROBLEM SUMMARY

Sample Rating Trend


ISO



Machine Id
KAESER C-706 (S/N 1031)


Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

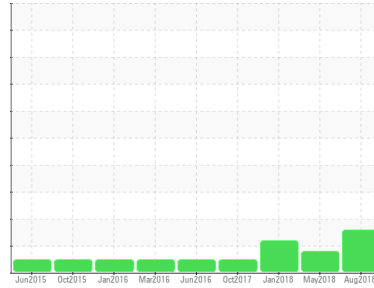

COMPONENT CONDITION SUMMARY

▲ Particle Trend

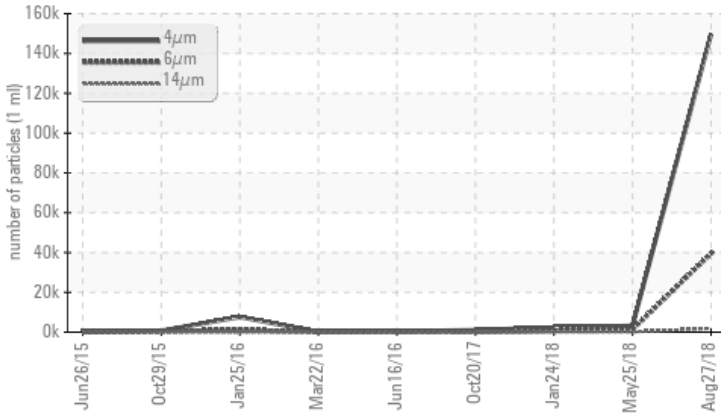

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 39446	1228	724
Particles >14µm	ASTM D7647	>80	▲ 1858	▲ 158	▲ 117
Particles >21µm	ASTM D7647	>20	▲ 482	▲ 44	▲ 42
Particles >38µm	ASTM D7647	>4	▲ 18	0	▲ 7
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 24/22/18	▲ 19/17/14	▲ 18/17/14

Customer Id: WESLONWC
Sample No.: WCI2313842
Lab Number: 04555172
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	MISSED	Feb 04 2019	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

25 May 2018 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



24 Jan 2018 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



20 Oct 2017 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

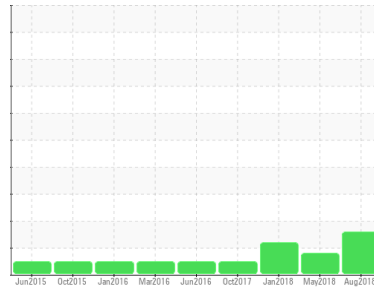

ISO



Machine Id
KAESER C-706 (S/N 1031)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number	Client Info		WCI2313842	WCI2333155	WCI2313846
Sample Date	Client Info		27 Aug 2018	25 May 2018	24 Jan 2018
Machine Age	hrs	Client Info	14552	12357	9615
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ATTENTION	ATTENTION

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	<1	0	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	0	<1	<1
Copper	ppm	ASTM D5185m >50	8	5	8
Tin	ppm	ASTM D5185m >10	0	<1	0
Antimony	ppm	ASTM D5185m	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0	2
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	<1	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 90	<1	0	0
Calcium	ppm	ASTM D5185m 2	<1	0	0
Phosphorus	ppm	ASTM D5185m	6	7	44
Zinc	ppm	ASTM D5185m	2	0	0
Sulfur	ppm	ASTM D5185m	15514	4671	14626

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >25	<1	<1	0
Sodium	ppm	ASTM D5185m	<1	0	2
Potassium	ppm	ASTM D5185m >20	<1	<1	3

FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		149664	3165	2358
Particles >6µm	ASTM D7647	>1300	▲ 39446	1228	724
Particles >14µm	ASTM D7647	>80	▲ 1858	▲ 158	▲ 117
Particles >21µm	ASTM D7647	>20	▲ 482	▲ 44	▲ 42
Particles >38µm	ASTM D7647	>4	▲ 18	0	▲ 7
Particles >71µm	ASTM D7647	>3	0	0	2
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 24/22/18	▲ 19/17/14	▲ 18/17/14


FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.456	0.602	0.409




OIL ANALYSIS REPORT


▲ Particle Trend

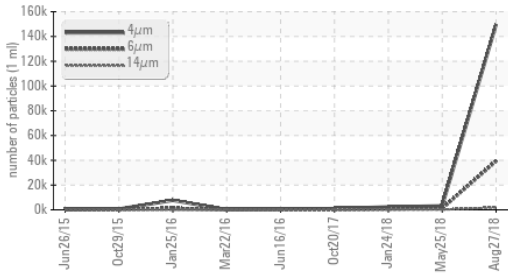


▲ Particle Trend

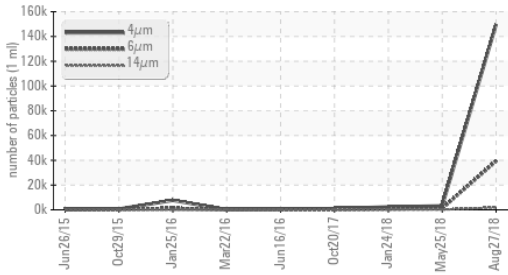

Acid Number

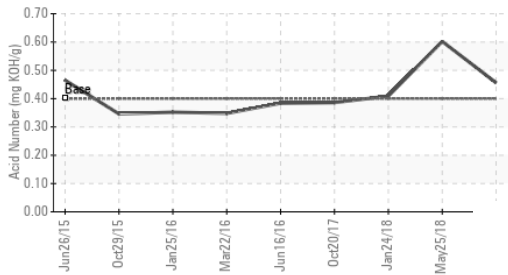


Viscosity @ 40°C

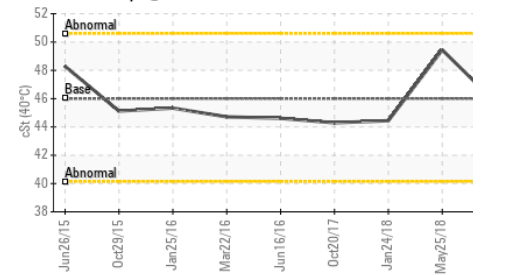

VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	VLITE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	VLITE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445 46	45.7	49.44	44.44

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

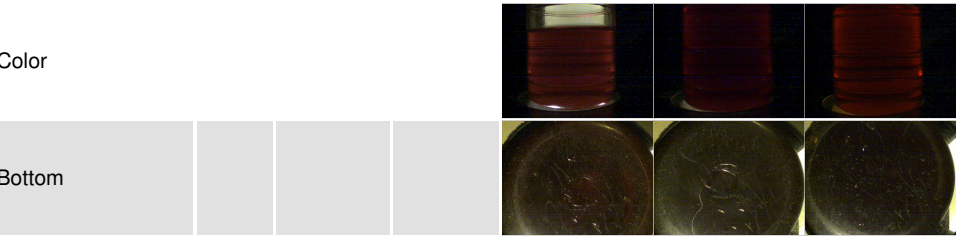


GRAPHS


Ferrous Alloys

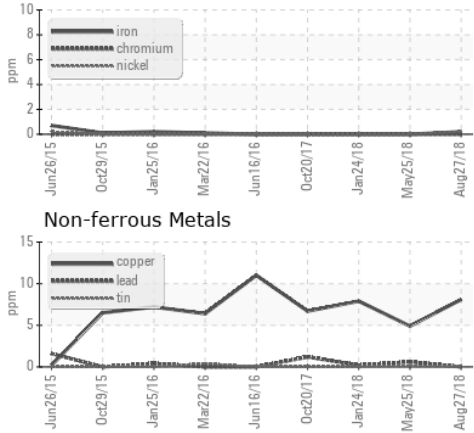


Non-ferrous Metals

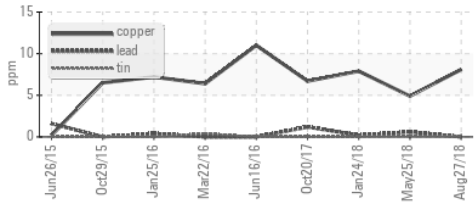


Viscosity @ 40°C

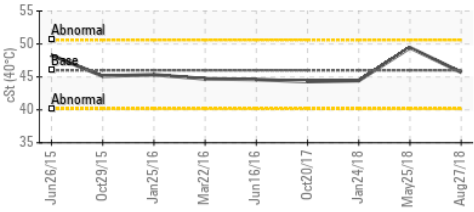

▲ Particle Count

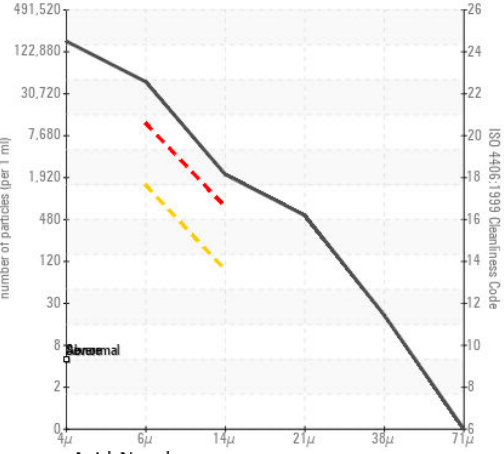

Acid Number

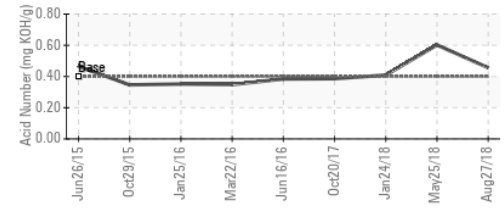

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC12313842 **Received** : 20 Sep 2018
Lab Number : 04555172 **Diagnosed** : 21 Sep 2018
Unique Number : 8339030 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

WESTLAKE CHEMICAL
 2290 CALLAHAN RD
 LONGVIEW, TX
 US 75607
 Contact: ROB WALLIN
 rwallin@westlake.com
 T: (903)242-7576
 F: (903)758-9521