




# OIL ANALYSIS REPORT

Sample Rating Trend

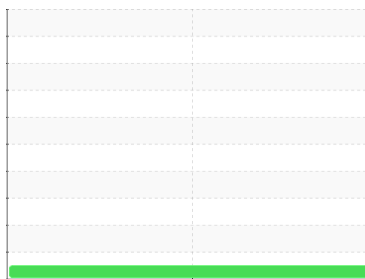

**NORMAL**



Area

**ZPAG 32**

Machine Id

**KAESER DS 140 1421083 - SPARTECH**

Component

**Compressor**

## DIAGNOSIS

### Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The oil viscosity is higher than expected. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCZ04567545</b>	---	---
Sample Date	Client Info			<b>02 Oct 2018</b>	---	---
Machine Age	hrs	Client Info		<b>52529</b>	---	---
Oil Age	hrs	Client Info		<b>4000</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	<b>NEG</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>7</b>	---	---
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Antimony	ppm	ASTM D5185m		<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185m	525	<b>9</b>	---	---
Molybdenum	ppm	ASTM D5185m	10	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	5	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	10	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	250	<b>2</b>	---	---
Zinc	ppm	ASTM D5185m	100	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	400	<b>287</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>2</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.576</b>	---	---



# OIL ANALYSIS REPORT

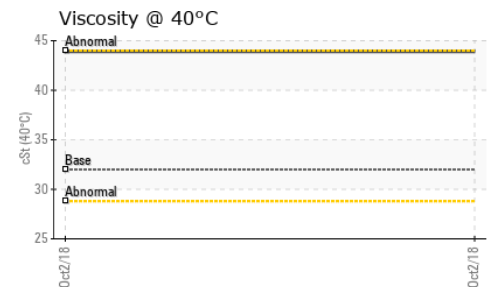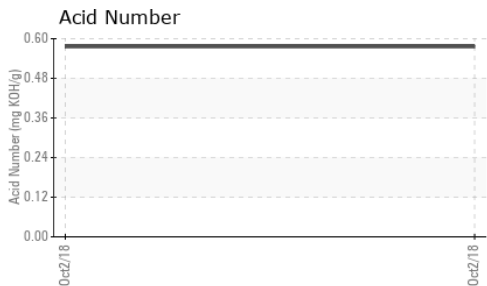





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 32	<b>43.91</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

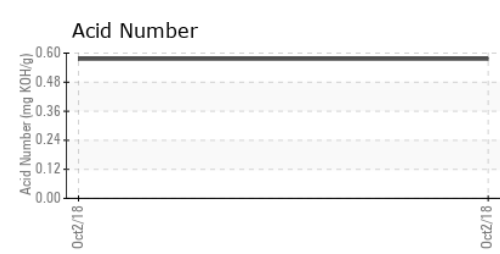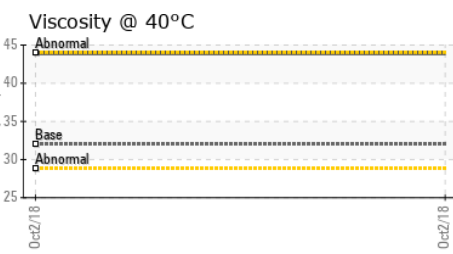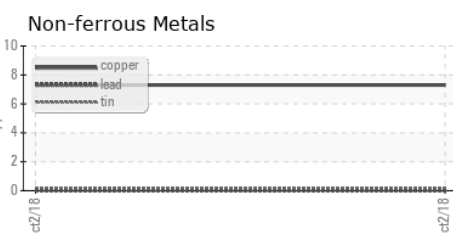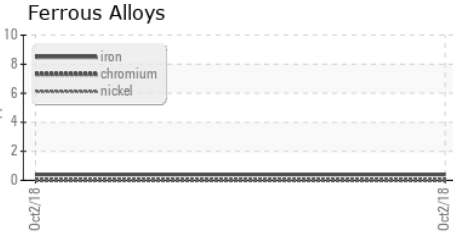

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCZ04567545      **Received** : 09 Oct 2018  
**Lab Number** : **04567545**      **Tested** : 11 Oct 2018  
**Unique Number** : 8356452      **Diagnosed** : 11 Oct 2018 - Angela Borella  
**Test Package** : IND 2

**ZORN COMP & EQUIPMENT CO (GB)**  
 733 POTTS AVE  
 GREEN BAY, WI  
 US 54304  
 Contact: DEAN SCHAD  
 dean.schad@zornair.com  
 T: (920)391-8121  
 F: (920)499-1168

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)