


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id KAESER CSD 75 6019866 (S/N 1348)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2018	Jan2019		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC75450	KC63826	
Sample Date		Client Info		07 Jan 2019	30 May 2018	
Machine Age	hrs	Client Info		2617	1550	
Oil Age	hrs	Client Info		1900	1550	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	2	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m	>50	3	6	
Tin	ppm	ASTM D5185m	>10	<1	0	
Antimony	ppm	ASTM D5185m		0	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	34	16	
Calcium	ppm	ASTM D5185m	2	<1	0	
Phosphorus	ppm	ASTM D5185m		0	0	
Zinc	ppm	ASTM D5185m		12	15	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m	725	4	4	
Potassium	ppm	ASTM D5185m	>20	7	7	
Water	%	ASTM D5103111	>0.05	0.011	0.015	
ppm Water	ppm	ASTM D6304	>500	110	150	
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3707		
Particles >6µm		ASTM D7647	>1300	871		
Particles >14µm		ASTM D7647	>80	26		
Particles >21µm		ASTM D7647		3		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/12		
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.408	0.452	
- · · · · · · · · · · · · · · · · · · ·						



OIL ANALYSIS REPORT

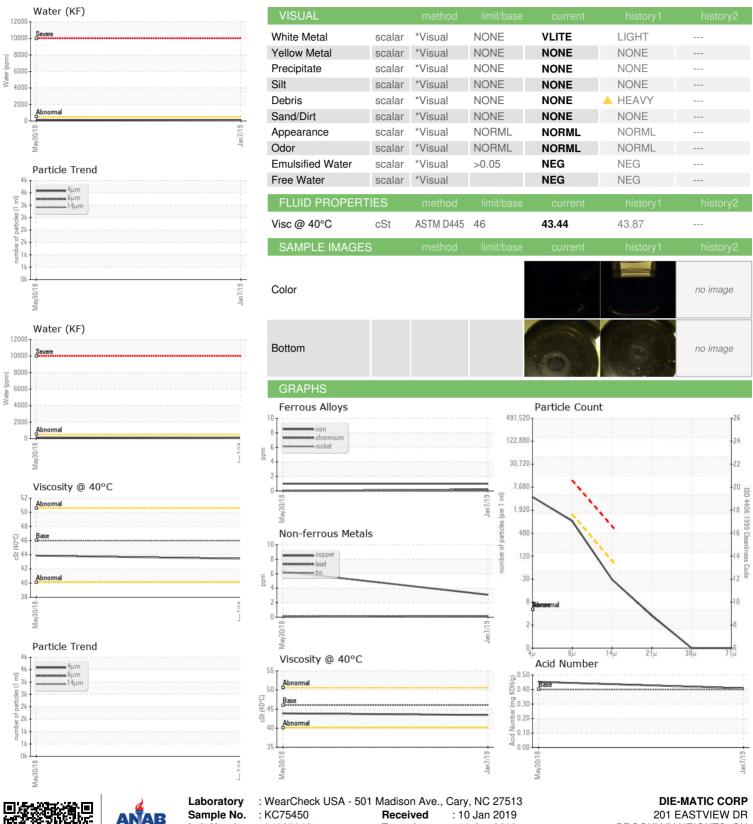



Certificate L2367

Lab Number

: 04627013 Unique Number: 8458439

Test Package : IND 2

Tested : 11 Jan 2019 Diagnosed

: 11 Jan 2019 - Jonathan Hester

BROOKLYN HEIGHTS, OH US 44131

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: