




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

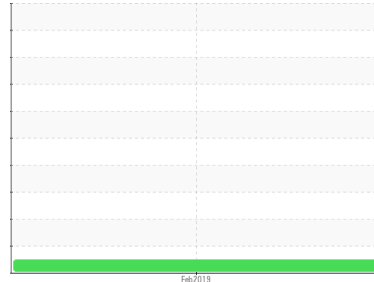

Machine Id
CTG-300

Component
Reservoir Oil

Fluid
MOBIL DTE 824 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP202585	---	---
Sample Date	Client Info		12 Feb 2019	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<1	---	---
Chromium	ppm	ASTM D5185m >15	0	---	---
Nickel	ppm	ASTM D5185m >15	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m >25	0	---	---
Lead	ppm	ASTM D5185m >100	0	---	---
Copper	ppm	ASTM D5185m >200	<1	---	---
Tin	ppm	ASTM D5185m >25	0	---	---
Antimony	ppm	ASTM D5185m	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<1	---	---
Barium	ppm	ASTM D5185m	<1	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	<1	---	---
Calcium	ppm	ASTM D5185m	3	---	---
Phosphorus	ppm	ASTM D5185m	1066	---	---
Zinc	ppm	ASTM D5185m	6	---	---




CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<1	---	---
Sodium	ppm	ASTM D5185m	12	---	---
Potassium	ppm	ASTM D5185m >20	<1	---	---
Water	%	ASTM D6304 >0.2	0.001	---	---
ppm Water	ppm	ASTM D6304 >2000	10	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.190	---	---

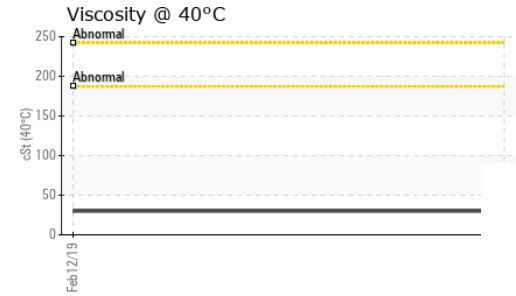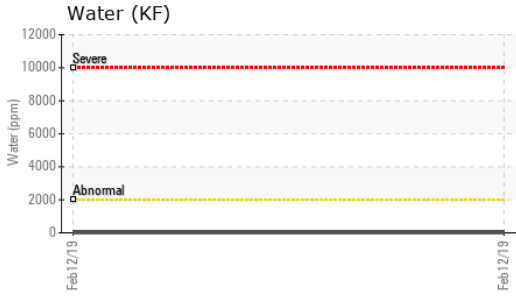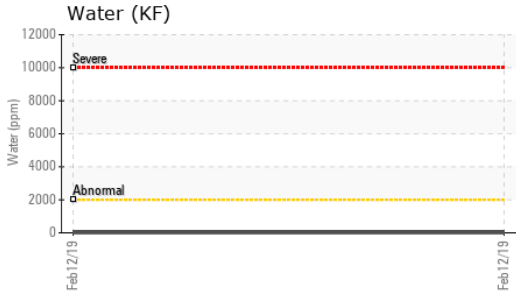

OIL ANALYSIS REPORT






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	---	---
Precipitate	scalar	*Visual	NONE	---	---
Silt	scalar	*Visual	NONE	---	---
Debris	scalar	*Visual	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	---	---
Appearance	scalar	*Visual	NORML	---	---
Odor	scalar	*Visual	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	---	---
Free Water	scalar	*Visual	---	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	29.9	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

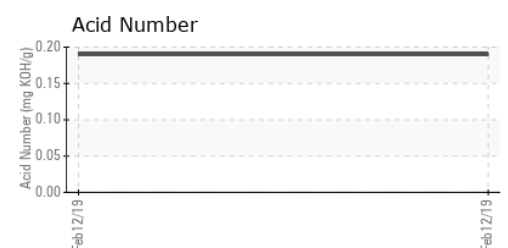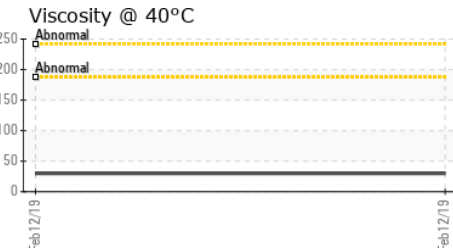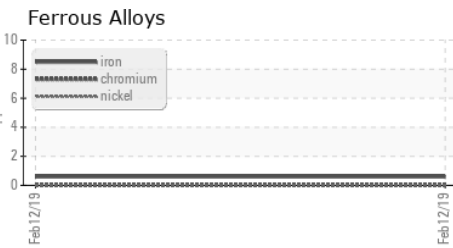

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP202585 **Reieved** : 18 Feb 2019
Lab Number : 04653159 **Diagnosed** : 19 Feb 2019
Unique Number : 8499659 **Diagnostician** : Jonathan Hester
Test Package : IND 2

ENGIE-MATEP
 474 BROOKLINE AVE
 BOSTON, MA
 US 02215
 Contact: ROBERT ST SAUVEUR
 robert.stsauveur@engie.com
 T: (401)651-9381
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)