




# OIL ANALYSIS REPORT

Sample Rating Trend

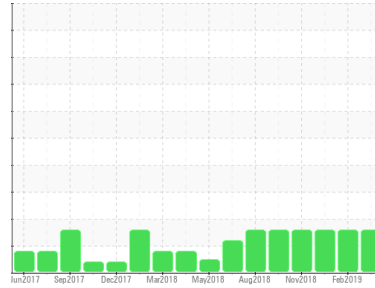

ISO



Area  
**RAW MATS**  
Machine Id  
**DISCHARGE HYD UNIT BALL MILL 2**  
Component  
**Hydraulic System**  
Fluid  
**MOBIL SHC 630 (25 GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0312509</b>	WC0312566	WCI2351112
Sample Date	Client Info		<b>29 Mar 2019</b>	18 Feb 2019	15 Jan 2019
Machine Age	days	Client Info	<b>0</b>	0	0
Oil Age	days	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>14</b>	13	20
Iron	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	2
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	2
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>461</b>	380	410
Zinc	ppm	ASTM D5185m	<b>0</b>	<1	0
Sulfur	ppm	ASTM D5185m	<b>14</b>	59	65

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>15</b>	14	12
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Water	%	ASTM D6304 >0.05	<b>0.002</b>	0.001	0.002
ppm Water	ppm	ASTM D6304 >500	<b>20</b>	10	20

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>640	<b>▲ 59835</b>	▲ 3773	▲ 102768
Particles >6µm	ASTM D7647	>160	<b>▲ 9245</b>	▲ 911	▲ 16634
Particles >14µm	ASTM D7647	>20	<b>▲ 172</b>	▲ 33	▲ 516
Particles >21µm	ASTM D7647	>4	<b>▲ 17</b>	▲ 8	▲ 80
Particles >38µm	ASTM D7647	>3	<b>0</b>	0	2
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>16/14/11	<b>▲ 23/20/15</b>	▲ 19/17/12	▲ 24/21/16



# OIL ANALYSIS REPORT

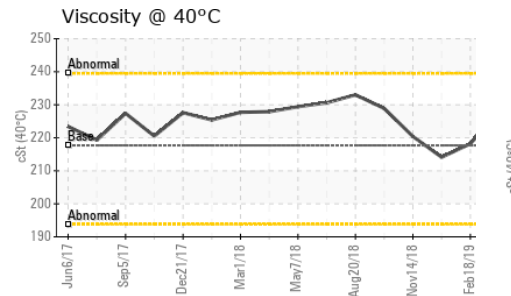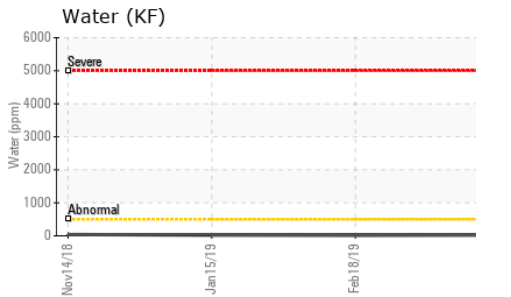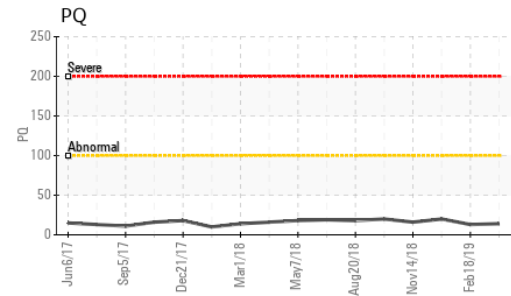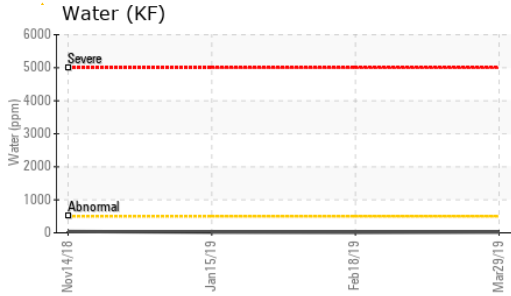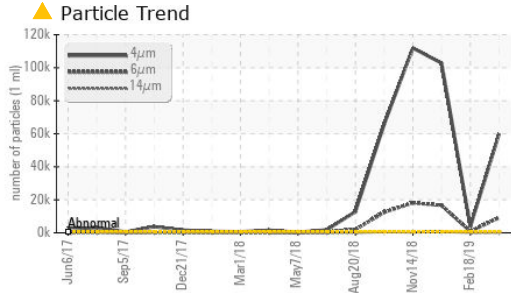


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.734</b>	0.434	0.366





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	217.7	<b>227.9</b>	218.2	214.1

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

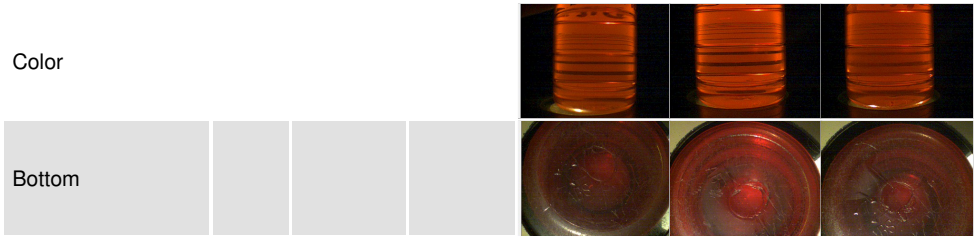

## GRAPHS

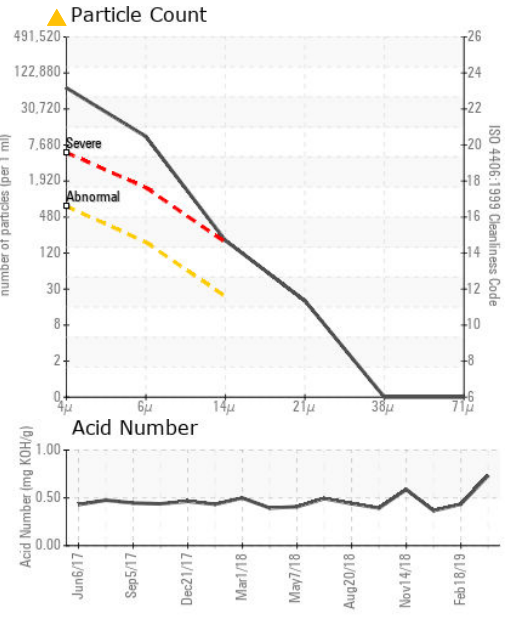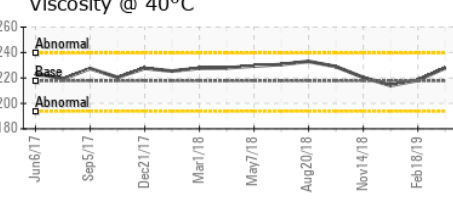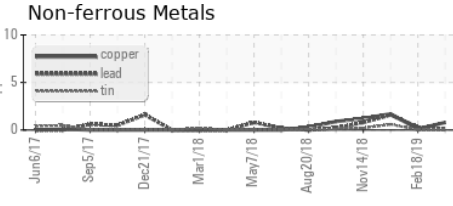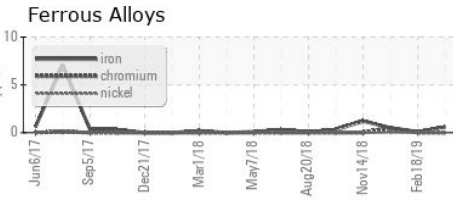

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0312509 **Received** : 05 Apr 2019  
**Lab Number** : **04685670** **Diagnosed** : 08 Apr 2019  
**Unique Number** : 8552186 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PQ )

**JAMES HARDIE BUILDING PRODUCTS - PULASKI**  
 1000 JAMES HARDIE WAY  
 PULASKI, VA  
 US 24031  
 Contact: MICHAEL MITCHELL  
 mike.mitchell@jameshardie.com  
 T:  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)