




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

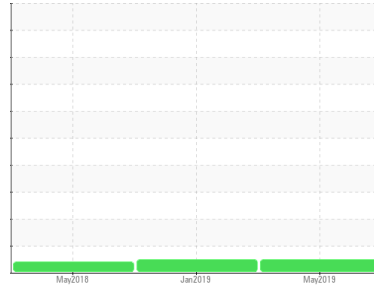

Machine Id
KAESER CSD 75 6019866 (S/N 1348)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC74855	KC75450	KC63826
Sample Date	Client Info			29 May 2019	07 Jan 2019	30 May 2018
Machine Age	hrs	Client Info		3459	2617	1550
Oil Age	hrs	Client Info		800	1900	1550
Oil Changed	Client Info			Changed	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	1	1
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	2	2
Lead	ppm	ASTM D5185m	>10	0	<1	<1
Copper	ppm	ASTM D5185m	>50	6	3	6
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m		0	0	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	21	34	16
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		21	12	15

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	<1	0
Sodium	ppm	ASTM D5185m		5	4	4
Potassium	ppm	ASTM D5185m	>20	7	7	7
Water	%	ASTM D6304	>0.05	0.017	0.011	0.015
ppm Water	ppm	ASTM D6304	>500	170	110	150

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		507	3707	---
Particles >6µm		ASTM D7647	>1300	178	871	---
Particles >14µm		ASTM D7647	>80	24	26	---
Particles >21µm		ASTM D7647	>20	6	3	---
Particles >38µm		ASTM D7647	>4	0	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	15/12	17/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.423	0.408	0.452


OIL ANALYSIS REPORT

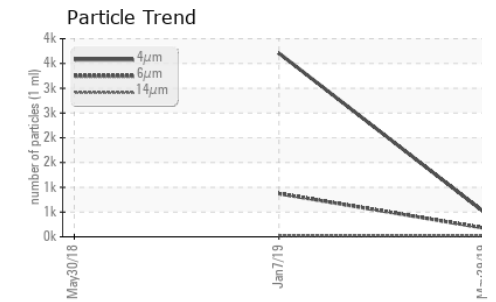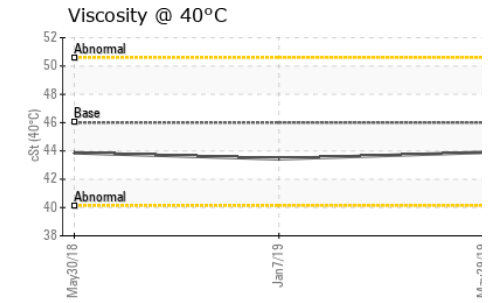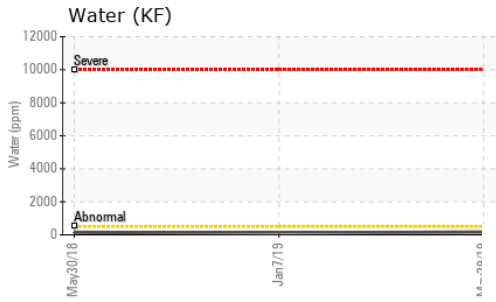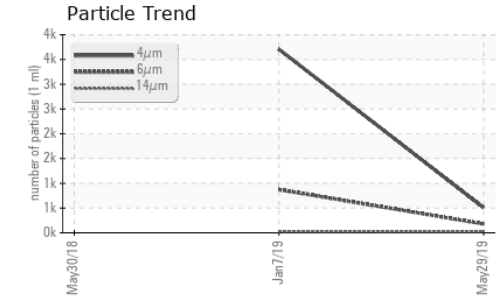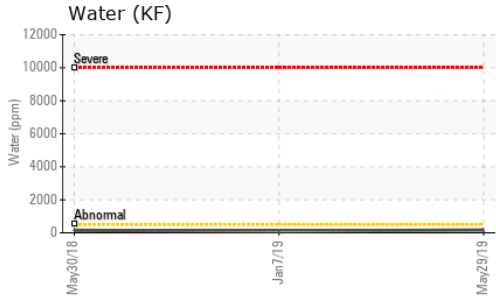






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE NONE
Silt	scalar	*Visual	NONE	NONE	NONE NONE
Debris	scalar	*Visual	NONE	NONE	NONE ▲ HEAVY
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE NONE
Appearance	scalar	*Visual	NORML	NORML	NORML NORML
Odor	scalar	*Visual	NORML	NORML	NORML NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG NEG
Free Water	scalar	*Visual		NEG	NEG NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.9	43.44	43.87

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

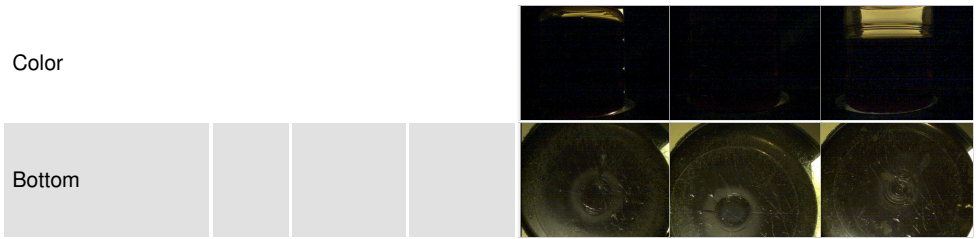

GRAPHS

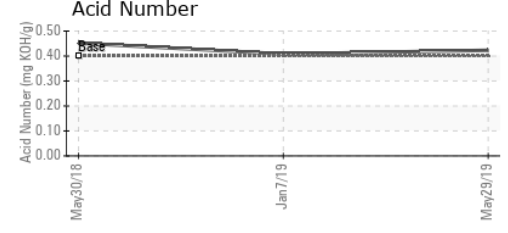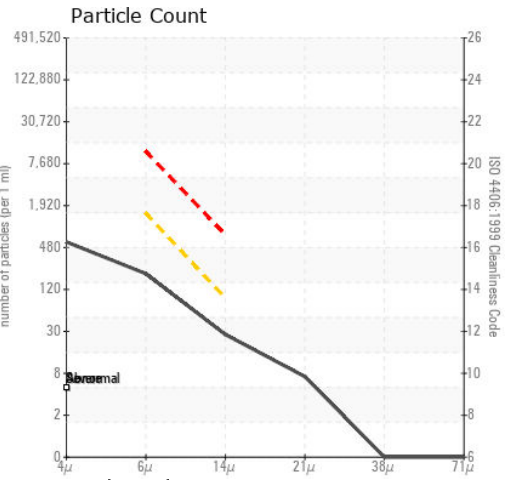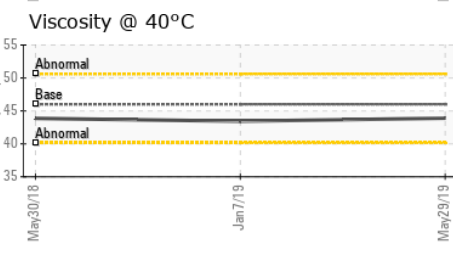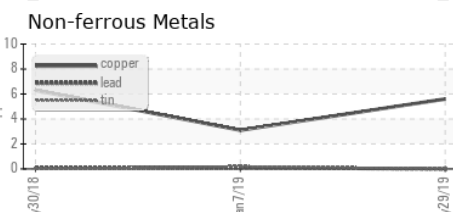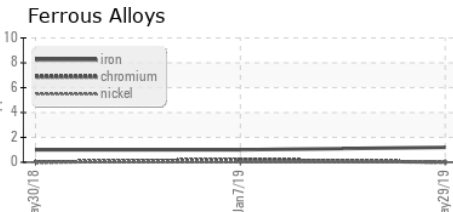

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC74855 **Received** : 03 Jun 2019
Lab Number : 04725573 **Tested** : 04 Jun 2019
Unique Number : 8617347 **Diagnosed** : 04 Jun 2019 - Don Baldrige
Test Package : IND 2

DIE-MATIC CORP
 201 EASTVIEW DR
 BROOKLYN HEIGHTS, OH
 US 44131
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: