

PROBLEM SUMMARY

Sample Rating Trend


ISO

KAESER AIRCENTER SM 10 6389211 (S/N 1201)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

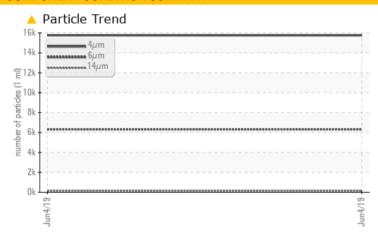

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST	T RESULTS			
Sample Status			ABNORMAL	
Particles >6µm	ASTM D7647	>1300	<u></u> 6321	
Particles >14µm	ASTM D7647	>80	<u> </u>	
Oil Cleanliness	ISO 4406 (c)	>/17/13	20/14	

Customer Id: MAGSANFL Sample No.: KC75751 Lab Number: 04741958 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDE	O ACTIONS			
Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

KAESER AIRCENTER SM 10 6389211 (S/N 1201)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun 2019		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
		Client Info	minu bacc	KC75751		
Sample Number Sample Date				04 Jun 2019		
•	bro	Client Info				
Machine Age	hrs	Client Info		536		
Oil Age	hrs	Client Info		536		
Oil Changed		Client Info		Changed ABNORMAL		
Sample Status				ADNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Γitanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
_ead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	1		
Γin	ppm	ASTM D5185m	>10	<1		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
					History	
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	27		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	70		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	5		
CONTAMINANTS	S	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	- 20	10		
Potassium	ppm	ASTM D5185m	>20	2		
Vater	%	ASTM D510311	>0.05	0.031		
opm Water	ppm	ASTM D6304 ASTM D6304	>50.03	310		
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		15763		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u>▲</u> 151		
Particles >21µm		ASTM D7647	>20	18		
Particles >38µm		ASTM D7647	>4	1		
Particles >36µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>↓</u> 20/14		
		. ,				
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	ma K∩U/a	VCTM D804E	1.0	0.276		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.276



OIL ANALYSIS REPORT

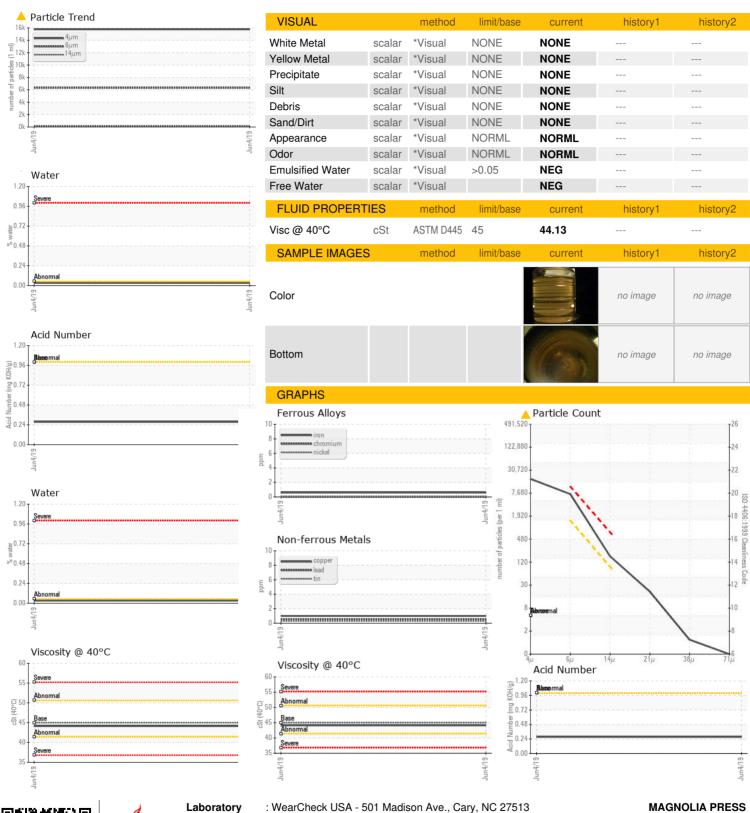





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package

: KC75751 : 04741958

: 8644666

Received Diagnosed

Diagnostician

: 25 Jun 2019 : 27 Jun 2019 : Jonathan Hester **MAGNOLIA PRESS** 104 LOREN COURT SANFORD, FL US 32771

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: