


OIL ANALYSIS REPORT

Sample Rating Trend

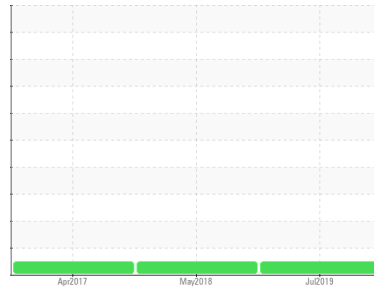

Machine Id
QUINCY QUINCY VACUUM PUMP 11
 Component
Vacuum Pump
 Fluid
TULCO LUBSOIL SYNTHETIC COMPRESSOR 46 (--- GAL)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is no indication of any contamination in the oil.

Fluid Condition
 The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TO5010839	TO5010020	TO5007995
Sample Date	Client Info			23 Jul 2019	14 May 2018	03 Apr 2017
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method			NEG	NEG	NEG




WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		14	---	16
Iron	ppm	ASTM D5185m	>500	<1	<1	<1
Chromium	ppm	ASTM D5185m	>7	0	0	0
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	<1	1
Lead	ppm	ASTM D5185m	>35	2	<1	2
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>5	0	0	0
Antimony	ppm	ASTM D5185m		2	4	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		<1	<1	1
Phosphorus	ppm	ASTM D5185m	74	46	49	88
Zinc	ppm	ASTM D5185m		1	1	3
Sulfur	ppm	ASTM D5185m	1000	680	540	444

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<1	0	<1
Sodium	ppm	ASTM D5185m		7	9	29
Potassium	ppm	ASTM D5185m	>20	0	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.236	---	0.154	---

OIL ANALYSIS REPORT



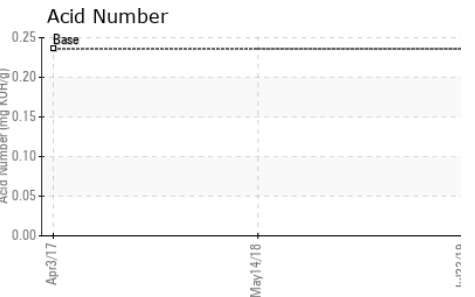
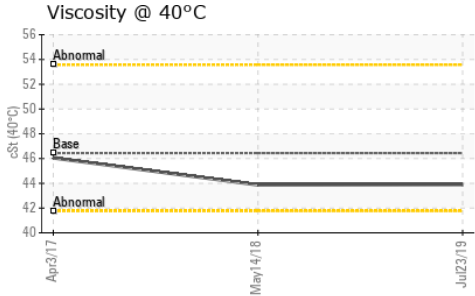
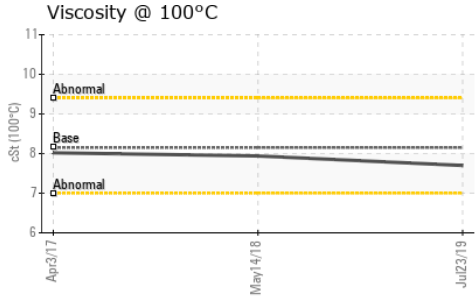


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.44	43.87	46.05
Visc @ 100°C	cSt	ASTM D445	8.15	7.94	8.02
Viscosity Index (VI)	Scale	ASTM D2270	149	154	146

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

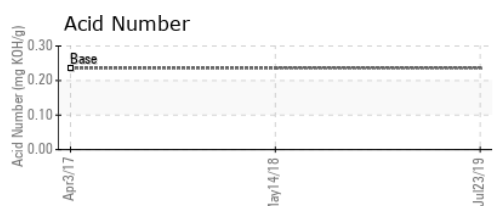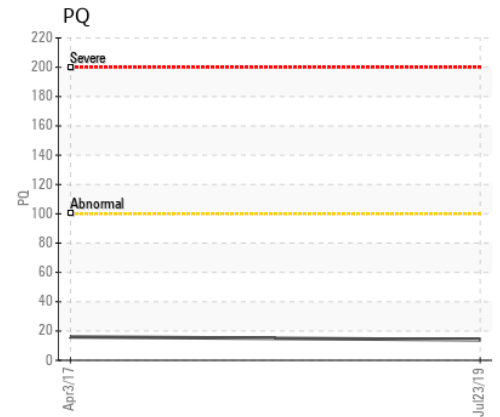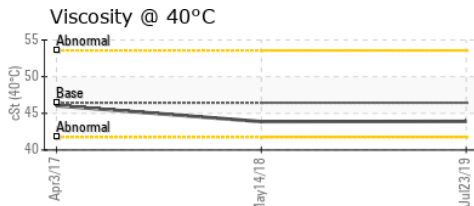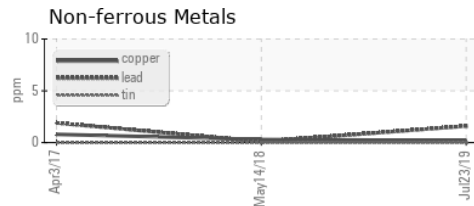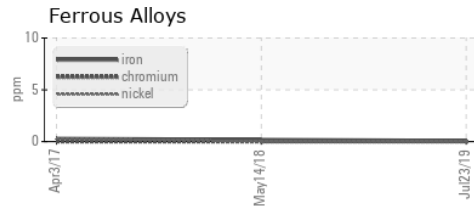

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO5010839 **Received** : 24 Jul 2019
Lab Number : **04761541** **Tested** : 25 Jul 2019
Unique Number : 8674267 **Diagnosed** : 25 Jul 2019 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KV100, PQ, VI)

DALLAS MORNING NEWS
 3900 W PLANO PKWY
 PLANO, TX
 US 75075
 Contact: KENNY CLARK
 kclark@dallasnews.com
 T: (214)977-6929
 F: (214)977-6888

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)