

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Machine Id

QUINCY QUINCY VACUUM PUMP 4

Component Vacuum Pump

Fluid TULCO LUBSOIL SYNTHETIC COMPRESSOR 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	/IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		TO5010836	TO5010092	TO5007961
Sample Date		Client Info		23 Jul 2019	14 May 2018	03 Apr 2017
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	NORMAL
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method		NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		17		11
Iron	ppm	ASTM D5185m	>500	1	2	1
Chromium	ppm	ASTM D5185m	>7	<1	<1	0
Nickel	ppm	ASTM D5185m		<1	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	<1	<1
Lead	ppm	ASTM D5185m	>35	2	<1	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>5	<1	<1	0
Antimony	ppm	ASTM D5185m		2	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m		<1	<1	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		2	2	<1
Calcium	ppm	ASTM D5185m		6	8	7
Phosphorus	ppm	ASTM D5185m	74	120	132	139
Zinc	ppm	ASTM D5185m		14	14	13
Sulfur	ppm	ASTM D5185m	1000	408	334	334
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	4	4	4
Sodium	ppm	ASTM D5185m		29	30	32
Potassium	ppm	ASTM D5185m	>20	0	0	0
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.236		0.152	




OIL ANALYSIS REPORT





Acid Num		
ō0.20		
0.20 0.15 0.10 0.05		
°0.15		
0.10		
0.05		
0.05		
0.00		
Apr3/17	Mav14/18	

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
			NONE		NONE	NONE
Precipitate	scalar	*Visual		NONE		
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual		NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.44	44.0	44.22	43.82
Visc @ 100°C	cSt	ASTM D445	8.15	7.6	7.89	7.71
Visc @ 100°C Viscosity Index (VI)	cSt Scale	ASTM D445 ASTM D2270	8.15 149	7.6 140	7.89 150	7.71 145
-	Scale					
Viscosity Index (VI)	Scale	ASTM D2270	149	140	150	145

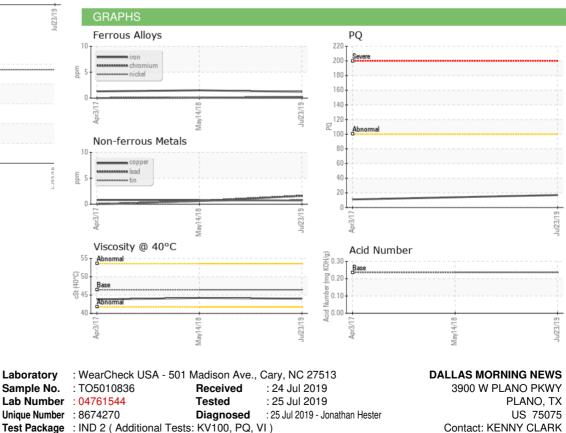

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: DALPLATO [WUSCAR] 04761544 (Generated: 05/06/2024 15:00:30) Rev: 1

Certificate 12367

Contact/Location: KENNY CLARK - DALPLATO

kclark@dallasnews.com

T: (214)977-6929

F: (214)977-6888