

**OIL ANALYSIS REPORT** 

7024100 (S/N 1014)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

# Sample Rating Trend **NORMAL**

# Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

# Contamination

The amount and size of particulates present in the system is acceptable. There is no indication of any contamination in the component.


# **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan2020		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC84476		
Sample Date		Client Info		02 Jan 2020		
Machine Age	hrs	Client Info		2564		
Oil Age	hrs	Client Info		2564		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	1		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	5		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.002		
ppm Water	ppm	ASTM D6304	>500	24.8		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		960		
Particles >6µm		ASTM D7647	>1300	421		
Particles >14µm		ASTM D7647	>80	28		
Particles >21µm		ASTM D7647	>20	8		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/12		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.462		



# **OIL ANALYSIS REPORT**

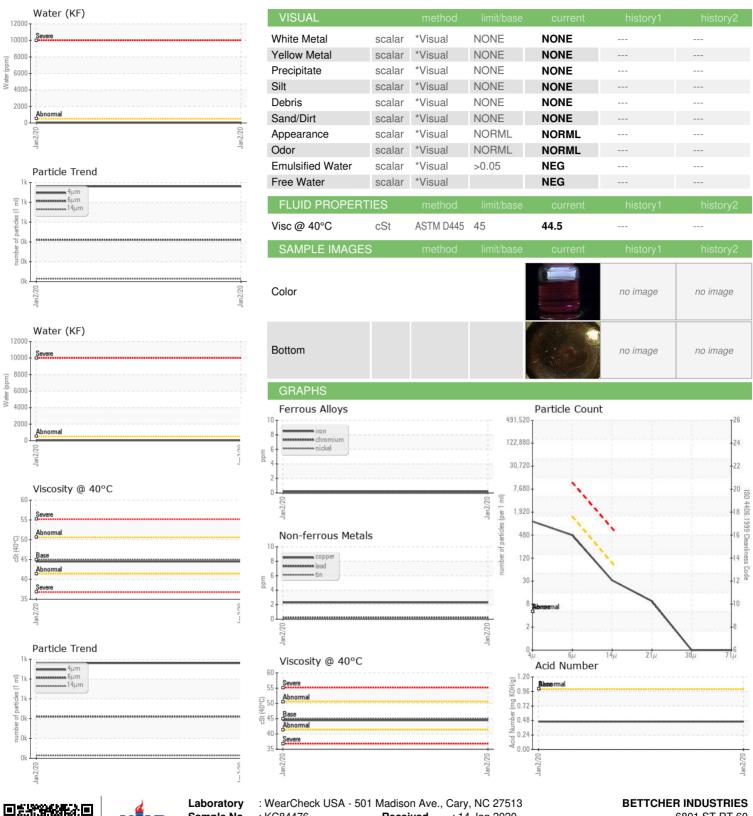



Certificate L2367

Sample No. Lab Number Unique Number

: KC84476 : 04887408

: 8882451 Test Package : IND 2

Received : 14 Jan 2020 **Tested** : 15 Jan 2020

: 15 Jan 2020 - Don Baldridge Diagnosed

6801 ST RT 60 BIRMINGHAM, OH US 44889

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: