




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**P2**  
 Machine Id  
**3543-B - 3540-B CRYSTALLIZER**  
 Component  
**Gearbox**  
 Fluid  
**MOBIL MOBILGEAR 600 XP ISO 150 (44 QTS)**

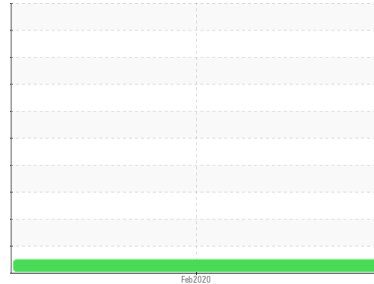

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0425046</b>	---	---
Sample Date	Client Info		<b>24 Feb 2020</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>150</b>	---	---
Oil Changed	Client Info		<b>Not Chngd</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m >15	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >15	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >200	<b>0</b>	---	---
Tin	ppm	ASTM D5185m >25	<b>0</b>	---	---
Antimony	ppm	ASTM D5185m	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>27</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>332</b>	---	---
Zinc	ppm	ASTM D5185m	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>14504</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Water	%	ASTM D6304 >0.2	<b>0.007</b>	---	---
ppm Water	ppm	ASTM D6304 >2000	<b>70</b>	---	---

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>10269</b>	---	---
Particles >6µm	ASTM D7647	>5000	<b>2486</b>	---	---
Particles >14µm	ASTM D7647	>640	<b>168</b>	---	---
Particles >21µm	ASTM D7647	>160	<b>50</b>	---	---
Particles >38µm	ASTM D7647	>40	<b>4</b>	---	---
Particles >71µm	ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>21/18/15</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.731</b>	---	---



# OIL ANALYSIS REPORT

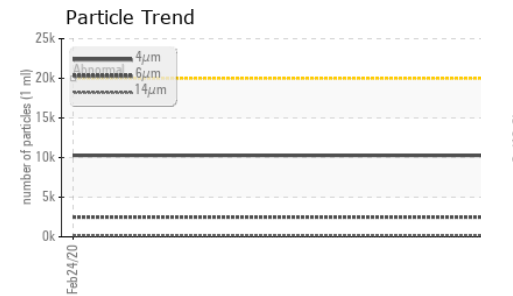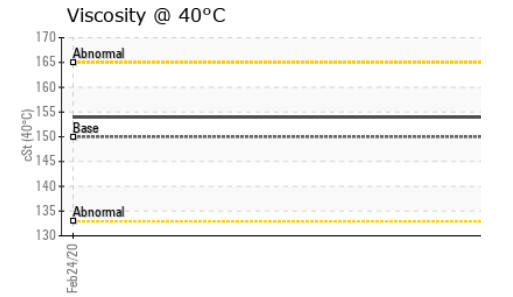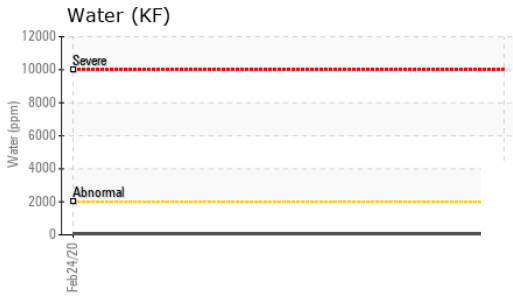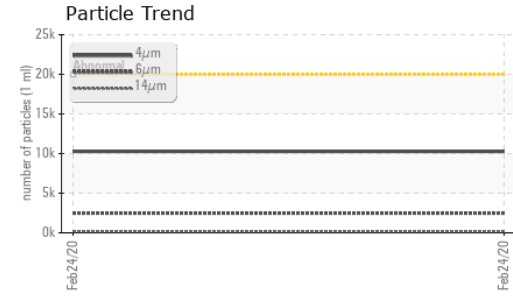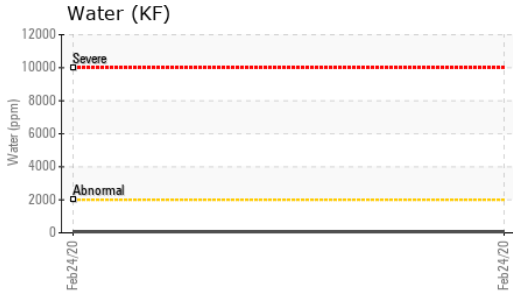





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	154	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

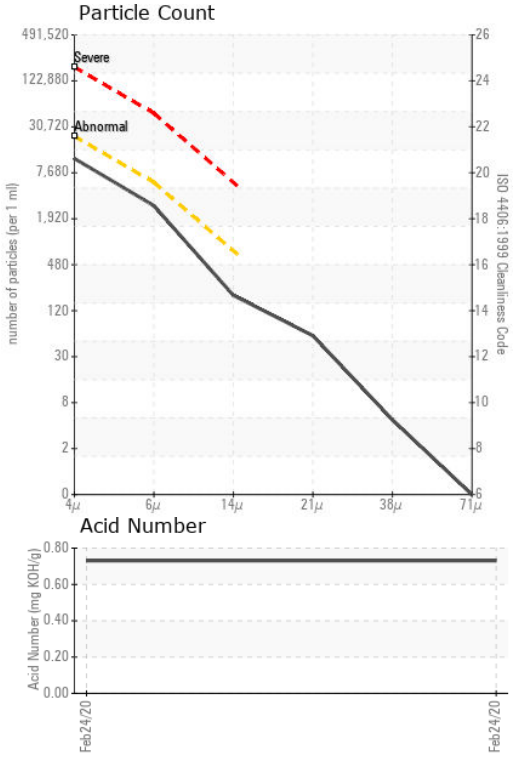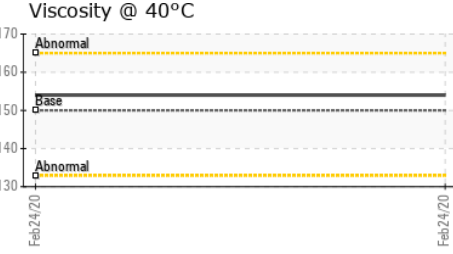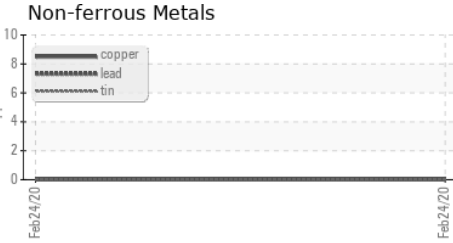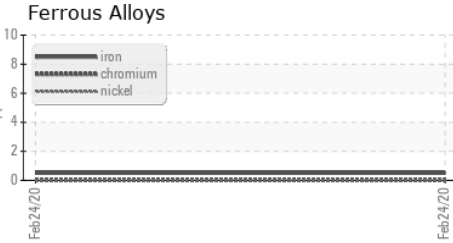

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0425046      Recieved : 26 Feb 2020  
 Lab Number : 04920870      Diagnosed : 27 Feb 2020  
 Unique Number : 8935949      Diagnostician : Wes Davis  
 Test Package : IND 2 ( Additional Tests: KF, PrtCount )

**AJINOMOTO USA**  
 4020 AJINOMOTO DRIVE  
 RALEIGH, NC  
 US 27610  
 Contact: Michael Thompson  
 thompsonm@ajiusa.com  
 T: (919)723-2142  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)